

Memorandum Department of Planning

To: Planning and Public Works Committee

From: Shilpi Bharti, Planner

Date: November 10, 2022

RE: FSP 57-2022 Verizon (13426 Olive Blvd.): A request for a new Facilities

Siting Permit to install a new wireless telecommunications facility located along Olive Boulevard Right-of-Way on property addressed as 13426 Olive

Blvd. (Ward 1)

Summary

Verizon has submitted a Facilities Siting Permit (FSP) application to install a new wireless telecommunications facility along MO DOT right-of-way of 13426 Olive Blvd., as shown in the aerial image below.

The proposed installation consists of a standard wood utility pole. Equipment and antennas will be mounted on the pole. The total height of the pole with antenna mounted on top will be 35' in height.

The proposed installation is compliant with the requirements of Unified Development Code Section 405.06.040. In accordance with Section 405 of the UDC, final approval of the installation must be granted by the City Council.

Attached to this report, please find additional information regarding the proposed installation.



Figure 1: Subject Site Aerial

RECEIVED

OCT 2 0 2022

Department of Planning

DocuSign Envelope ID: E04DE880-9072-4774-802C-36B22011FA4D

verizon

SITE NAME:

STLC CHF FS 05SC

LOCATION CODE:

706081

SITE ADDRESS:

STRUCTURE TYPE:

SIONALE 13426 OLIVE BLVD CHESTERFIELD, MO, 63017

Call before you dig.

WOOD UTILITY POLE

DRAWING INDEX

SHEET TITLE

DRAWING

DESCRIPTION:

FINAL CD

T-1 TITLE SHEET

A-10 SITE PLAN

A-2.0 POLE ELEVATIONS

GN-1.0 GENERAL NOTES (1 OF 3)

GN-1 1 GENERAL NOTES (2 OF 3)

GN-1.2 GENERAL NOTES (3 OF 3)

SURVEY (BY OTHERS)

A-3.1 EQUIPMENT DETAILS (2 OF 2)

A-4.0 CABLE DIAGRAM & DETAILS

E-1.0 ELECTRICAL DETAILS (1 OF 2

E-1.1 ELECTRICAL DETAILS (2 OF 2)

G-1.0 GROUNDING RISER DIAGRAM

A-5.0 FOUNDATION DETAILS

SHEET NO

9/28/2022 OF MISS KEVIN VANMAELE NUMBER PE-021561

4		NEERING LICENSE: -			=
	STAT	E CERTIFICATE OF AUTHOR			
	KMV	NEER: KEVIN M. VANMAELE	PE#: PE-021561	DISCIPLINE: CIVIL	c
	REJ CG	ROBERT E. JENSEN CHRISTOPHER GIANNOTTI	PE-028974	CIVIL	C
	SDK	SHELTON D. KEISLING TERRANCE M. SUPER	PE-27323 PE-18521	ELECTRICAL ELECTRICAL	E
į	_				=





DRAWING NOTICE:

THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF S.C., INC. AND IS LEIN TO THE BORROWER FOR THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND AGREES TO RETURN IN UPON REQUEST AND AGREES THAT IN WILL NOT BE REPRODUCED, COPIED, LEIN OR OTHERWISE DISPOSED OF DIRECTLY OR NOIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS PURPISHED.

SUBMITTALS: DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	02/22/22	czw	Α
REISSUED FOR REVIEW	06/14/22	CTO	В
REISSUED FOR REVIEW	06/24/22	CIO	С
ISSUED FOR CONSTRUCTION	07/19/22	czw	0
UPDATED ELEVATION	09/28/22	ABT	1

STLC CHF FS 05SC

TRD

706081

SITE ADDRESS:
13426 OLIVE BLVD CHESTERFIELD, MISSOURI 63017

TITLE SHEET

T-1

SITE INFORMATION

1A INFORMATION:

LAT(NAD83): 38° 40° 47.99° LONG(NAD83): 90° 29° 50.86°

13426 OLIVE BLVD CHESTERFIELD, MO

COUNTY: ST. LOUIS

EQUIPMENT & POWER INFO:

POLE #:

SERVICE ADDRESS: 13426 OLIVE BLVD CHESTERFIELD, MO 63017

TRANSFORMER #: TBD POWER PROVIDER: AMEREN

FIXTURE WATTAGE:

TO MATCH EXISTING

CONSULTING TEAM

7171 WEST 95TH STREET, SUITE 600 OVERLAND PARK, KANSAS 66212 (913) 438-7700 (913) 438-7777

LESSOR:

VERIZON WIRELESS 10740 NALL AVE SUITE 400 OVERLAND PARK, KANSAS 66211 PHONE: (913) 438-7700 FAX: (913) 438-7777

JURISDICTION:

CITY OF CHESTERFIELD 690 CHESTERFIELD PKWY W. CHESTERFIELD, MO 63017





ALL WORK SHALL BE PERFORMED AND MATERIALS INSTALLED IN ACCORDANCE WITH THE CURRENT EDITIONS OF THE FOLLOWING CODES A ADOPTED BY THE LOCAL GOVERNING AUTHORITIES. NOTHING IN THESE PLANS IS TO BE CONSTRUED TO PERMIT WORK NOT CONFORMING TO THESE CODES

APPLICABLE CODES

INTERNATIONAL BUILDING CODE INTERNATIONAL MECHANICAL CODE

ANSI/TIA-222 STRUCTURAL STANDARD NFPA 780 - LIGHTNING PROTECTION CODE UNIFORM PLUMBING CODE NATIONAL ELECTRICAL CODE Wirw.coil811.com

NATIONAL ELECTRIC SAFETY CODE (NESC)
AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO), STANDARD SPECIFICATION FOR STRUCTURAL SUPPORTS FOR HIGHWAY SIGNS, LUMINAIRES AND TRAFFIC SIGNALS. AMERICAN PUBLIC WORKS ASSOCIATION (APWA) AND ANY SUPPLEMENT

10. AMERICAN WITH DISABILITIES ACT (ADA) OF 1990.

11. AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI), A117.1 ACCESSIBLE AND USABLE BUILDING AND FACILITIES STANDARD

12. OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) OF 1970

13. NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) 70E, STANDARD FOR ELECTRICAL SAFETY IN THE WORKPLACE (LATEST EDITION)

DRAWING NOTICE

11"X17" PLOT WILL BE HALF SCALE UNLESS OTHERWISE NOTED

THESE SITE PLANS ADHERE TO ALL OF THE REQUIREMENTS CALLED OUT IN THE JURISDICTION PLANNING AND ZONING FOR ANTENNAS AND SUPPORT STRUCTURES WHERE SITE IS LOCATED

CONTRACTOR SHALL VERIFY ALL PLANS AND EXISTING DIMENSIONS / CONDITIONS ON SITE, IMMEDIATELY NOTIFY ENGINEER OF ANY DISCREPANCIES PRIOR TO PERFORMING ANY WORK OR BE RESPONSIBLE FOR THE SAME.

ALL TELECOM WORK TO BE COMPLETED BY CONTRACTOR EXPERIENCED WITH VERIZON. INSTALLATION AND CLOSEOUT PROCEDURES.

PROJECT DESCRIPTION VZW CONTRACTOR:

WITHIN AN EXISTING

INSTALL TELECOM EQUIPMENT ON

INSTALL TELECOM ANTENNA ON NEW POLEINSTALL NEW POWER SERVICE

INSTALL NEW VZW DARK FIBER SERVICE

ENGINEER

C/E

C/E

C/E

C/E

QR CODE

OF MIS

SHELTON

KEISLING

NUMBER

PE-27323



- THE CONTRACTOR SHALL BE RESPONSIBLE FOR SURVEY MONUMENT AND/OR VERTICAL CONTROL BENCHMARKS WHICH ARE DISTURBED OR DESTROYED BY CONSTRUCTION. A LAND SURVEYOR MUST FIELD LOCATE, REFERENCE, AND/OR PRESERVE ALL HISTORICAL OR CONTROLLING MONUMENTS BY A LAND SURVEYOR. A CORNER RECORD OR RECORD OF SURVEY, AS APPROPRIATE, SHALL BE FILED REQUIRED BY THE PROFESSIONAL LAND SURVEYORS ACT.
- B. IMPORTANT NOTICE: 811 IS OPEN 24 HOURS A DAY, 365 DAYS PER YEAR, FOR ALL TICKET LOCATE REQUESTS CALL 1-800 DIG RITE (1-800-344-7483)
- C. CONTRACTOR SHALL BE RESPONSIBLE FOR THE POT HOLE AND LOCATING OF ALL EXISTING UTILITIES THAT CROSS THE PROPOSED TRENCH LINE AND MUST MAINTAIN A 1' MINIMUM VERTICAL CLEARANCE.
- D. IF ANY EXISTING HARDSCAPE OR LANDSCAPE INDICATED ON THE APPROVED PLANS IS DAMAGED OR REMOVED DURING DEMOLITION OR CONSTRUCTION, IT SHALL BE REPAIRED AND/OR REPLACED IN KIND PER THE APPROVED PLANS.
- E. CONTRACTOR SHALL REPLACE OR REPAIR ALL CITY OF CHESTERFIELD INFRASTRUCTURE DAMAGED DURING CONSTRUCTION.
- F. THIS PROJECT WILL BE INSPECTED BY ENGINEERING AND FIELD ENGINEERING
- G. MANHOLES OR COVERS SHALL BE LABELED VERIZON, EXCEPT FOR MANHOLES OR COVERS PLACED ON BEHALF OF THE MUNICIPALITY FOR THEIR EQUIPMENT.
- H. CONTRACTOR SHALL IMPLEMENT AN EROSION CONTROL PROGRAM DURING THE PROJECT CONSTRUCTION ACTIVITIES. THE PROGRAM SHALL MEET THE APPLICABLE REQUIREMENTS OF THE STATE WATER RESOURCE CONTROL BOARD.
- I. THE CONTRACTOR SHALL HAVE EMERGENCY MATERIALS AND EQUIPMENT ON HAND FOR UNFORESEEN SITUATIONS, SUCH AS DAMAGE TO UNDERGROUND WATER, SEWER, AND STORM DRAIN FACILITIES WHEREBY FLOWS MAY GENERATE EROSION AND SEDIMENT POLLUTION

SPECIAL NOTES

- A. INDEMNIFICATION CLAUSE: THE CONTRACTOR AGREES AND SHALL: ASSUME SOLE AND COMPLETE RESPONSIBILITY OF THE JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THIS PROJECT, INCLUDING THE SAFETY OF ALL PERSONS AND PROPERTIES. THAT THESE REQUIREMENTS SHALL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS AND CONDITIONS. THE CONTRACTOR FURTHER AGREES TO DEFEND INDEMNITY AND HOLD SSC, REPRESENTATIVES, AND ENGINEERS HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED IN CONNECTION WITH THE PERFORMANCE OF THE
- B. ALL WORK SHALL CONFORM TO THE LATEST STANDARD "SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION" AS ADOPTED BY THE CITY, COUNTY OR STATE AS MODIFIED BY STANDARD PLANS AND ADDENDUMS
- C. THE EXISTENCE AND LOCATION OF UTILITIES AND OTHER AGENCY'S FACILITIES AS SHOWN HERON ARE OBTAINED BY A SEARCH OF AVAILABLE RECORDS. OTHER FACILITIES MAY EXIST. THE CONTRACTORS SHALL VERIFY PRIOR TO THE START OF CONSTRUCTION AND SHALL USE EXTREME CARE AND PROTECTIVE MEASURES TO PREVENT DAMAGE TO THESE FACILITIES. THE CONTRACTOR IS RESPONSIBLE. FOR THE PROTECTION ALL UTILITY OF AGENCY FACILITIES WITHIN THE LIMITS OF WORK, WHETHER THEY ARE SHOWN ON THIS PLAN OR NOT.
- D. THE CONTRACTOR SHALL NOTIFY THE CITY, COUNTY OR STATE ENGINEER INSPECTION DEPARTMENT, AT LEAST TWO TWO DAYS BEFORE START OF ANY WORK REQUIRING THEIR INVOLVEMENT.
- E. THE CITY, COUNTY OR STATE SHALL SPECIFY THE EXPIRATION PERIOD OF THE PERMIT FOR THIS CONSTRUCTION PROJECT.
- F. THE MINIMUM COVER FOR ALL CONDUITS PLACED UNDERGROUND SHALL BE 36 INCHES TO THE FINISHED GRADE AT ALL TIMES.
- G. THE CONTRACTOR SHALL TUNNEL ALL CURB AND GUTTER AND BORE ALL CONCRETE DRIVEWAYS AND WALKWAYS AT THE DIRECTION OF THE CITY, COUNTY
- H. ALL A.C AND/OR CONCRETE PAVEMENT SHALL BE REPLACED AT THE DIRECTION OF THE CITY, COUNTY STATE ENGINEERS
- I. ALL SHRUBS, PLANTS OR TREES THAT HAVE BEEN DAMAGED OR DISTURBED DURING THE COURSE OF THE WORK, SHALL BE REPLANTED AND/OR REPLACED SO AS TO RESTORE THE WORK SITE TO ITS ORIGINAL CONDITION.
- J. THE CONTRACTOR WILL BE RESPONSIBLY FOR THE PROCESSING OF ALL APPLICANT PERMIT FORMS ALONG WITH THE REQUIRED LIABILITY INSURANCE FORMS. CLEARLY DEMONSTRATING THE SSC, THE CITY, COUNTY OR STATE IS ALSO INSURED WITH THE REQUIRED LIABILITY INSURANCE FOR THIS
- K. VAULTS, PEDESTALS, CONDUITS AND OTHER TYPES OF SUBSTRUCTURE ARE ETHER SPECIFIED ON THIS PLAN OR WILL BE SPECIFIED BY THE CONSTRUCTION ENGINEER. ANY AND ALL DEVIATIONS FROM THE SPECIFIED TYPES OF MATERIAL MUST BE APPROVED BY THE SYSTEM ENGINEER, IN WRITING BEFORE INSTALLATION THEREOF. ANY EQUIPMENT OR MATERIALS PLACED ON BEHALF OF THE GOVERNING MUNICIPALITY (STREET LIGHT MATERIALS FOR EXAMPLE) WILL BE SAID MUNICIPALITY'S APPROVED MATERIALS LIST.

- L. THE CONTRACTOR SHALL VERIFY THE LOCATION OF ALL EXISTING UTILITIES INCLUDING SEWER LATERALS & WATER SERVICES TO INDIVIDUAL LOTS BOTH VERTICALLY AND HORIZONTALLY PRIOR TO COMMENCING IMPROVEMENT
- M. CONTRACTOR SHALL MAKE EXPLORATION EXCAVATIONS AND LOCATE EXISTING FACILITIES SUFFICIENTLY AHEAD OF CONSTRUCTION TO PERMIT REVISIONS TO PLANS IF REVISION IS NECESSARY BECAUSE OF LOCATION OF EXISTING UTILITIES.
- N. THE LOCATIONS OF ALL EXISTING UTILITIES SHOWN ON THESE PLANS ARE FROM EXISTING RECORDS AND CORROBORATED, WHERE POSSIBLE, WITH FIELD TIES. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING THE LOCATIONS SHOWN, BOTH HORIZONTALLY AND VERTICALLY, PROR TO CONSTRUCTION, IF EXISTING LOCATION VARY SUBSTANTIALLY FROM THE PLANS. THE ENGINEER SHOULD BE NOTIFIED TO MAKE ANY CONSTRUCTION CHANGES REQUIRED.
- O. ALL MATERIALS USED IN CONSTRUCTION THAT WILL BE OWNED AND MAINTAINED BY THE CITY OF CHESTERFIELD SHALL BE FROM THE APPROVED MATERIALS LIST.

EROSION AND SEDIMENT CONTROL NOTES

TEMPORARY EROSION/SEDIMENT CONTROL PRIOR TO COMPLETION OF FINAL IMPROVEMENTS, SHALL BE PERFORMED BY THE CONTRACTOR OR QUALIFIED PERSON AS INDICATED BELOW:

- A. ALL REQUIREMENTS OF THE CITY, COUNTY AND STATE "STORM WATER STANDARDS" MUST BE INCORPORATED INTO THE DESIGN AND CONSTRUCTION OF THE PROPOSED GRADING/IMPROVEMENTS CONSISTENT WITH THE APPROVED STORM WATER POLLUTION PREVENTION PLAN (SWPPP), WATER QUALITY TECHNICAL REPORT (WOTR), AND/OR WATER POLLUTION CONTROL PLAN (WPCP).
- FOR STORM DRAIN INLETS, PROVIDE AS GRAVEL BAG SILT BASIN IMMEDIATELY UPSTREAM INLET AS INDICATED ON DETAILS.
- C. FOR INLETS LOCATED AT SUMPS ADJACENT TO TOP OF SLOPES. THE CONTRACTOR SHALL ENSURE WATER DRAINING TO THE SUMP IS DIRECTED INTO THE INLET AND THAT A MINIMUM OF 1.00' FREEBOARD EXISTS AND IS MAINTAINED ABOVE THE TOP OF THE INLET. IF FREEBOARD IS NOT PROVIDED BY GRADING SHOWN ON THESE PLANS THE CONTRACTOR SHALL PROVIDE IT VIA TEMPORARY MEASURES, I.E. GRAVEL BAGS OF DIKES
- D. THE CONTRACTOR OR QUALIFIED PERSON SHALL BE RESPONSIBLE FOR CLEANUP OF SILT AND MUD ON ADJACENT STREET(S) AND STORM DRAIN SYSTEM DUE TO CONSTRUCTION ACTIVITY.
- E. THE CONTRACTOR OR QUALIFIED PERSON SHALL CHECK AND MAINTAIN ALL LINED AND UNLINED DITCHES AFTER EACH RAINFALL.
- F. THE CONTRACTOR SHALL REMOVE SILT AND DEBRIS AFTER EACH MAJOR
- G. EQUIPMENT AND WORKERS FOR EMERGENCY WORK SHALL BE MADE AVAILABLE AT ALL TIMES DURING THE RAINY SEASON, ALL NECESSARY MATERIALS SHALL BE STOCKPILED ON SITE CONVENIENT LOCATIONS TO FACILITATE RAPID NSTRUCTION OF TEMPORARY DEVICES WHEN RAIN IS IMMINENT.
- H. THE CONTRACTOR SHALL RESTORE ALL EROSION/SEDIMENT CONTROL DEVICES TO WORKING ORDER TO THE SATISFACTION OF THE CITY ENGINEER OF RESIDENT ENGINEER AFTER EACH RUN-OFF PRODUCING RAINFALL.
- I. THE CONTRACTOR SHALL INSTALL ADDITIONAL EROSION/SEDIMENT CONTROL MEASURES AS MAY BE REQUIRED BY THE RESIDENT ENGINEER DUE TO UNCOMPLETED GRADING OPERATIONS OR UNFORESEEN CIRCUMSTANCES, WHICH
- J. THE CONTRACTOR SHALL BE RESPONSIBLE AND SHALL TAKE THE NECESSARY PRECAUTIONS TO PREVENT PUBLIC TRESPASS ONTO AREAS WHERE IMPOUNDED WATERS CREATE A HAZARDOUS CONDITION.
- K. ALL EROSION/SEDIMENT CONTROL MEASURES PROVIDED PER THE APPROVED GRADING PLAN SHALL INCORPORATED HEREON, ALL EROSION/SEDIMENT CONTROL FOR INTERIM CONDITION SHALL BE DONE TO THE SATISFACTION OF THE
- L. GRADED AREAS AROUND THE PROJECT PERIMETER MUST DRAIN AWAY FROM THE FACE OF THE SLOPE AT THE CONCLUSION OF EACH WORKING DAY
- M. ALL REMOVABLE PROTECTIVE DEVICES SHOWN SHALL BE IN PLACE AT THE END OF EACH WORKING DAY WHEN RAIN IMMINENT
- N. THE CONTRACTOR SHALL ONLY GRADE, INCLUDING CLEARING AND GRUBBING FOR THE AREAS FOR WHICH THE CONTRACTOR OR QUALIFIED PERSON CAN PROVIDE EROSION/SEDIMENT CONTROL MEASURES.
- O. THE CONTRACTOR SHALL ARRANGE FOR WEEKLY MEETINGS DURING OCTOBER 1ST TO APRIL 30TH FOR PROJECT TEAM (GENERAL CONTRACTOR, QUALIFIED PERSON, EROSION CONTROL SUBCONTRACTOR IF ANY, ENGINEER OF WORK, OWNER/DEVELOPER AND THE RESIDENT ENGINEER) TO EVALUATE THE ADEQUACY OF THE EROSION/SEDIMENT CONTROL MEASURE AND OTHER RELATED CONSTRUCTION ACTIVITIES.



ROW GROUND CONSTRUCTION NOTES:

- A. 120/240 OR 120/208 POWER REQUIRED FOR 1-PHASE, 3-WIRE SERVICE.
- B. GC TO REMOVE/CLEAN ALL DEBRIS, NAILS, STAPLES OR NON-USED VERTICALS OFF THE POLE
 C. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH MUNICIPAL, COUNTY,
- STATE, AND FEDERAL STANDARDS AND REGULATIONS.

 D. CALL DIG SAFE USA 72 HOURS PRIOR TO EXCAVATING AT (800) 344-7233.

 E. ALL LANDSCAPING TO BE RESTORED TO ORIGINAL CONDITION OR BETTER
- ALL EQUIPMENT TO BE BONDED
- G. METERING CABINET REQUIRES 3' CLEARANCE AT DOOR OPENING. H. CAULK CABINET BASE AT PAD

STANDARD GROUNDING NOTES:

- A. GROUND TESTED AT 5 OHMS OR LESS
- B. 5/8" X 8'-0" ROD, CADWELD BELOW GRADE C. #6 WIRE, FOR GROUNDING AND BONDING
- WOOD MOLDING, STAPLED EVERY 3' AND AT EACH END E. GROUNDS 3' FROM POLE.

STANDARD CONDUIT NOTES:

- A. FOR UNDERGROUND USE SCHEDULE 40 CONDUIT.

 B. FOR RISERS USE SCHEDULE 80 CONDUIT.

 C. PLACE 2" GALVANIZED STEEL CONDUIT FOR ANY CONDUIT UNDER 3".

 D. CONVERT 4" CARRIER CONDUIT TO 3" AT BASE OF POLE.
- E. GC TO STUB UP POLE 10' W/3" POWER CONDUIT, POWER CO. TO CONVERT FROM 3" SCH. 80 TO 2" SCH. 80 FROM TOP OF STUB UP.
- F. ALL CONDUIT SHALL BE MANDREL TESTED AND EQUIPPED WITH 3/8" PULL


STANDARD CONDUIT NOTES:

- A. SAND BEDDING MINIMUM 1" UNDER CONDUITS, AND 6" SANDSHADING ON TOP
- B. ALL TRENCHED ELECTRICAL SERVICE CONDUITS FROM POWER COMPANY, WHETHER FROM POLES, TRANSFORMERS, OR OTHER LOCATIONS; WILL BE SLURRY BACKFILLED
- C. IN STREET SLURRY TO GRADE AND MILL DOWN 1-1/2" FOR AC CAP. F. IN DIRT SLURRY 18" FROM GRADE, AND FILL WITH 95% COMPACTION NATIVE
- SOIL FOR BALANCE.

 G. PLACE WARNING TAPE IN TRENCH 12" ABOVE ALL CONDUITS AND #18
 WARNING TAPE ABOVE GROUND RING

ROW GROUND CONSTRUCTION NOTES:

- A. NO BOLT THREADS TO PROTRUDE MORE THAN 1-1/2".
- B. FILL ALL HOLES LEFT IN POLE OF REARRANGEMENT OF CLIMBERS.
 C. ALL CLIMB STEPS NEXT TO CONDUITS SHALL HAVE EXTENDED STEPS.
 D. CABLE NOT TO IMPEDE 15" CLEAR SPACE OFF POLE FACE (12:00)
- E. 90' SHORT SWEEPS UNDER ANTENNA ARM. ALL CABLES MUST ONLY TRANSITION ON THE INSIDE OR BOTTOM OF ARMS (NO CABLE ON TOP OF
- F. USE CABLE CLAMPS TO SECURE CABLE TO ARMS; PLACE 2" CARRIER CABLE
- ID TAGS ON BOTH SIDES OF ARMS.
 G. USE 90' CONNECTOR AT CABLE CONNECTION TO ANTENNAS.
- H. USE 1/2" CABLE ON ANTENNAS UNLESS OTHERWISE SPECIFIED.
 I. FILL VOID AROUND CABLES AT CONDUIT OPENING WITH FOAM SEALANT TO
- PREVENT WATER INTRUSION



STATE OF MISSOUR

STATE CERTIFICATE OF AUTHORIZATION # EF-2791 DISCIPLINE ENGINEER. KMV KEVIN M VANMAELE PE-021561 CIVIL REJ ROBERT E JENSEN PE-028974 CIVIL CG CHRISTOPHER GIANNOTTI PE-2020038653 CIVIL SDK SHELTON D. KEISLING PE-27323 ELECTRICAL TMS TERRANCE M. SUPER PE-18521 ELECTRICAL





SSC

DRAWING NOTICE:
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE
PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FO THEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION O THE LOAN OF THIS DRAWING, THE BORROWER PROMISES A AGREES TO RETURN IT UPON REQUEST AND AGREES THAT WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE SPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS:			_
DESCRIPTION	DATE	BY	RE
ISSUED FOR REVIEW	02/22/22	CZW	Α
REISSUED FOR REVIEW	06/14/22	C10	В
REISSUED FOR REVIEW	06/24/22	CTO	С
ISSUED FOR CONSTRUCTION	07/19/22	czw	0
UPDATED ELEVATION	09/28/22	ABT	1

STLC CHF FS 05SC

TBD 706081

SITE ADDRESS:
13426 OLIVE BLVD CHESTERFIELD, MISSOURI

SHEET DESCRIPTION:

GENERAL NOTES (1 OF 3)

SHEET #:-GN-1.0

- CONTRACTOR SHALL REVIEW THE CONTRACT DOCUMENTS PRIOR TO ORDERING THE ELECTRICAL EQUIPMENT AND STARTING THE ACTUAL CONSTRUCTION. CONTRACTOR SHALL ISSUE A WRITTEN NOTICE OF ALL FINDINGS TO THE ARCHITECT/ENGINEER LISTING ANY DISCREPANCIES OR CONFLICTING INFORMATION.
- 2. ELECTRICAL PLANS, DETAILS AND DIAGRAMS ARE DIAGRAMMATIC ONLY. VERIFY EXACT LOCATIONS AND MOUNTING HEIGHTS OR ELECTRICAL EQUIPMENT WITH OWNER PRIOR TO
- EACH CONDUCTOR OF EVERY SYSTEM SHALL BE PERMANENTLY TAGGED IN EACH PANELBOARD, PULLBOX, JUNCTION BOX, SWITCH BOX, ETC. THE TYPE OF TAGGING METHODS SHALL BE IN COMPLIANCE WITH OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION (O.S.H.A.)
- 4. ALL MATERIALS AND EQUIPMENT SHALL BE NEW AND IN GOOD WORKING CONDITION WHEN INSTALLED AND SHALL BE OF THE BEST GRADE AND OF THE SAME MANUFACTURER THROUGHOUT FOR EACH CLASS OR GROUP OF EQUIPMENT. MATERIALS SHALL BE LISTED "U.L." WHERE APPLICABLE. MATERIALS SHALL MEET WITH APPROVAL OF ALL GOVERNING BODIES HAVING JURISDICTION. MATERIALS SHALL BE MANUFACTURED IN ACCORDANCE WITH APPLICABLE STANDARDS ESTABLISHED BY ANSI, NEMA, NBFU AND
- 5. ALL CONDUIT SHALL HAVE A PULL CORD.
- 6. PROVIDE PROJECT MANAGER WITH ONE SET OF COMPLETE ELECTRICAL "AS INSTALLED" DRAWINGS AT THE COMPLETION OF THE JOB, SHOWING ACTUAL DIMENSIONS, ROUTINGS,
- 7. ALL CIRCUIT BREAKERS, FUSES AND ELECTRICAL EQUIPMENT SHALL HAVE AN INTERRUPTING SHORT CIRCUIT CURRENT TO WHICH THEY MAY BE SUBJECTED, AND A MINIMUM OF 10,000 A.I.C.
- 8. THE ENTIRE ELECTRICAL INSTALLATION SHALL BE GROUNDED AS REQUIRED BY IBC, NEC
- 9. PATCH, REPAIR AND PAINT ANY AREA THAT HAS BEEN DAMAGED IN THE COURSE OF
- PLASTIC PLATES FOR ALL SWITCHES, RECEPTACLES, TELEPHONE AND BLANKED OUTLETS SHALL HAVE ENGRAVED LETTERING WHERE INDICATED ON THE DRAWINGS. WEATHERPROOF RECEPTACLES SHALL HAVE SIERRA #WPD-8 LIFT COVER PLATES.

SERVICE AND DISTRIBUTION


- STREETLIGHTING DISTRIBUTION CABLE MUST BE #2, #4, #6, OR #8 AWG CU RHW/USE, 600V, COPPER STRANDED AND COLOR CODED BLACK, RED (OR BLACK) AND GREEN (APWA 2802.8) FOR A GROUNDED 240V SYSTEM (SINGLE PHASE).
- STREETLIGHTING DISTRIBUTION CABLE SHALL BE INSTALLED IN SCHEDULE 40, 2° PVC CONDUIT OR IN PREASSEMBLED "CABLE-IN-DUCT." ALL CONDUIT RUNS SHALL BE PLACED 24" FROM BACK OF CURB WHERE POSSIBLE AND AT A MINIMUM DEPTH OF 24"
- STREETLIGHT CABLE USED WITHIN THE POLES SHALL BE 3 →

 #10, TYPE RHW/USE, 600
 VOLTS RATED, COPPER, U.L. LISTED AND COLOR—CODED RED, BLACK AND GREEN
 ACCORDING TO THE NEC.
- PROVIDE AND INSTALL IN EACH POLE BASE, 3 SINGLE-POLE, SET-SCREW, IN-LINE, BREAKAWAY, FUSEHOLDERS. USE BUSSMAN (OR APPROVED EQUAL) MODEL NO. HEB-JW-RYC AND HEB-JW-RYC (LAST POLE). FOR THE 2 "HOT" BREAKAWAY CONDUCTORS, PLACE A 10 AMP KTK FUSE IN EACH BREAKAWAY FUSEHOLDER AND A NNB COPPER SLUG IN THE SYSTEM GROUND FUSEHOLDER.
- 5. WIRE AND CABLE CONDUCTORS SHALL BE COPPER, 600V, TYPE THHN OR THWN, WITH A MIN. SIZE OF #12 AWG, COLOR CODED, UNLESS OTHERWISE NOTED.
- 6. METER SOCKET AMPERES, VOLTAGE, NUMBER OF PHASES SHALL BE NOTED ON THE DRAWINGS. MANUFACTURED BY MILBANK OR APPROVED EQUAL, AND SHALL BE UTILITY
- A. RIGID CONDUIT SHALL BE U.L. LABEL GALVANIZED ZINC COATED WITH GALVANIZED ZINC INTERIOR AND SHALL BE USED WHEN INSTALLED IN OR UNDER CONCRETE SLABS, IN CONTACT WITH THE EARTH, UNDER PUBLIC ROADWAYS, IN MASONRY WALLS OR EXPOSED ON BUILDING EXTERIOR. RIGID CONDUIT IN CONTACT WITH EARTH SHALL BE 1/2 LAPPED WRAPPED WITH HUNTS WRAP PROCESS NO. 3.
- B. FLEXIBLE METALLIC CONDUIT SHALL HAVE U.L. USTED LABEL AND MAY BE USED WHERE PERMITTED BY CODE. FITTINGS SHALL BE "JAKE" OR "SQUEEZE" TYPE. ALL FLEXIBLE CONDUITS SHALL HAVE FULL LENGTH GROUND WIRE.
- C. IT IS REQUIRED AND WILL BE THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR TO NOTIFY 811 OR OTHER SUCH UTILITY LOCATING AGENCY 3 DAYS BEFORE

- 8. CONTRACTOR TO COORDINATE WITH UTILITY COMPANY FOR CONNECTION OF TEMPORARY AND PERMANENT POWER TO THE SITE. THE TEMPORARY POWER AND ALL HOOKUP COSTS ARE TO BE PAID BY THE CONTRACTOR.
- ALL ELECTRICAL EQUIPMENT SHALL BE LABELED WITH PERMANENT ENGRAYED PLASTIC LABELS WITH WHITE ON BLUE BACKGROUND LETTERING (MINIMUM LETTER HEIGHT SHALL BE ONE FOURTH INCH (1/4"). NAMEPLATES SHALL BE FASTENED WITH STAINLESS STEEL SCREWS. NOT ADHESIVE.
- 10. UPON COMPLETION OF WORK, CONTINUITY, SHORT CIRCUIT, AND FALL POTENTIAL
 GROUNDING TESTS BY AN INDEPENDENT TESTING SERVICE ENGAGED BY THE CONTRACTOR
 SHALL BE SUBMITTED FOR APPROVAL SUBMIT TEST REPORTS TO PROJECT MANAGER.
 CLEAN PREMISES OF ALL DEBRIS RESULTING FROM WORK AND LEAVE WORK IN A COMPLETE AND UNDAMAGED CONDITION.
- 11. GROUNDING ELECTRODE SYSTEM
- A. PREPARATION
 SURFACE PREPARATION: ALL CONNECTIONS SHALL BE MADE TO BARE METAL, ALL PAINTED
 SURFACES SHALL BE FIELD INSPECTED AND MODIFIED TO ENSURE PROPER CONTACT. NO
 WASHERS ARE ALLOWED BETWEEN THE ITEMS BEING GROUNDED, ALL CONNECTIONS ARE TO HAVE A NON-OXIDIZING AGENT APPLIED PRIOR TO INSTALLATION.
- 12. IF CONDUCTORS MUST RUN THROUGH CONDUIT, BOTH ENDS OF CONDUIT SHALL BE GROUNDED. SEAL BOTH ENDS OF CONDUIT WITH SILICONE CAULK.
 - A. EXTERNAL CONNECTIONS
- 13. ALL BURIED GROUNDING CONNECTIONS SHALL BE MADE BY THE EXOTHERMIC WELD PROCESS. CONNECTIONS SHALL INCLUDE ALL CABLE TO CABLE, SPLICES, TEE'S, CROSSES, ETC. ALL CABLE TO GROUND RODS, GROUND ROD SPLICES AND LIGHTNING PROTECTION SYSTEMS ARE TO BE AS INDICATED. ALL MATERIALS USED (MOLDS, WELDING METAL, TOOLS, ETC.) SHALL BE BY "ULTRAWELD" AND INSTALLED PER MANUFACTURER'S
- 14. ALL ABOVE GRADE GROUNDING AND BONDING CONDUCTORS SHALL BE CONNECTED BY TWO HOLE CRIMP TYPE (COMPRESSION) CONNECTIONS (EXCEPT FOR THE ACEG AND GROUND ROD). MECHANICAL CONNECTIONS, FITTINGS OR CONNECTIONS THAT DEPEND SOLELY ON SOLDER SHALL NOT BE USED. ALL CABLE TO CABLE CONNECTIONS SHALL BE HIGH PRESSURE DOUBLE CRIMP TYPE CONNECTIONS. CONNECTIONS TO STRUCTURAL
- A. GROUND RODS: ALL GROUND RODS SHALL BE 5/8-INCH DIAMETER X 10'-0" LONG "COPPERWELD" OR APPROVED EQUAL, OF THE NUMBER AND LOCATIONS INDICATED. GROUND RODS SHALL BE DRIVEN FULL LENGTH VERTICAL IN UNDISTURBED EARTH.
- B. GROUND CONDUCTORS: ALL GROUND CONDUCTORS SHALL BE STANDARD TINNED SOLID BARE COPPER ANNEALED, AND OF SIZE INDICATED ON DRAWINGS UNLESS OTHERWISE 2. MATERIALS:
- 15. LUGS SHALL BE 2-HOLE, LONG BARREL, STRAND COPPER UNLESS OTHERWISE SPECIFIED IN THE CONTRACT DOCUMENTS. LUGS SHALL BE THOMAS AND BETTS SERIES \$54___BE OR EQUIVALENT
- A. 535 MCM DLO 54880BE B. 262 MCM DLO 54872BE
- #1/0 DLO 54862BE
- #4/0 THWN AND BARE 54866BE \$2/0 THWN 54862BE
- #2 THHN 54207BE
- 16. WHEN THE DIRECTION OF THE CONDUCTOR MUST CHANGE, IT SHALL BE DONE GRADUALLY. THE CURVATURE OF THE TURN SHALL BE DONE IN ACCORDANCE WITH THE FOLLOWING

MINIMUM BENDING GROUNDING CONDUCTOR SIZE RADIUS TO INSIDE EDGE NO. 6 AWG TO NO. 4 AWG 6 INCHES

- NO. 2 AWG TO NO 1/0 AWG 8 INCHES
- NO. 2/O AWG TO 4/O AWG12 INCHES
- NO. 250 MCM TO 750 MCM24 INCHES
- 17. GROUNDING RESISTANCE TEST REPORT: UPON COMPLETION OF THE TESTING FOR EACH SITE, A TEST REPORT SHOWING RESISTANCE IN OHMS MUST BE SUBMITTED. TWO (2) SETS OF TEST DOCUMENTS FROM THE INDEPENDENT TESTING SERVICE ARE TO BE BOUND AND SUBMITTED WITHIN ONE (1) WEEK OF WORK COMPLETION.



POLES. POSTS. AND STANDARDS (SINGLE MAST AND SELF SUPPORTING TOWERS)

- A. LIGHTNING ROD AND EXTENSION PIPE INCLUDING ALL APPURTENANCES, TO BE FURNISHED BY VERIZON, IF REQUIRED.
- B. GROUNDING: GROUND METAL POLES WITH A MINIMUM OF #2 AWG TINNED SOLID BARE COPPER CONDUCTOR USING EXOTHERMIC CONNECTION TO TOWER BASE PLATE.

TELECOMMUNICATIONS WIRING COMPONENTS (COAXIAL ANTENNA CABLE)

- A. ALL MATERIALS, PRODUCTS OR PROCEDURES INCORPORATED INTO WORK SHALL BE NEW AND OF STANDARD COMMERCIAL QUALITY.
- B. ALL MATERIALS AND PRODUCTS SPECIFIED IN THE CONTRACT DOCUMENTS SHALL BE SUPPLIED BY THE CONTRACTOR UNLESS NOTED OTHERWISE.

- INSTALL COAXIAL CABLE AND TERMINATIONS BETWEEN ANTENNAS AND EQUIPMENT PER MANUFACTURER'S RECOMMENDATIONS WITH COAXIAL CABLES SUPPORTED AT NO MORE THAN 3'-0" O.C. WEATHERPROOF ALL CONNECTORS BETWEEN THE ANTENNA AND EQUIPMENT PER MANUFACTURER'S REQUIREMENTS. TERMINATE ALL COAXIAL CABLE THREE FEET (3") IN EXCESS OF EQUIPMENT LOCATION UNLESS OTHERWISE STATED.
- 2. LENGTHS LESS THAN OR EQUAL TO 100 FEET SHALL BE 7/8".
- 3. ANTENNA AND COAXIAL CABLE GROUNDING
- A. ALL COAXIAL CABLE GROUNDING KITS ARE TO BE INSTALLED ON STRAIGHT RUNS OF COAXIAL CABLE (NOT WITHIN BENDS)
- A. TO PROVIDE EASY IDENTIFICATION AND UNIFORM MARKING OF ANTENNA CABLING, PLASTIC TAGS SHALL BE USED AT THE FOLLOWING LOCATIONS:
- 1. FIRST LOCATION IS AT THE END OF THE COAX NEAREST THE ANTENNA (WHERE THE COAXIAL CABLE AND JUMPER ARE CONNECTED).
- 2. SECOND LOCATION IS AT END OF THE COAX NEAREST THE EQUIPMENT.
- B. USE ANDREW CABLE TIES (PT.# 27290) TO SECURE IDENTIFICATION TAGS.
- TESTING: LESSEE SHALL PROVIDE AN INDEPENDENT TESTING AGENCY TO PERFORM THE COAXIAL SWEEP TEST & REPORT. THE CONTRACTOR IS TO PROVIDE ONE CLIMBER/QUALIFIED PERSONNEL TO ASSIST IN ANY REPAIRS AND WEATHERPROOFING ONCE THE TEST IS COMPLETE. THE CONTRACTOR IS TO PROVIDE LESSEE WITH A MINIMUM OF 48 HOURS NOTICE PRIOR TO THE TIME OF THE SWEEP TEST.



STATE OF MISSOURI

ENGINEER. PE#: DISCIPLINE

ELECTRICAL 1

SDK_SHELTON D. KEISLING PE-27323 TMS_TERRANCE M. SUPER PE-18521

DI ANG DEDADEN END





OWNING NOT THE THE SPEND HE SHE SHE SOLE ROPERTY OF SEC, INC. AND IS LENT TO THE BORROWER FOR HEIR CONFIDENTIAL USE ONLY, AND IN CONSIDERATION OF HE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND THE LOAN OF THIS DRAWINS, THE SORROWER PROMISES AN AGREES TO RETURN IT UPON REQUEST AND AGREES THAT I WILL NOT BE REPRODUCED, COPIED, LENT OR OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR AN' PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS: DESCRIPTION	DATE	BY	RE
ISSUED FOR REVIEW	02/22/22	czw	А
REISSUED FOR REVIEW	06/14/22	CJO	В
REISSUED FOR REVIEW	06/24/22	CJO	С
ISSUED FOR CONSTRUCTION	07/19/22	czw	0
UPDATED ELEVATION	09/28/22	ABT	1
OF BATES ELEVATION	COILCOLL	7.00	

STLC CHF FS 05SC

TBD

13426 OLIVE BLVD CHESTERFIELD, MISSOURI

SHEET DESCRIPTION:

GENERAL NOTES (2 OF 3)


GN-1.1

706081

PART 4 - GENERAL NOTES PER 18 2016001 SECTION 4.05

- "ALL WORK SHALL COMPLY WITH THE KIRKWOOD, MO., DEPARTMENT OF PUBLIC WORKS, STANDARD CONSTRUCTION AND MATERIALS SPECIFICATION, DIVISION II, SECTION 2800, DIVISION V, SECTION 5800 AND SUPPLEMENTAL CHANGES."
- "THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL RESTORATION OF THE CONSTRUCTION SITE TO CITY SPECIFICATIONS. THE CONTRACTOR SHALL ALSO BE RESPONSIBLE FOR ALL COST ASSOCIATED WITH ANY DAMAGE, INCLUDING BUT NOT LIMITED TO LANDSCAPING, SPRINKLER SYSTEMS, WATER, SEWER, CURBS AND SIDEWALK, GAS MAIN, ETC... CAUSED BY THE CONSTRUCTION. RESTORATION OF THE CITY'S RIGHT-OF-WAY IS REQUIRED TO COMPLY WITH APPLICABLE APWA STANDARDS."
- "ALL WORKMANSHIP AND MATERIALS SHALL BE SUBJECT TO INSPECTION AND APPROVAL BY THE STREET LIGHTING DIMSION, PUBLIC WORKS DEPARTMENT. COORDINATE INSPECTIONS WITH SARA HURST AT (816) 513-9882 OR BRYAN CARTER AT (816) 513-9857.
- "THE CONTRACTOR IS RESPONSIBLE FOR MAKING HIS OWN DETERMINATION AS TO TYPE AND LOCATION OF UNDERGROUND AND OVERHEAD UTILITIES AS MAY BE NECESSARY TO AVOID DAMAGE. THE CONTRACTOR SHALL VERIEY LOCATION OF UNDERGROUND PIPELINES, CONDUITS, STRUCTURES AND OVERHEAD LINES BY CONTACTING THE OWNERS
- "ALL STREET LIGHTING DISTRIBUTION CABLE SHALL BE INSTALLED IN 2", SCHEDULE 40, PVC CONDUIT OR APPROVED EQUAL. ALL CONDUIT RUNS SHALL BE PLACED 24" FROM BACK OF CURB WHERE POSSIBLE AND AT A MINIMUM DEPTH OF 24".
- "UNDERGROUND DISTRIBUTION CABLE MUST BE #2, #4, #6 OR #8, TYPE THWN, 600 VOLT, COPPER AND COLOR CODED ACCORDING TO THE NEC. ALL DISTRIBUTION CABLE MUST BE CONTINUOUS (UNSPILICED) FROM THE PRECEDING LIGHT POLE, JUNCTION BOX OR CONTROLLER TO THE BREAKAWAY FUSE HOLDER IN THE BASE OF THE POLE. OVERHEAD CABLE SHALL BE #4 OR #6 PER EXISTING CONDITION. OVERHEAD CONDUCTORS SHALL BE ALUMINUM. COLOR CODED ACCORDING TO THE NEC, INSULATED WITH CROSS-LINK POLYETHYLENE AND SIZED PER PLANS. SUPPORTING HARDWARE SHALL BE 5/8 INCH OR 16,000 POUND, STANDARD POLE LINE HARDWARE. WEDGE CLAMPS SHALL HAVE ALUMINUM WEDGES AND STAINLESS STEEL BAILS AND SHELLS. CONNECTORS SHALL BE STANDARD BOLTED TYPE CONDUCTORS WITH OXIDE INHIBITORS TO PREVENT CORROSION (APWA 2802.8). NO MID-SPAN SPLICES ARE ALLOWED."
- "CABLE USED WITHIN THE POLES SHALL BE \$10, TYPE THWN, 600 VOLTS RATED, COPPER, U.L. LISTED AND COLOR-CODED ACCORDING TO THE NEC."
- "PROVIDE AND INSTALL IN EACH POLE BASE A SINGLE-POLE, SET-SCREW, IN-LINE, BREAKAWAY, FUSE HOLDER FOR EACH CONDUCTOR. USE BUSSMAN (OR APPROVED EQUAL) MODEL NO. HEB-JW-RYC AND HEB-JW-RLC-J (LAST POLE). FOR THE UNGROUNDED ("HOT") CONDUCTORS, PLACE A 10 AMP KTK FUSE IN EACH BREAKAWAY FUSE HOLDER AND A NNB COPPER SLUG IN THE SYSTEM GROUND FUSE HOLDER."
- "HIMINAIRE LARELS: THE LABELS SHALL BE KCMO-2X16-ADDS OR APPROVED EQUAL CONTACT WILLIAM FRICK & COMPANY AT (847) 918-3700. THE CONTRACTOR SHALL FURNISH AND INSTALL LUMINAIRE IDENTIFICATION LABELS ACCORDING TO THE FURNISH AND INSTALL LUMINARE IDENTIFICATION LABELS ACCORDING TO THE CONSTRUCTION PLANS. IDENTIFICATION LABELS SHALL CONSIST OF THREE LETTERS AND FOUR NUMERALS IN VERTICAL ORIENTATION WITH THE LETTERS AT THE TOP SO AS TO READ DOWNWARD. LABELS SHALL BE 2 INCH SERIES "C" UPPER CASE BLACK CHARACTERS ON SILVER RETRO—REFLECTIVE SHEETING WITH PRESSURE SENSITIVE ADHESIVE BACKING, AS PRESCRIBED FOR USE ON STANDARD HIGHWAY SIGNS IN THE FHWA MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES. LABELS FOR DECORATIVE FHWA MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES. LABELS FOR DECORATIVE POLES MUST BE COORDINATED WITH THE STREET LIGHTING DIVISION AT (816) 513-9874. STEEL POLES SHALL BE LABELED BY AFFORMS A SELF-ADHESIVE DECAL DIRECTLY ON THE POLE. LABELS INTENDED FOR MOUNTING ON WOOD POLES SHALL BE APPLIED TO A METAL PLACARD AND ATTACHED DIRECTLY TO THE POLE. THE LABEL SHALL BEAR THE NUMBER SHOWN ON THE PLAN OR AS DIRECTED BY THE CITY REPRESENTATIVE AND BE POSITIONED ON THE VERTICAL AXIS OF THE POLE FACING THE STREET, 8-10 FEET ABOVE THE PAVEMENT SURFACE. CONTROLLER CABINET LABELS: CONTROLLER CABINETS SHALL BE PERMANENTLY LABELED WITH THE NUMERIC ADDRESS OF THE COUMPMENT. LABELS SHALL BE 4 INCH SERIES "C" UPPER CASE BLACK CHARACTERS ON SILVER RETRO-REFLECTIVE SHEETING WITH PRESSURE SENSITIVE ADDRESSED SENSITIVE AND EACH THE ADDRESSED STREET." AND FACE THE ADDRESSED STREET."
- IF THE POLE IS OWNED BY THE ATTACHEE: "THE CONTRACTOR SHALL FURNISH AND IF THE POLE IS OWNED BY THE ATTACHEE: "THE CONTRACTOR SHALL FURNISH AND INSTALL AN OWNERSHIP IDENTIFICATION LABEL ACCORDING TO THE CONSTRUCTION PLANS. IDENTIFICATION LABELS SHALL CONSIST OF A UNIQUE NUMBER FOLLOWED BY THE FIRST THREE LETTERS OF THE POLE OWNERS NAME IN VERTICAL ORIENTATION WITH THE LETTERS OF THE BOTTOM SO AS TO READ DOWNWARD, LABELS SHALL BE SETS "C" UPPER CASE BLACK CHARACTERS ON SILVER RETRO-REFLECTIVE SHEETING WITH PRESSURE SENSITIVE ADHESIVE BACKING, AS PRESCRIBED FOR USE ON STANDARD HIGHWAY SIGNS IN THE FHWA MANUAL OF UNFORM TRAFFIC CONTROL DEVICES OR APPROVED EQUAL LABELS FOR DECORATIVE POLES MUST BE COORDINATED WITH THE STREET LICHTING DIVISION AT (816) 513-9874. THE LABEL SHALL BE POSITIONED ON THE VERTICAL AXIS OF THE POLE FACING THE STREET AND 6-8 FEET ABOVE THE PAVEMENT SURFACE."
- "THE CONTRACTOR SHALL STAKE ALL POLE RELOCATIONS. PRIOR TO ANY CONSTRUCTION, THE STREET LIGHTING INSPECTOR SHALL VERIFY ALL POLE RELOCATIONS STAKED BY THE CONTRACTOR. POLE SETBACK SHALL BE 2' TO 3' FROM BACK OF CURB. ALL POLES MUST BE INSTALLED PERPENDICULAR TO THE STREET. NO DIAGONAL INSTALLATIONS ARE ALLOWED, THE MOUNTING HEIGHT SHALL MATCH EXISTING INSTALLATIONS, MINIMUM ADA SIDEWALK CLEARANCES SHALL BE MAINTAINED."

- "ALL ATTACHMENTS ON THE EXISTING LIGHT POLE MUST BE INSTALLED ON THE NEW POLE WITH THE SAME PLACEMENT (HEIGHT, DIRECTION, ETC.). ALL COSTS FOR REMOVAL AND REINSTALLATION OF EXISTING ATTACHMENTS (SIGNS, BANNERS, OTHER TELECOMMUNICATION EQUIPMENT, ETC.) SHALL BE THE RESPONSIBILITY OF THE ATTACHEE. ALL ATTACHMENTS NOT INDICATED ON PLANS MUST BE COORDINATED WITH THE ENGINEER."
- m. "ALL POWER COORDINATION MUST BE PERFORMED BY DESIGNER, DEVELOPER AND
- "CONTRACTOR MUST BE A LICENSED ELECTRICIAN WITH THE CITY OF KIRKWOOD, MO AND BE AN EXPERIENCED AND QUALIFIED LINEMAN. THE CITY OF KIRKWOOD IS NOT RESPONSIBLE FOR ANY PART OF THE WORK TO BE DONE."
- ALL EQUIPMENT AND MATERIALS SPECIFIED IN THESE PLANS SHALL BE EVALUATED BASED ON A STANDARD FOR WHICH THE EQUIPMENT IS TO BE USED, LISTED AND LABELED BY UNDERWRITERS LABORATORIES OR OTHER THIRD PARTY LISTING AGENCY RECOGNIZED IN THE UNITED STATES. ALL EQUIPMENT SHALL BE INSTALLED AND USED PER THE LISTING MATERIAL FOR THE STALL BE INSTALLED.
- CONTRACTOR COORDINATION PROCEDURES WITH THE CITY OF KIRKWOOD.
 - THE PUBLIC WORKS DEPARTMENT, STREET LIGHTING DIMISION WILL ONLY ACCEPT ONE POINT OF CONTACT (PROJECT MANAGER) AT THE CONSTRUCTION STAGE. THE PROJECT MANAGER MUST BE EMPLOYED BY THE ATTACHEE THE CITY HAS SIGNED THE POLE ATTACHMENT AGREEMENT WITH. THIS PERSON MUST CONTACT PUBLIC WORKS DEPARTMENT, STREET LIGHTING DIVISION (SARA HURST, (816) 513-9882,
 SARA,HURSTOKCMO,ORG) 5 BUSINESS DAYS PRIOR TO THE START OF WORK TO NOTIFY
 THE CITY OF YOUR INTENTION TO BEGIN WORK AND SUBMIT A CONSTRUCTION
 SCHEDULE, A PRE-INSPECTION WILL BE MADE TO DETERMINE CURRENT STATE OF THE
 SITE AND POLE A STREET LIGHTING INSPECTOR WILL BE ASSIGNED TO THE PROJECT WILL COORDINATE ALL NECESSARY INSPECTIONS WITH THE PROJECT MANAGER.
 - THE ATTACHEE'S CONTRACTOR SHALL VERIFY THE LOCATION OF ALL UTILITIES TO INCLUDE UNDERGROUND PIPELINES, CONDUITS, STRUCTURES AND OVERHEAD LINES BY CONTACTING THE OWNERS OF THE UTILITIES. THE CONTRACTOR IS RESPONSIBLE FOR MAKING HIS OWN DETERMINATION AS TO THE TYPE AND LOCATION OF UNDERGROUND AND OVERHEAD UTILITIES AS NECESSARY TO AVOID DAMAGE.
 - THE ATTACHEE'S CONTRACTOR SHALL COORDINATE STREETLIGHT POWER DISCONNECTION. IF THE POLE IS DIRECT FED AND HAS NO MEANS OF DISCONNECTION, THE CONTRACTOR IS RESPONSIBLE FOR MAKING ARRANGEMENTS TO DISCONNECT POWER. POWER DISCONNECTION MUST BE MADE BY A LICENSED ELECTRICIAN WITH THE CITY OF KIRKWOOD, MO AND BE A EVERGY CERTIFIED LINEMAN. THIS SERVICE CAN BE PROVIDED BY ANY COMPANY MEETING THESE QUALIFICATIONS OR BY OUR MAINTENANCE CONTRACTOR, BLACK AND MICDONALD. THE CITY OF KIRKWOOD IS NOT RESPONSIBLE FOR COORDINATION OR PAYMENT OF ANY PART OF THE WORK TO BE DOME.
 - THE ATTACHEE'S CONTRACTOR SHALL COMPLETE THE INSTALLATION OF EQUIPMENT AND RESTORE THE SITE TO CITY STANDARDS. ALL COSTS FOR REMOVAL AND REINSTALLATION OF EXISTING ATTACHMENTS SHALL BE THE RESPONSIBILITY OF THE
- COORDINATE FINAL INSPECTION WITH THE STREET LIGHTING INSPECTOR. ALL CHANGES TO THE CITY APPROVED PLAN MUST BE APPROVED PRIOR TO THE WORK BEING COMPLETED. PROVIDE A LABEL ON THE POLE WITH THE ATTACHEE'S EMERGENCY CONTACT INFORMATION. IF THE POLE IS OWNED BY THE ATTACHEE, PROVIDE A PERMANENT POLE IDENTIFICATION LABEL INSTALLED PER PLAN.





STATE OF MISSOUR STATE CERTIFICATE OF AUTHORIZATION # EF-2791 ENGINEER. KMV KEVIN M VANMAELE PE-021561 CIVIL REJ ROBERT E. JENSEN PE-028974 CIVIL CG CHRISTOPHER GIANNOTT! PE-2020038653 CIVIL SDK SHELTON D. KEISLING PE-27323 ELECTRICAL TMS TERRANCE M. SUPER PE-18521 ELECTRICAL

PLANS PREPARED FOR:



7171 West 95th Street, Suite 600 Overland Park, Kansas 66212 Phone: 913-438-7700 Fax: 913-438-777 SSC

*DRAWING NOTICE: THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE PROPERTY OF SSC, INC. AND IS LENT TO THE BORROWER FOR PROPERTY OF SEC. INC. AND EARLY AND IN CONSIDERATION OF THEIR CONFIDENTIAL USE ONLY. AND IN CONSIDERATION OF THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AN AGREES TO RETURN IT UPON REQUEST AND AGREES THAT WILL NOT BE REPRODUCED, COPED, LENT ON OTHERWISE DISPOSED OF DIRECTLY OR INDIRECTLY, NOR USED FOR A PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS: DESCRIPTION DATE BY REV ISSUED FOR REVIEW 02/22/22 CZW A REISSUED FOR REVIEW 06/14/22 C.IO B REISSUED FOR REVIEW 06/24/22 CJO C SSUED FOR CONSTRUCTION 07/19/22 CZW 0 UPDATED ELEVATION 09/28/22 ABT 1

STLC CHF FS 05SC

POLE NUMBER: TRD

SHEET DESCRIPTION:


706081


13426 OLIVE BLVD CHESTERFIELD, MISSOURI


GENERAL NOTES

SHEET #:= GN-1.2

(3 OF 3)

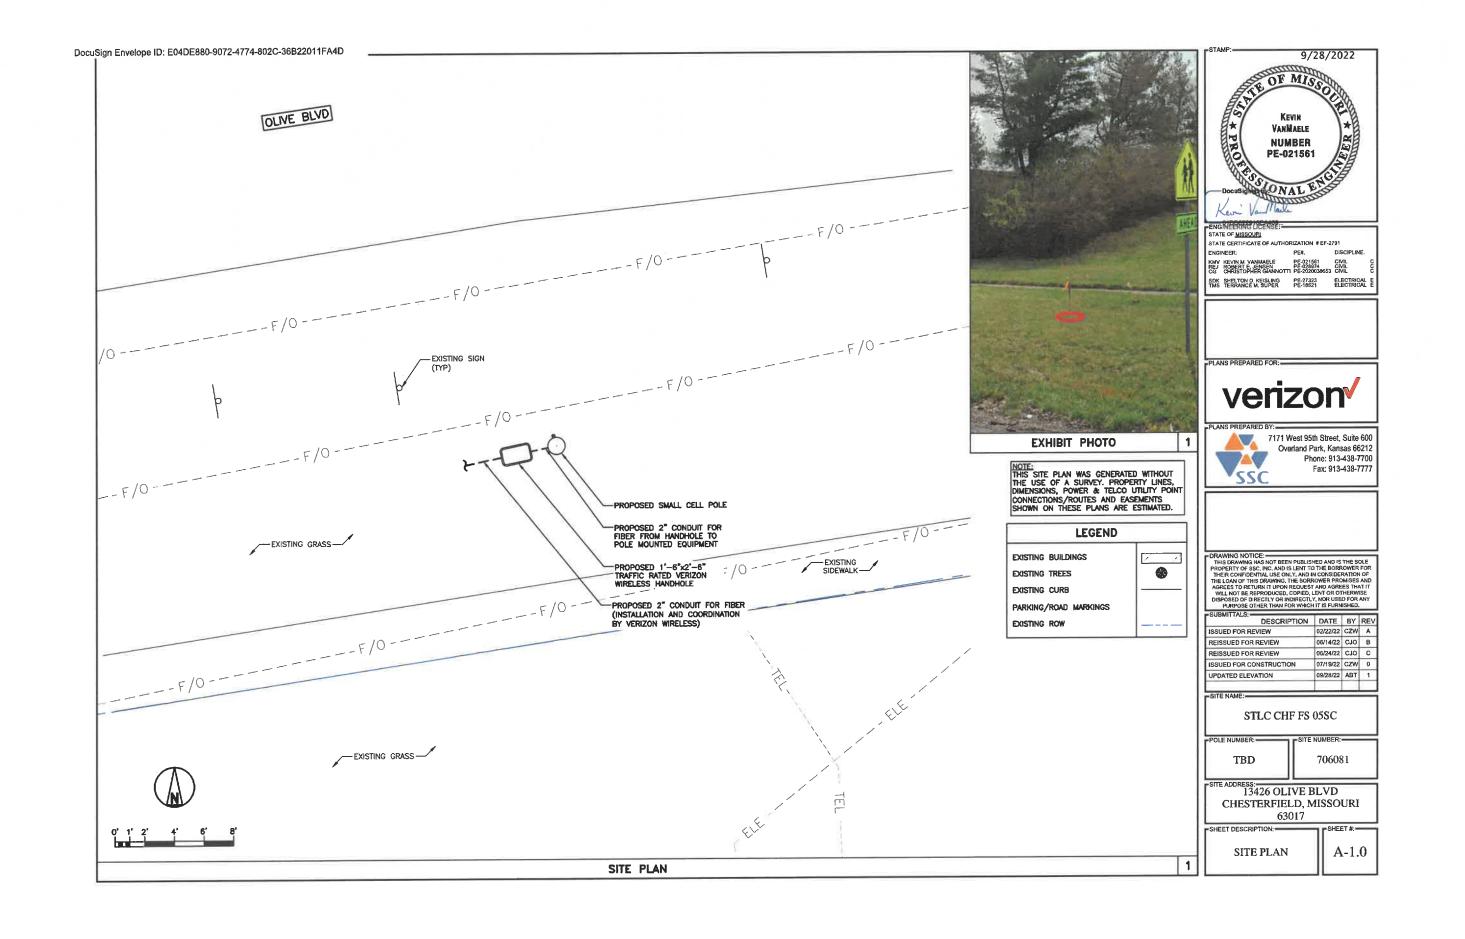


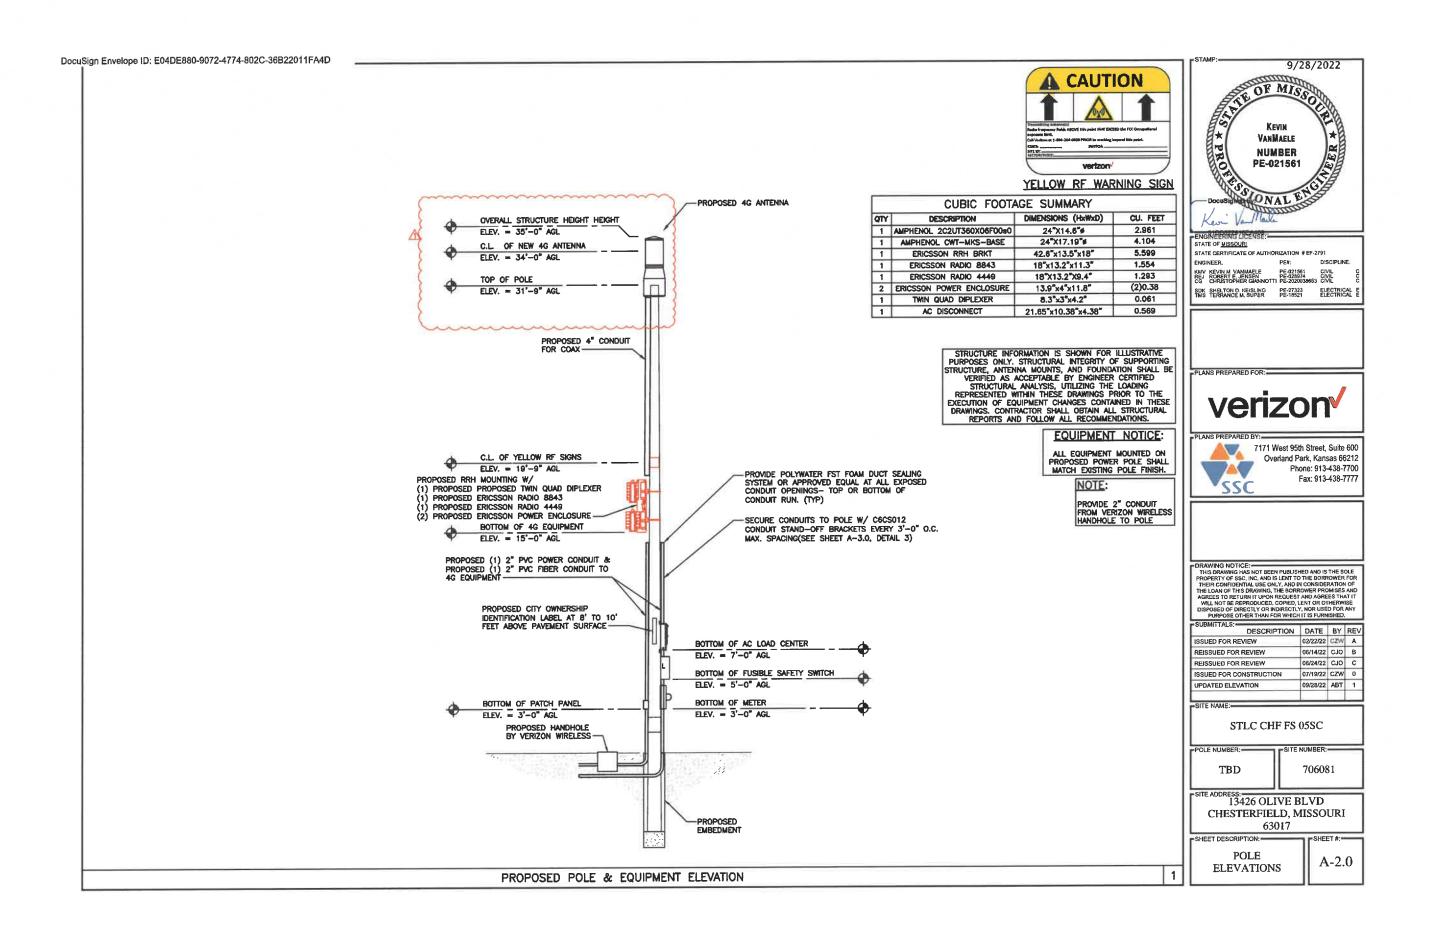

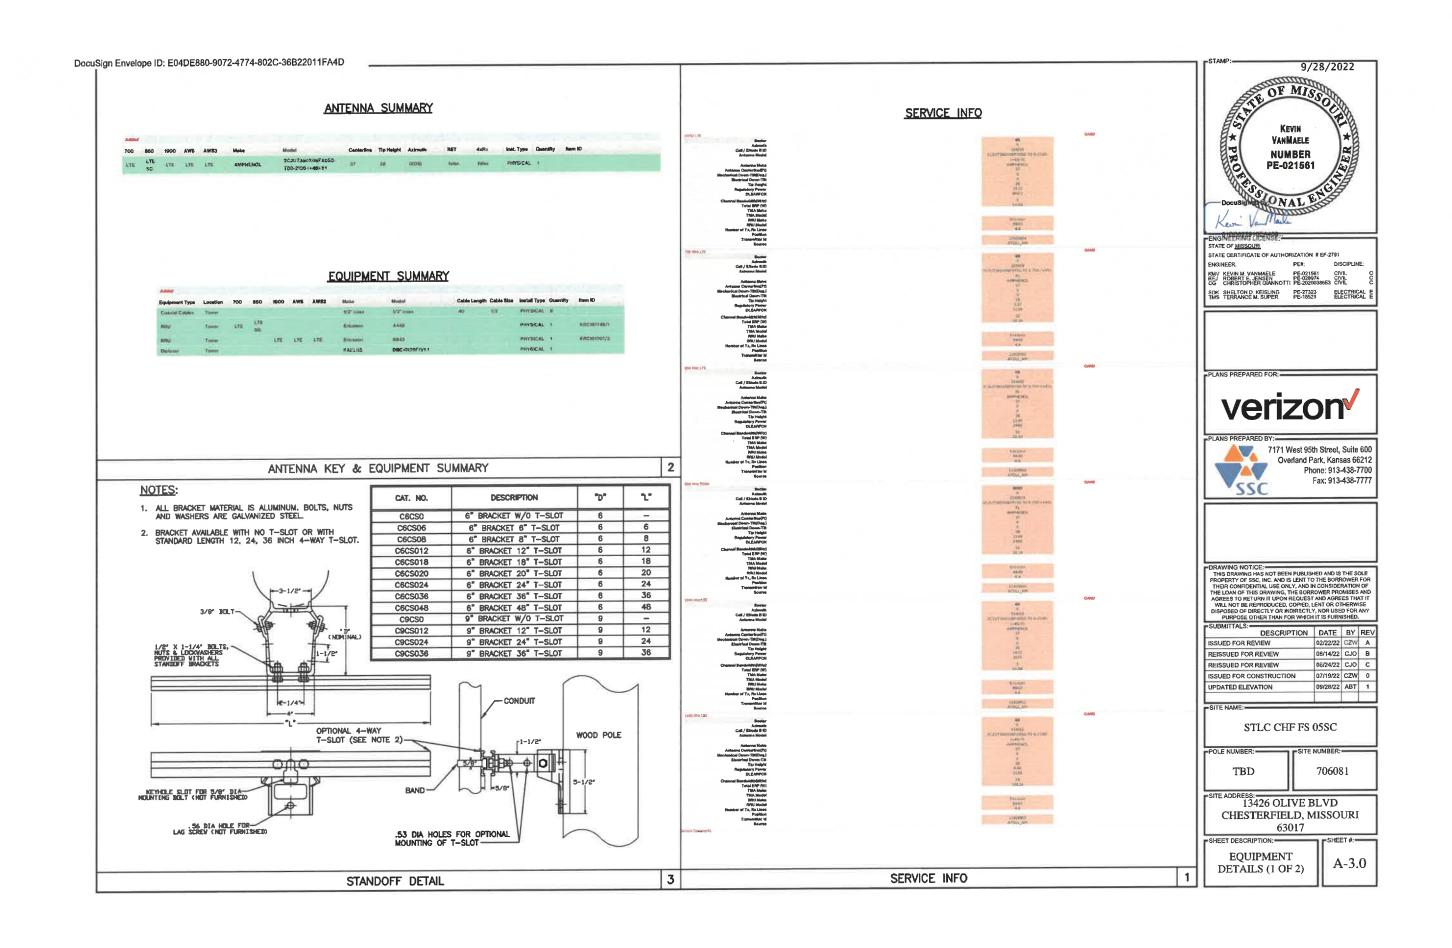



ANTENNA MOUNT INFORMATION IS SHOWN FOR ILLUSTRATIVE PURPOSES ONLY, FINAL MOUNT & ATTACHMENT CONFIGURATION TO BE APPROVED BY ENGINEER.

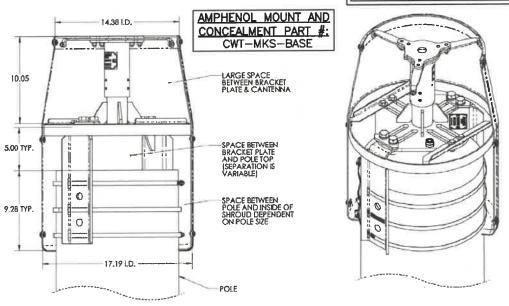

OMNI ANTENNA MOUNTING KIT





- For use with Ericcson 8843 or 4449 and up to (2) of Ericsson Power 6302 Power Supplys
- Compact Size
- Diverse mounting applications; includes concrete lamp post, steel pole, wood pole applications, and wall mountable.
- · Optional grounding locations Power supply mounting options with ability to adjust bracket for slight tilt
- Conceelment Cover attachment (cover not included in this kit*)
- · Kit Includes: (2) Pole Brackets, (2) Power Supply Bracket, (2) Radio Brackets, (2) 5/8 x 16" Bolts, (4) V-Band Clamp. Grounding Jumper, and all associated hardware.
- · Kit Allows for: Radiohead and Power Supply

Product Specifications: Model No: ERICSSON-RRH-BRKT

Dimension (W x H x D)	13.5 x 42.6 x 12.) (inches)
Weight	36 lbs
Safety	500 lbs Vertical Load Rating
Environment	Galvanized, Weather Resistant
Cooling	Natural Cooling
Mount	Lamp post, pole or wall mountable
Construction	Aluminum/Steel
Finish	Outdoor Powder Coating/ Natural Color

4G EQUIPMENT MOUNTING

SPECIFICATIONS:

ERICSSON VENDOR: MODEL#: DIMENSIONS (HxWxD): 18.0" x 13.2" x 9.4" WEIGHT: 70 LBS

ERICSSON 4449 RRU DETAIL

DETAIL NOT USED

FRONT

BOTTOM

≢14.6" SPECIFICATIONS: VENDOR: MODEL#: DIMENSIONS (LxD): WEIGHT: AMPHENOL 2C2UT360X06Fxve0

MODEL#: 8843
DIMENSIONS (HxWxD): 18.0" x 13.2" x 11.3"
WEIGHT: 75 LBS

SPECIFICATIONS:

DIA8 6 (0 33)

EARTH

VENDOR:

5

6.202"

9.100"

0

3/4" CONDUIT

KNOCK-OUT

AC DISCONNECT SWITCH DETAIL

FRONT

BOTTOM


ERICSSON

ERICSSON 8843 RRU DETAIL

14X NARROW

.900"

5.423"

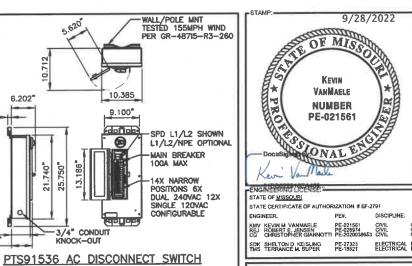





DRAWING NOTICE:
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SQLE
PROPERTY OF SSC. INC. AND IS LENT TO THE BORROWER FOR
THERE CONFIDENTIAL USE ONLY. AND IN CONSIDERATION OF
THE LOAN OF THIS DRAWING. THE BORROWER PROMISES AND
AGREES TO RETURN IT UPON REDUEST AND AGREES THAT IT
WILL NOT BE REPRODUCED, COPPED, LENT OF OTHERWISE.
DISPOSED OF DIRECTLY OR INDIRECTLY, MOR USED FOR ANY
PURPOSE OTHER THAN POR WHICH IT IS PURHISHIED.

SUBMITTALS: DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	02/22/22	CZW	Α
REISSUED FOR REVIEW	06/14/22	CJO	8
REISSUED FOR REVIEW	06/24/22	CTO	С
ISSUED FOR CONSTRUCTION	07/19/22	CZW	0
UPDATED ELEVATION	09/28/22	ABT	1


STLC CHF FS 05SC

TBD 706081

SITE ADDRESS:
13426 OLIVE BLVD CHESTERFIELD, MISSOURI 63017

EQUIPMENT DETAILS (2 OF 2)

A-3.1





105-1700 100-1700 2106-200 2106-200


DBC0129F1V1-1 QUAD DIPLEXER

4G OMNI ANTENNA DETAIL

6

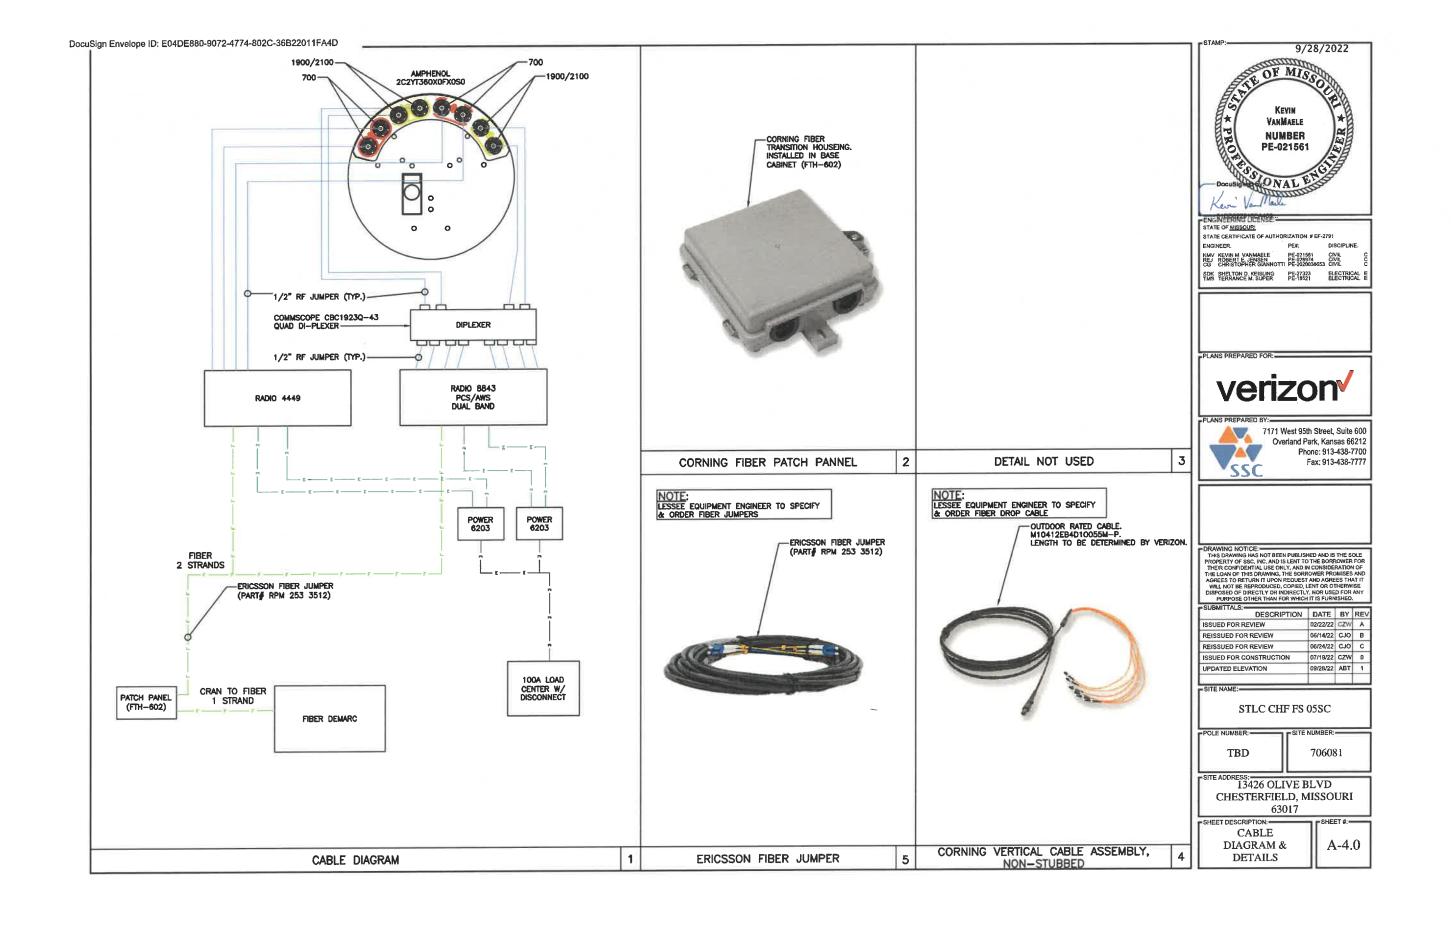

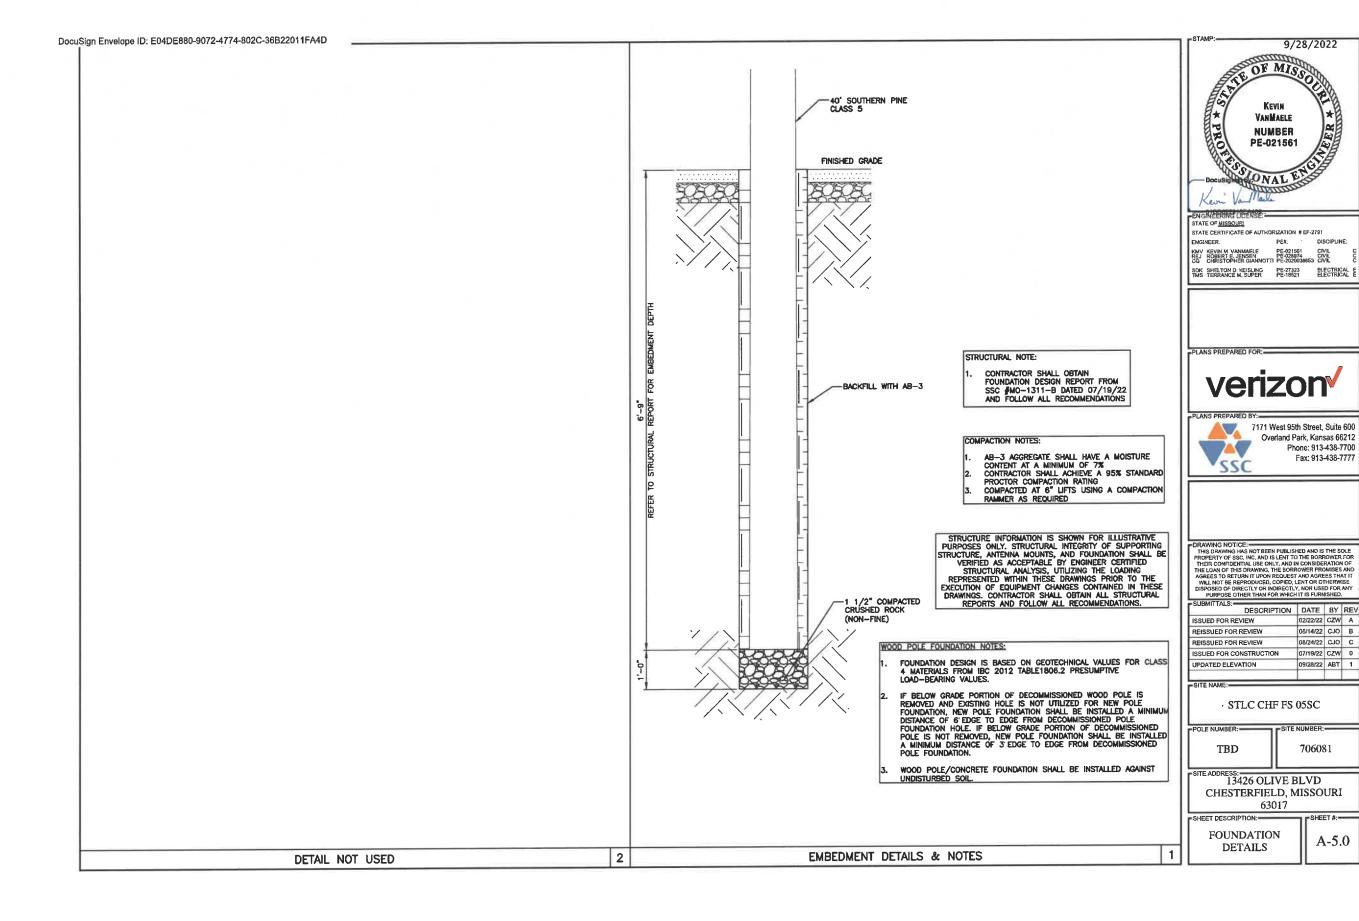

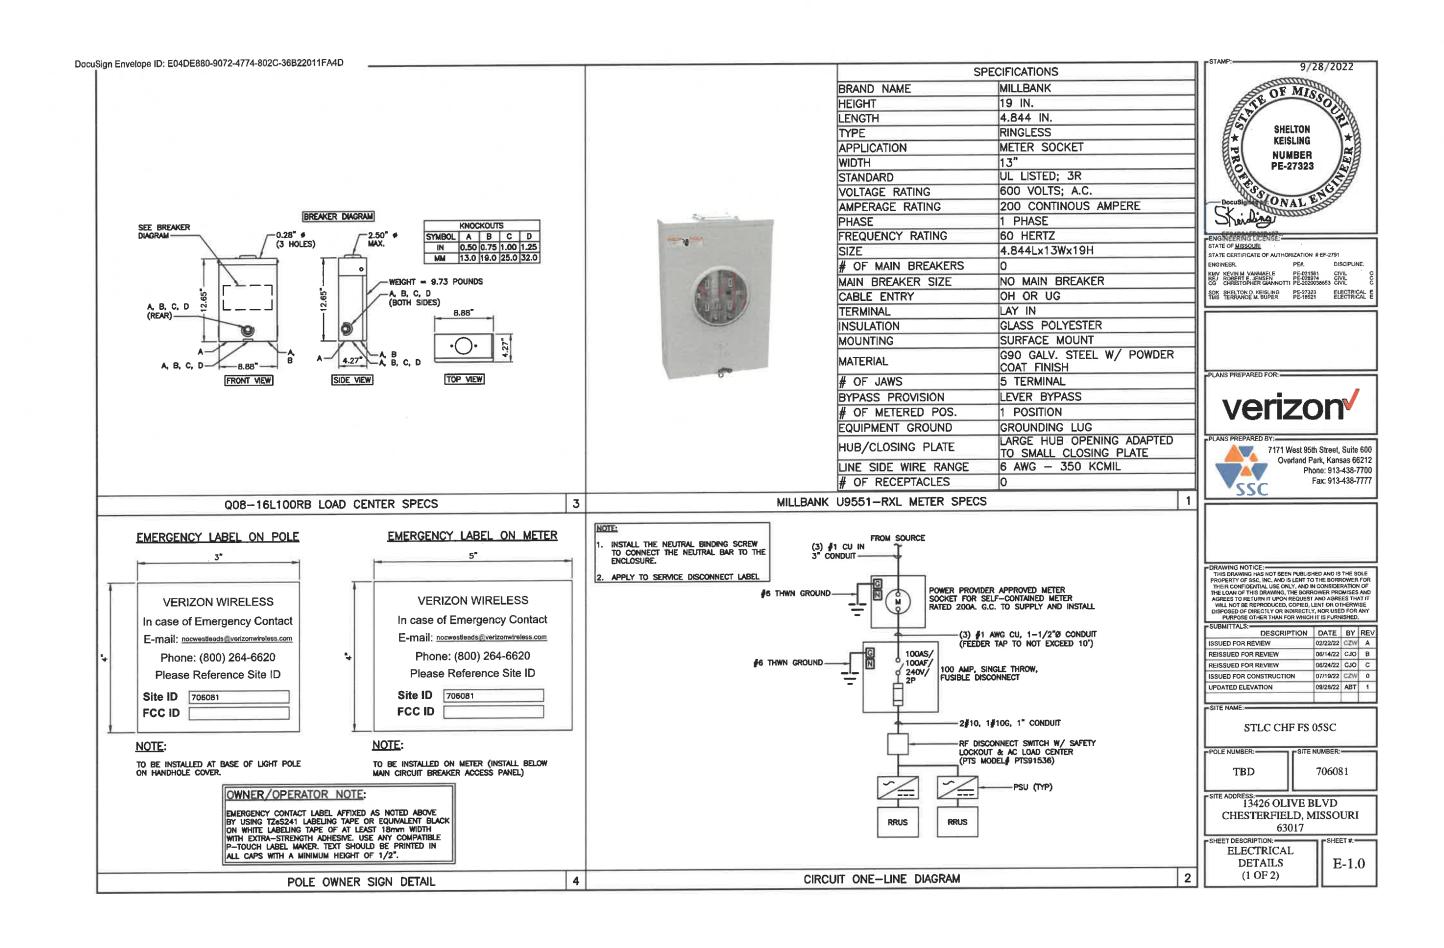

NOTE: RF NOTICE SIGN FOR MINI MACROS (>40 WATT OUTPUT POWER FROM ANTENNAS)




ANTENNA SIGNAGE:
ON WOOD POLES - SIGN ON ALUMINUM WITH SS SCREW
TO THE POLE
ON METAL POLES - ADHESIVE VINYL OR PLACARD
STRAPPED WITH SS TIES ON CONCRETE / COMPOSITE — PLACARD STRAPPED WITH SS TIES SS ILES
SIGN PLACEMENT:
AFFIX TO THE STRUCTURE 11-12' BELOW THE
COMMERCIAL RF ANTENNA(S)

VERIFY DISTANCE PER LOCAL CODE, UTILITY COMPANY, AND CLIENT REQUIREMENTS TOP 6" SHALL BE STANDARD FILL PER EXISTING SITE SURFACE (SEE NOTE 1) FINISHED GRADE TAPE (TYP) 2'-6" (MIN) (SEE NOTE 2) -UNEXCAVATED GRAVEL/FINE DIRT FILL COMPACTED OR COMPACTED SAND, FOR CONCRETE ENCASEMENT: SURROUND THE CONDUITS 8" (MIN) ON ALL SIDES 1'-0" (MIN) PVC CONDUIT PVC CONDUIT

CONDUIT TRENCH DETAIL

(SEE NOTE 2)

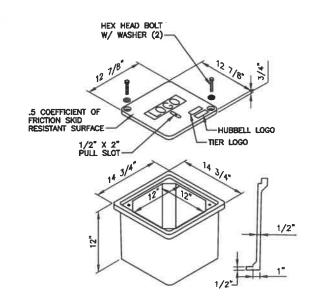

ORDERING INFORMATION

MANUFACTURER: HUBBELL POWER SYSTEMS

PART#: COVER - PC1212HA00**
BOX - PC1212BA12

DESCRIPTION: 12"x12"x"12" TIER 12 PC STYLE POLYMER CONCRETE HANDHOLE

NOTE: G.C. MAY USE APPROVED EQUAL

9/28/2022 OF MISS SHELTON KEISLING NUMBER PE-27323 ONALE Skinding

STATE OF MISSOURI STATE CERTIFICATE OF AUTHORIZATION # EF-2791 ENGINEER: DISCIPLINE SDK SHELTON D. KEISLING PE-27323 ELECTRICAL TMS TERRANCE M. SUPER PE-18521 ELECTRICAL



7171 West 95th Street, Suite 600 Overland Park, Kansas 66212 Phone: 913-438-7700 Fax: 913-438-7777 SSC

PDRAWING NOTICE:
THIS DRAWING HAS NOT BEEN PUBLISHED AND IS THE SOLE
PROPERTY OF SSC, INC, AND IS LEIN TO THE BORROWER FOR
THEIR COMFIDENTIAL USE ONLY, AND IN CONSIDERATION OF
THE LOAN OF THIS DRAWING, THE BORROWER PROMISES AND
AGREES TO RETURN IT UPON REQUEST AND AGREES THAT IT
WILL NOT BE REPRODUCED, CONCILITY, OR USED FOR ANY
PURPOSE OTHER THAN FOR WHICH IT IS FURNISHED.

SUBMITTALS: DESCRIPTION	DATE	BY	REV
ISSUED FOR REVIEW	02/22/22	czw	Α
REISSUED FOR REVIEW	06/14/22	CJO	В
REISSUED FOR REVIEW	06/24/22	CJO	Ç
ISSUED FOR CONSTRUCTION	07/19/22	czw	0
UPDATED ELEVATION	09/28/22	ABT	1

STLC CHF FS 05SC

TBD 706081

SITE ADDRESS:
13426 OLIVE BLVD CHESTERFIELD, MISSOURI

SHEET DESCRIPTION: ELECTRICAL **DETAILS** (2 OF 2)

SHEET#:-E-1.1

RF NOTICE SIGN DETAIL

3

NOTES:

WIDTH OF TRENCH AS REQUIRED BY UTILITY COMPANY OR PER QUANTITY OF CONDUITS AND LOCAL CODE REQUIREMENTS

FIBER HAND HOLE DETAIL

