

## Planning Commission Staff Report

**Project Type:** Site Development Concept Plan

**Meeting Date:** November 13, 2019

**From:** Andrew Stanislav, Planner *AS*

**Location:** 17511 Chesterfield Airport Road

**Description:** **84 Lumber, Adj. Lot 2 (17511 Chesterfield Airport Rd):** A Site Development Concept Plan, Landscape Concept Plan, and Lighting Concept Plan for a 13.023 acre tract of land zoned “PC” Planned Commercial located on the north side of Chesterfield Airport Road east of Long Road (17U510084).

### PROPOSAL SUMMARY

Stock and Associates Consulting Engineers, Inc. has submitted a Site Development Concept Plan for Planning Commission review. This request depicts a phased development of 5 lots that totals 13.023 acres. The subject site is zoned “PC” Planned Commercial District and is currently governed under the terms and conditions of City of Chesterfield Ordinance 2969. A Site Development Concept Plan, Landscape Concept Plan, and Lighting Concept Plan have all been submitted for review and approval in accordance with the governing ordinance.

### HISTORY OF SUBJECT SITE

The subject site was originally zoned “NU” Non-Urban District by St. Louis County prior to the City’s incorporation. On October 2, 1995, a record plat was approved by the City of Chesterfield establishing lots 1 and 2 of the 84 Lumber Subdivision.



Figure 1: Subject Site Aerial Image

City of Chesterfield Ordinance 2969 was approved by City Council on August 7, 2017, establishing a “PC” Planned Commercial District for Lot 2 of the 84 Lumber Subdivision. Subsequently, a Boundary Adjustment Plat was approved by the City on August 5, 2019, in order to consolidate a small 10-foot wide tract of land located between Lot 2 of the 84 Lumber Subdivision and Chesterfield Commons Seven.

A Site Development Concept Plan and Site Development Section Plan were submitted and reviewed by the City in 2017; however, these applications became inactive and the subject site currently remains vacant.

A Public Hearing before the Planning Commission was held on October 16, 2019 for a proposed ordinance amendment for the subject site (P.Z. 13-2019) with the purposes of requesting 1) to add “automobile dealership” as a permitted use, and 2) to increase the maximum height from one (1) to two (2) story construction. This petition is still proceeding through the City’s approval process; however, none of the changes requested to the planned district ordinance impact the Site Development Concept Plan.

### **STAFF ANALYSIS**

The subject site is located on the north side of Chesterfield Airport Road, east of Long Road, and south of Interstate 64. Given that Chesterfield Airport Road and I-64 are both classified as major arterials according to the City’s functional classification system, facades along these frontages will be highly visible to a large number of users. The area is designated “Mixed Commercial Use” within the City of Chesterfield Comprehensive Land Use Plan, and the subject site comprises a total of 13.023 acres.

The Site Development Concept Plan substantially conforms to the Preliminary Development Plan that was approved in conjunction with Ordinance 2969 (as well as the modified Preliminary Development Plan submitted for consideration with ordinance amendment P.Z. 13-2019 for the subject site). Information regarding surrounding land uses, zoning districts, and the City’s Comprehensive Plan Land Use Designation and Policies for this development are provided in the Staff Report for the ordinance amendment (P.Z. 13-2019) that is also being presented for consideration.

### **Site Development Concept Plan**

The Concept Plan provides general areas for lot lines, potential roadways, building footprints, and parking areas. The subject site is composed of five total lots (A-E) for the phased development as seen in Figure 2 on the following page, all of which is currently undeveloped.



the applicant is proposing to clear-cut the site and instead provide mitigation for each lot in the proposed development.

### **Lighting Concept Plan**

The applicant has submitted the required Lighting Concept Plan. The primary purpose of the Lighting Concept Plan is to provide streetlighting along the Arnage Road extension as well as the frontage along Chesterfield Airport Road as required in the site specific ordinance. All streetlight fixtures are flat lensed, fully enclosed, directed downward, and are to be approved by Ameren as noted on the plan.

### **DEPARTMENTAL INPUT**

Staff has reviewed the submittal and has found the application to be in conformance with the City of Chesterfield Unified Development Code and Ordinance 2969. Staff recommends approval of the Site Development Concept Plan for the 84 Lumber, Adj. Lot 2 (17511 Chesterfield Airport Rd) development.

### **MOTION**


The following options are provided to the Planning Commission for consideration relative to this application:

- 1) "I move to approve (or deny) the Site Development Concept Plan, Landscape Concept Plan, and Lighting Concept Plan for 84 Lumber, Adj. Lot 2 (17511 Chesterfield Airport Rd)."
- 2) "I move to approve the Site Development Concept Plan, Landscape Concept Plan, and Lighting Concept Plan for 84 Lumber, Adj. Lot 2 (17511 Chesterfield Airport Rd) with the following conditions..." (conditions may be added, eliminated, altered or modified)

Attachments: Site Development Concept Plan Packet

# SITE DEVELOPMENT CONCEPT PLAN FOR ADJUSTED LOT 2 - 84 LUMBER SUBDIVISION AS RECORDED IN PB. 367, PG. 350

A TRACT OF LAND IN U.S. 125 AND ADJUSTED LOT 2 OF THE BOUNDARY ADJUSTMENT PLAT OF  
84 LUMBER SUBDIVISION AS RECORDED IN PLAT BOOK 367, PAGE 350 LOCATED IN  
TOWNSHIP 45 NORTH, RANGE 4 EAST OF THE 5TH PRINCIPAL MERIDIAN,  
CITY OF CHESTERFIELD, ST. LOUIS COUNTY, MISSOURI

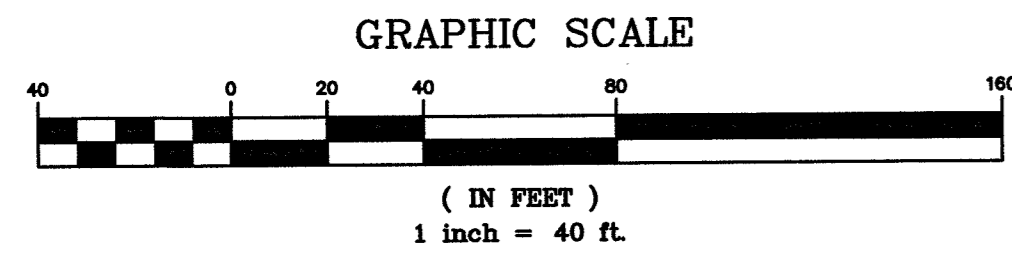

### GENERAL NOTES:

- Subject property is Zoned "PC" Planned Commercial District Ordinance 2869, August 7, 2017.  
General Requirements (see Ordinance 2869):  
Maximum building floor area - 50,000 sq.ft. (except Hotels)  
Maximum building height - 42 feet (except Hotels)  
Minimum Open Space - 35 percent  
Maximum development F.A.R. of 0.55.  
Structure setback - 30 feet from southern boundary of district (Chesterfield Airport Road)  
Structure setback - 55 feet from northern boundary of district (I-64/US 40)  
Structure setback - 10 feet from all other boundary lines of district.  
Parking setback - 30 feet from southern boundary of district (Chesterfield Airport Road)  
Parking setback - 55 feet from northern boundary of district (I-64/US 40)  
Parking setback - 0 feet from all other boundary lines of district.
- Subject property lies within Flood Zones "A" shaded "Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood." and Zone AH "Flood depths of 1 to 3 feet (usually areas of ponding). Base Flood Elevations determined. Shown Graphically
- Utilities shown hereon are from shown from record and/or survey information. Any location, size and type information should be considered as approximate only. It is the Contractor's responsibility to call Dig-Rite to verify utility locations.
- Parcels 1 & 2 are contiguous with no gaps or gores.
- Per Plat Book 336, Page 80, Parcel 3, was established to grant Lot 2 (Parcel 1) access to Chesterfield Airport Road.

### ADJUSTED LOT 2 (08/22/19)

A tract of land being Adjusted Lot 2 of 84 Lumber Subdivision as recorded in Plat Book 367 Page 350 of the St. Louis County Records, and part of U.S. Survey 125, located in Township 45 North, Range 4 East of the 5th Principal Meridian, City of Chesterfield, St. Louis County, Missouri, and being more particularly described as follows:

Beginning at the southwest corner of Chesterfield Airport Road 17505 as recorded in Plat Book 365 Page 150 of the St. Louis County records, said point being on the north right of way line of Chesterfield Airport Road, 100 feet wide; thence South 89 degrees 31 minutes 27 seconds West, along the north right of way line of said Airport Road, 520.40 feet, to the southeast corner of Lot 1 of above said 84 Lumber Subdivision; thence the following courses and distance along the east and south lines of Lot 1 of said 84 Lumber Subdivision: North 00 degrees 49 minutes 46 seconds East, 367.38 feet; North 89 degrees 31 minutes 24 seconds East, 406.95 feet; and North 00 degrees 45 minutes 19 seconds East, 641.83 feet, to the south right of way line of Interstate 64, variable width; thence South 84 degrees 19 minutes 27 seconds East, along the south line of said Interstate 64, 505.68 feet, to the west line of Chesterfield Commons Seven as recorded in Plat Book 359 Page 158 of the St. Louis County records; thence South 00 degrees 28 minutes 53 seconds West, along the west line of said Chesterfield Commons Seven, 754.45 feet, thence South 89 degrees 31 minutes 27 seconds West, along the north line of Outparcel 2 of said Chesterfield Commons Seven, and the north line of said Chesterfield Airport Road 17505, 395.35 feet, to the northwest corner of said Chesterfield Airport Road 17505; thence South 00 degrees 31 minutes 19 seconds West, along the West line of said Chesterfield Airport Road 17505, 200.38 feet; to the POINT OF BEGINNING. Containing 567,264 square feet or 13.023 acres, more or less, according to calculations performed by Stock & Associates Consulting Engineers, Inc. on May 31, 2019.

### SURVEYOR'S CERTIFICATION

This is to certify that Stock and Associates Consulting Engineers, Inc. has prepared this Site Development Concept Plan from a field survey and does not represent a property boundary survey. The information shown is a correct representation of all existing and proposed land divisions.

STOCK AND ASSOCIATES CONSULTING ENGINEERS INC.  
LC No. 222-D

Walter J Pfleger, Missouri P.L.S. No. 2008000728

### MSD BENCHMARK

BENCHMARK 12171 NGVD29 Elev = 460.06 FUS  
Standard DNR aluminum disk stamped SL-38 situated in a grassy area northwest of the intersection of Chesterfield Airport Road and Caprice Drive, south of the parking for a retail strip center approximately 0.1 miles east of Long Road, roughly 50 feet west of the centerline of Caprice Drive, 43 feet north of the centerline of Chesterfield Airport Road, and 69 feet east of a tree hydrant.

### SITE BENCHMARK

BENCHMARK "50" ON LIGHT POLE  
at the Southwest corner of 17505 Chesterfield Airport Road.  
ELEV. 464.89

### GEOTECHNICAL ENGINEER'S STATEMENT

Midwest Testing and the undersigned engineer have not prepared the plan on this sheet. The seal of the undersigned professional engineer has been affixed at the request of the City of Chesterfield and is a professional opinion to indicate that the undersigned has reviewed the plans and that in his opinion the grading and improvements relative to slope construction as shown on the plans, as well as the foundations, are compatible with the soil and geologic conditions at the site as described in the geotechnical report for the development, titled Geotechnical Exploration—MT Job No. 14684—17511 Chesterfield Airport Road—Chesterfield, Missouri and dated May 31, 2019.

Midwest Testing and the undersigned assume no responsibility for services by others, pursuant to RSMO 327.411.


Construction means and methods for implementation of the grading plan shall be left to the developer/contractor. Observations of the developer/contractor's compliance with the applicable specifications shall be identified and verified in writing.

MIDWEST TESTING  
Richard D. Laughlin, P.E.  
Missouri PE No. E-20132



ABBREVIATIONS	
C.O.	CLEANOUT
DE	DEED BOOK
E	ELECTRIC
FL	FLOWLINE
FT	FEET
FND.	FOUND
G	GAS
M.H.	MANHOLE
N/F	NOW OR FORMERLY
PL	PLAT BOOK
P.C.	PAGE
P.V.C.	POLYVINYL CHLORIDE PIPE
R.B.	RADIAL BEARING
R.C.P.	REINFORCED CONCRETE PIPE
SQ.	SQUARE
T.C.P.	TELEPHONE CABLE
V.C.P.	VITRIFIED CLAY PIPE
W	WATER
(86'W)	RIGHT-OF-WAY WIDTH

LEGEND	
⊕	BENCH MARK
⊙	FOUND IRON ROD
⊚	FOUND IRON PIPE
⊛	RIGHT OF WAY MARKER
⊚	UTILITY POLE
⊚	SUPPORT POLE
⊚	UTILITY POLE WITH LIGHT
⊚	LIGHT STANDARD
⊚	ELECTRIC METER
⊚	ELECTRIC MANHOLE
⊚	ELECTRIC PEDESTAL
⊚	ELECTRIC SPUR BOX
⊚	GAS DRIP
⊚	GAS METER
⊚	GAS VALVE
⊚	TELEPHONE MANHOLE
⊚	TELEPHONE PEDESTAL
⊚	TELEPHONE SPUR BOX
⊚	CABLE TV PEDESTAL
⊚	FIRE HYDRANT
⊚	FIRE DEPARTMENT CONNECTION
⊚	WATER MANHOLE
⊚	WATER METER
⊚	WATER VALVE
⊚	POST INDICATOR VALVE
⊚	CLEAN OUT
⊚	STORM MANHOLE
⊚	GRATED MANHOLE
⊚	STORMWATER INLET
⊚	GRATED STORMWATER INLET
⊚	SANITARY MANHOLE
⊚	TREE
⊚	BUSH
⊚	TRAFFIC SIGNAL
⊚	PARKING METER
⊚	STREET SIGN
⊚	SPRINKLER
⊚	MAIL BOX

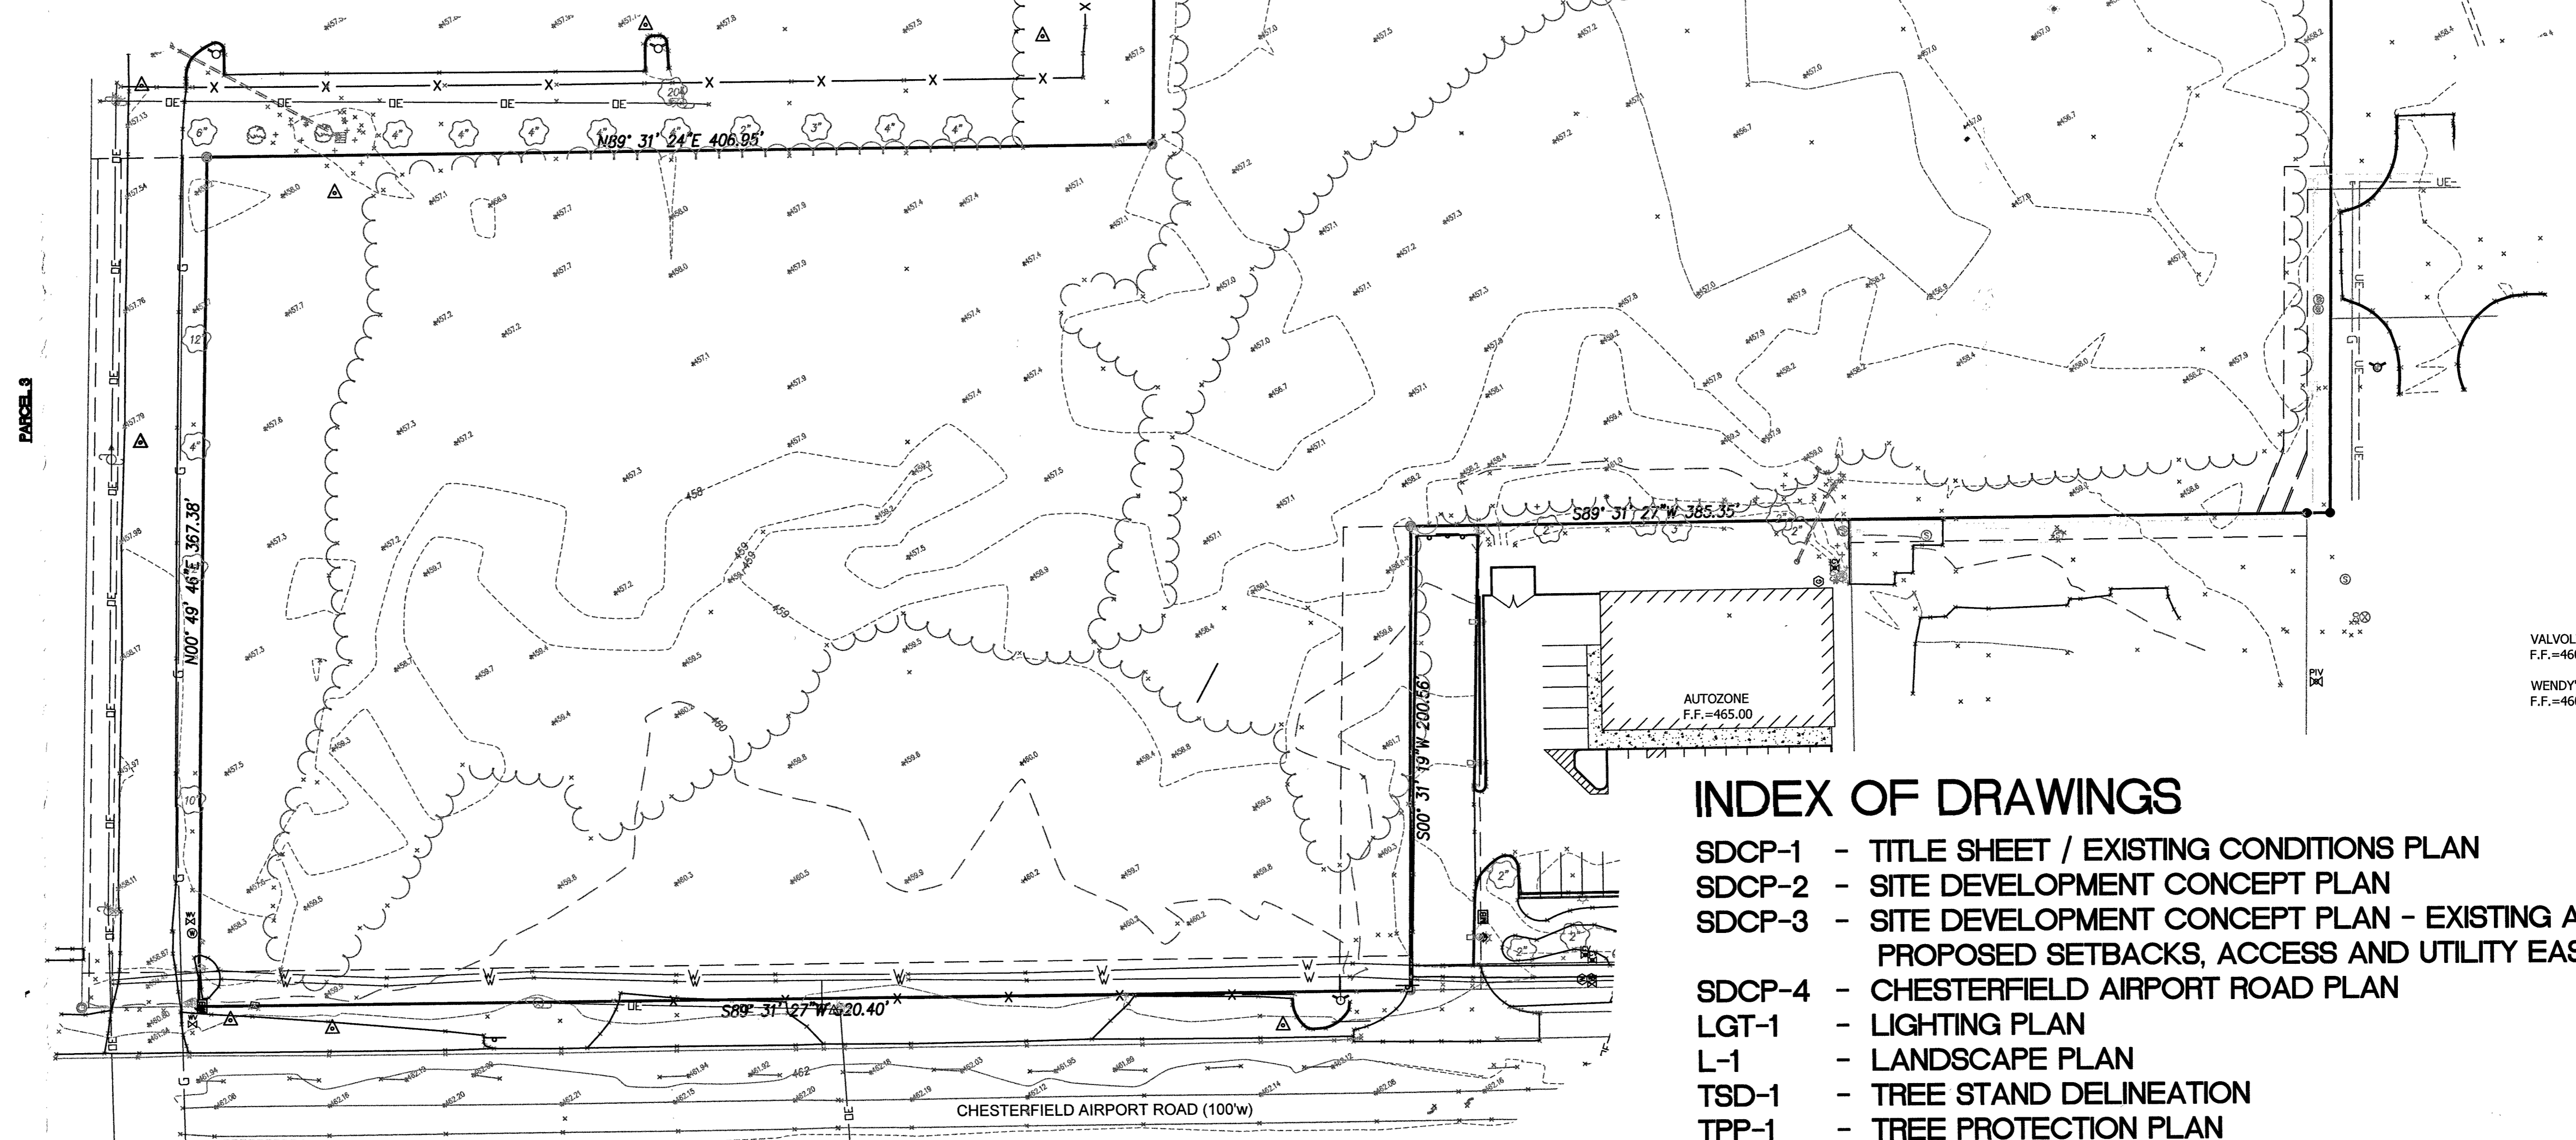


### INDEX OF DRAWINGS

- SDCP-1 - TITLE SHEET / EXISTING CONDITIONS PLAN
- SDCP-2 - SITE DEVELOPMENT CONCEPT PLAN
- SDCP-3 - SITE DEVELOPMENT CONCEPT PLAN - EXISTING AND PROPOSED SETBACKS, ACCESS AND UTILITY EASEMENTS
- SDCP-4 - CHESTERFIELD AIRPORT ROAD PLAN
- LGT-1 - LIGHTING PLAN
- L-1 - LANDSCAPE PLAN
- TSD-1 - TREE STAND DELINEATION
- TPP-1 - TREE PROTECTION PLAN

PREPARED FOR:  
TSG CHESTERFIELD AIRPORT ROAD, LLC  
c/o THE STAENBERG GROUP  
2127 INNERBELT BUSINESS CENTER DRIVE  
ST. LOUIS MISSOURI 63114  
ATTN - MR. SAM ALDER - DEVELOPMENT DIRECTOR

PREPARED BY:  
**STOCK & ASSOCIATES**  
Consulting Engineers, Inc.  
257 Chesterfield Business Parkway  
St. Louis, MO 63005 PH: (636) 530-9000 FAX: (636) 530-9000  
E-mail: general@stockinc.com  
Web: www.stockinc.com

A SITE DEVELOPMENT CONCEPT PLAN FOR:  
**ADJUSTED LOT 2 - 84 LUMBER SUBDIVISION**  
17511 CHESTERFIELD AIRPORT ROAD  
CITY OF CHESTERFIELD, MO 63005

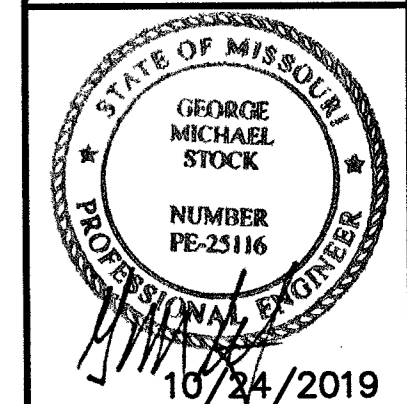

10/24/2019  
GEORGE M. STOCK, E-25116  
CIVIL ENGINEER  
CITY OF CHESTERFIELD  
NUMBER: 000986

REVISIONS:	
1	10/09/19 - CITY COMMENTS
2	10/24/19 - CITY COMMENTS

RECEIVED	
OCT 31 2019	
DRAWN BY: J.P.W.	CHECKED BY: G.M.S.
DATE: 09/06/2019	JOB NO: 218-6407.2
M.S.D. #:	BASE MAP #:
S.L.C. HNT #:	HNT SUP. #:
M.D.N.A. #:	
SHEET TITLE: EXISTING CONDITIONS PLAN	
SHEET NO.: SDCP-1	

**PERTINENT DATA**

OWNER: TSG CHESTERFIELD AIRPORT ROAD, LLC  
LOT AREA: 13.023 Acres ±  
EXISTING ZONING: "PC" PLANNED COMMERCIAL DISTRICT (ORD. #2969)  
SITE ADDRESS: 17511 CHESTERFIELD AIRPORT ROAD  
CHESTERFIELD, MISSOURI 63005

LOCATOR NO: 17U510084  
WUNNENBERG'S: PG. 20, GRID 18HH  
FIRE DISTRICT: MONARCH FIRE PROTECTION DISTRICT  
SCHOOL DISTRICT: ROCKWOOD  
SEWER DISTRICT: METROPOLITAN ST. LOUIS SEWER DIST.  
WATER SHED: MISSOURI RIVER  
FEMA MAP: 29189C0165K, FEB 4, 2015  
ELECTRIC COMPANY: AMEREN UE  
GAS COMPANY: SPIRE INC.  
BRIAN LANGENBACHER 314-768-7767  
PATRICK MCMILLAN 314-575-4835  
AT&T  
MISSOURI AMERICAN WATER COMPANY  
GINA BAYES 314-996-2465 (SERVICE LINES)  
SUE MOYNIHAN 314-996-2306 (MAIN EXTENSIONS)

PHONE COMPANY:  
WATER COMPANY:

**GENERAL NOTES**


- BOUNDARY AND TOPOGRAPHIC SURVEY BY STOCK & ASSOCIATES CONSULTING ENGINEERS, INC.
- ALL UTILITIES SHOWN HAVE BEEN LOCATED BY THE ENGINEER FROM AVAILABLE RECORDS. THEIR LOCATION SHOULD BE CONSIDERED APPROXIMATE. THE CONTRACTOR HAS THE RESPONSIBILITY TO NOTIFY ALL UTILITY COMPANIES, PRIOR TO CONSTRUCTION, TO HAVE EXISTING UTILITIES FIELD LOCATED.
- NO GRADE SHALL EXCEED 3:1 SLOPE.
- GRADING AND STORM WATER PER M.S.D., WOODOT, ST. LOUIS COUNTY, THE CITY OF CHESTERFIELD AND THE MONARCH CHESTERFIELD LEVEE DISTRICT.
- STORMWATER SHALL BE DISCHARGED AT ADEQUATE NATURAL DISCHARGE POINT. SINKHOLES ARE NOT ADEQUATE DISCHARGE POINTS.
- ALL UTILITIES WILL BE INSTALLED UNDERGROUND.
- SITE DEVELOPMENT SHALL BE IN ACCORDANCE WITH RECOMMENDATIONS AS OUTLINED IN THE GEOTECHNICAL EXPLORATION TITLED B AND ALL IRS SUPPLEMENTAL PROVISIONS AND ADDENDUMS.
- SIGNAGE APPROVAL IS A SEPARATE PROCESS

**ST. LOUIS COUNTY STANDARD NOTES**

- ALL PROPOSED IMPROVEMENTS SHALL BE CONSTRUCTED TO ST. LOUIS COUNTY STANDARDS.
- NO SLOPES WITHIN ST. LOUIS COUNTY RIGHT-OF-WAY SHALL EXCEED 3 (HORIZONTAL) TO 1 (VERTICAL).
- STORM WATER SHALL BE DISCHARGED AT AN ADEQUATE NATURAL DISCHARGE POINT. SINKHOLES ARE NOT ADEQUATE DISCHARGE POINTS.
- ALL PROPOSED ACCESS TO ST. LOUIS COUNTY ROADS SHALL MEET MINIMUM ST. LOUIS COUNTY SIGHT DISTANCE REQUIREMENTS.
- ALL GRADING AND DRAINAGE SHALL BE IN CONFORMANCE WITH ST. LOUIS COUNTY AND MSD STANDARDS.
- ALL HYDRANTS, POWER POLES OR OTHER POTENTIAL OBSTRUCTIONS WITHIN THE ST. LOUIS COUNTY ROAD RIGHT-OF-WAY SHALL HAVE A MINIMUM TWO (2) FOOT SETBACK FROM FACE OF CURB OR EDGE OF PAVEMENT, AS DIRECTED BY THE ST. LOUIS COUNTY DEPARTMENT OF HIGHWAYS AND TRAFFIC.
- ANY ENTITY THAT PERFORMS WORK ON ST. LOUIS COUNTY MAINTAINED PROPERTY SHALL PROVIDE THE COUNTY WITH A CERTIFICATE OF INSURANCE EVIDENCING GENERAL LIABILITY COVERAGE (BODILY INJURY AND PROPERTY DAMAGE) IN THE AMOUNTS SPECIFIED AS THE LIMITS OF LIABILITY SET BY THE STATE FOR PUBLIC ENTITIES. SUCH CERTIFICATE SHALL INCLUDE "ST. LOUIS COUNTY" AS AN ADDITIONAL INSURED AND SHALL BE PROVIDED PRIOR TO THE ISSUANCE OF ANY PERMIT. CERTIFICATE SHALL PROVIDE FOR A 30 DAY POLICY CANCELLATION NOTICE TO ST. LOUIS COUNTY. UPON REQUEST, THE COUNTY WILL PROVIDE THE SPECIFIC AMOUNTS FOR BOTH PER PERSON AND PER OCCURRENCE LIMITS.
- PRIOR TO "SPECIAL USE PERMIT" ISSUANCE BY THE ST. LOUIS COUNTY DEPARTMENT OF HIGHWAYS AND TRAFFIC, A SPECIAL CASH ESCROW OR A SPECIAL ESCROW SUPPORTED BY AN IRREVOCABLE LETTER OF CREDIT, MAY BE REQUIRED TO BE ESTABLISHED WITH THE ST. LOUIS COUNTY DEPARTMENT OF HIGHWAYS AND TRAFFIC TO GUARANTEE COMPLETION OF THE REQUIRED ROADWAY IMPROVEMENTS.
- CONTINUOUS PEDESTRIAN ACCESS SHALL BE PROVIDED DURING THE CONSTRUCTION PROCESS. PRIOR TO THE START OF CONSTRUCTION, ADEQUATE PEDESTRIAN ACCESS AROUND THE SITE SHALL BE PROVIDED AND VERIFIED. NO EXISTING SIDEWALK SHALL BE REMOVED WITHOUT PROVIDING ADEQUATE PEDESTRIAN FACILITIES AND ROUTES DURING CONSTRUCTION ACTIVITIES.

**ST. LOUIS COUNTY NOTES**

- ALL STRIPING IN CHESTERFIELD AIRPORT ROAD RIGHT-OF-WAY IN COUNTY JURISDICTION SHALL BE BY COUNTY FORCES.
- TRAFFIC GENERATION ASSESSMENT CONTRIBUTIONS SHALL BE ASSESSED WITH EACH SITE DEVELOPMENT SECTION PLAN SUBMITTAL.

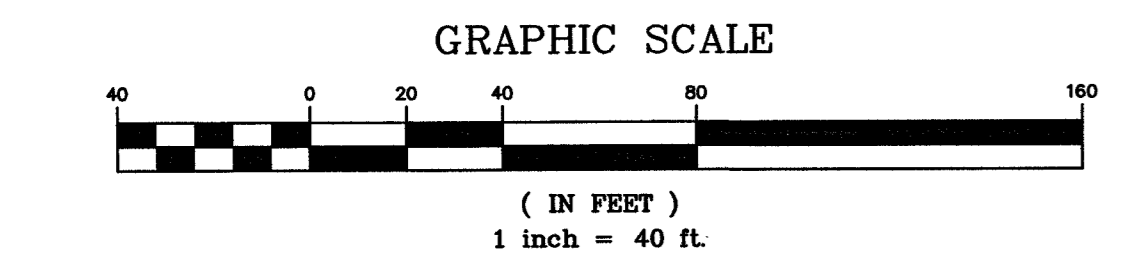

**ABBREVIATIONS**

- ATC - ADJUST TO GRADE
- B.C. - BACK OF CURB
- C.O. - CLEANOUT
- DB. - DEED BOOK
- E. - ELECTRIC
- ELEV. - ELEVATION
- EX. - EXISTING
- F.C. - FACE OF CURB
- FL. - FLOWLINE
- FT. - FEET
- FND. - FOUND
- G. - GAS
- H.W. - HIGH WATER
- LFB. - LOW FLOW BLOCKED
- M.H. - MANHOLE
- N/F. - NOW OR FORMERLY
- PL. - PLAT BOOK
- PG. - PAGE
- PR. - PROPOSED
- P.V.C. - POLYVINYL CHLORIDE PIPE
- R.C.P. - REINFORCED CONCRETE PIPE
- R/W. - RIGHT-OF-WAY
- SQ. - SQUARE
- T. - TELEPHONE CABLE
- T.B.A. - TO BE ABANDONED
- T.B.R. - TO BE REMOVED
- T.B.R.&R. - TO BE REMOVED AND REPLACED
- TYP. - TYPICALLY
- U.I.P. - USE IN PLACE
- U.O.N. - UNLESS OTHERWISE NOTED
- V.C.P. - VITRIFIED CLAY PIPE
- W. - WATER
- (86'W) - RIGHT-OF-WAY WIDTH

**LEGEND**

- EXISTING SANITARY SEWER
- EXISTING STORM SEWER
- EXISTING TREE
- EXISTING BUILDING
- EXISTING CONTOUR
- SPOT ELEVATION
- EXISTING UTILITIES
- FOUND 1/2" IRON PIPE
- SET IRON PIPE
- FOUND CROSS
- FOUND STONE
- FIRE HYDRANT
- LIGHT STANDARD
- BUSH
- SIGN
- NOTES PARKING SPACES
- GUY WIRE
- POWER POLE
- WATER VALVE
- DENOTES RECORD INFORMATION
- HANDICAPPED PARKING
- PROPOSED CONTOUR
- PROPOSED SPOT
- PROPOSED STORM
- PROPOSED SANITARY

**DISCLAIMER:**  
STOCK AND ASSOCIATES CONSULTING ENGINEERS, INC. AND THE UNDERSIGNED ENGINEER HAVE NO RESPONSIBILITY FOR SERVICES PROVIDED BY OTHERS TO IMPLEMENT THE IMPROVEMENTS SHOWN ON THIS PLAN AND ALL OTHER DRAWINGS WHERE THE UNDERSIGNED ENGINEER'S SEAL APPEARS. THE CONSTRUCTION MEANS AND METHODS ARE THE SOLE RESPONSIBILITY OF THE OWNER AND CONTRACTOR. STOCK AND ASSOCIATES CONSULTING ENGINEERS, INC. HAS NO RESPONSIBILITY TO VERIFY FINAL IMPROVEMENTS AS SHOWN ON THIS PLAN UNLESS SPECIFICALLY ENGAGED AND AUTHORIZED TO DO SO BY THE OWNER OR CONTRACTOR.

**UTILITY NOTE:**  
UNDERGROUND FACILITIES, STRUCTURES AND UTILITIES HAVE BEEN PLOTTED FROM AVAILABLE SURVEYS, RECORDS AND INFORMATION, AND, THEREFORE DO NOT NECESSARILY REFLECT THE ACTUAL EXISTENCE, NON-EXISTENCE, SIZE, TYPE, NUMBER, OR LOCATION OF THESE FACILITIES, STRUCTURES AND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ACTUAL LOCATION OF ALL UNDERGROUND FACILITIES, STRUCTURES, AND UTILITIES, EITHER SHOWN OR NOT SHOWN ON THESE PLANS. THE UNDERGROUND FACILITIES, STRUCTURES, AND UTILITIES SHALL BE LOCATED IN THE FIELD PRIOR TO ANY GRADING, EXCAVATION OR CONSTRUCTION OF IMPROVEMENTS. THESE PROVISIONS SHALL IN NO WAY ABSOLVE ANY PARTY FROM COMPLYING WITH THE UNDERGROUND FACILITY SAFETY AND DAMAGE PREVENTION ACT, CHAPTER 319 RSMo.

TSG CHESTERFIELD AIRPORT ROAD, LLC, the owner of the property shown on this plan for and in consideration of being granted a permit to develop property under the provisions of Chapter (applicable subsection) "PC" - Planned Commercial of the City of Chesterfield

Ordinance No. \_\_\_\_\_ do hereby agree and declare that said property from the date of recording this plan shall be developed only as shown thereon, unless said plan is amended by the Planning Commission, or voided or vacated by order of ordinance of the City of Chesterfield Council.

by: \_\_\_\_\_

STATE OF MISSOURI } SS.  
COUNTY OF ST. LOUIS }

On this \_\_\_\_\_ day of \_\_\_\_\_, 2019, before me personally appeared \_\_\_\_\_, who being by me duly sworn, did say he is the \_\_\_\_\_ and that said instrument was signed on behalf of said limited liability company, and that said \_\_\_\_\_ acknowledged said instrument to be the free act and deed of said limited liability company.

IN WITNESS WHEREOF, I have signed and sealed the foregoing the day and year first above written.

\_\_\_\_\_  
Notary Public


\_\_\_\_\_  
Print Name

My commission expires: \_\_\_\_\_

This Site Development Concept Plan was approved by the City of Chesterfield Planning Commission and duly verified on the \_\_\_\_\_ day of \_\_\_\_\_, 2019, by the Chairperson of said Commission, authorizing the recording of this Amended Site Development Section Plan pursuant to Chesterfield Ordinance No. 200, as attested to by the Director of Planning and Development Services and the City Clerk.



By: Justin Wyse, Director of Planning and Development Services

By: Vickie McGownd, City Clerk

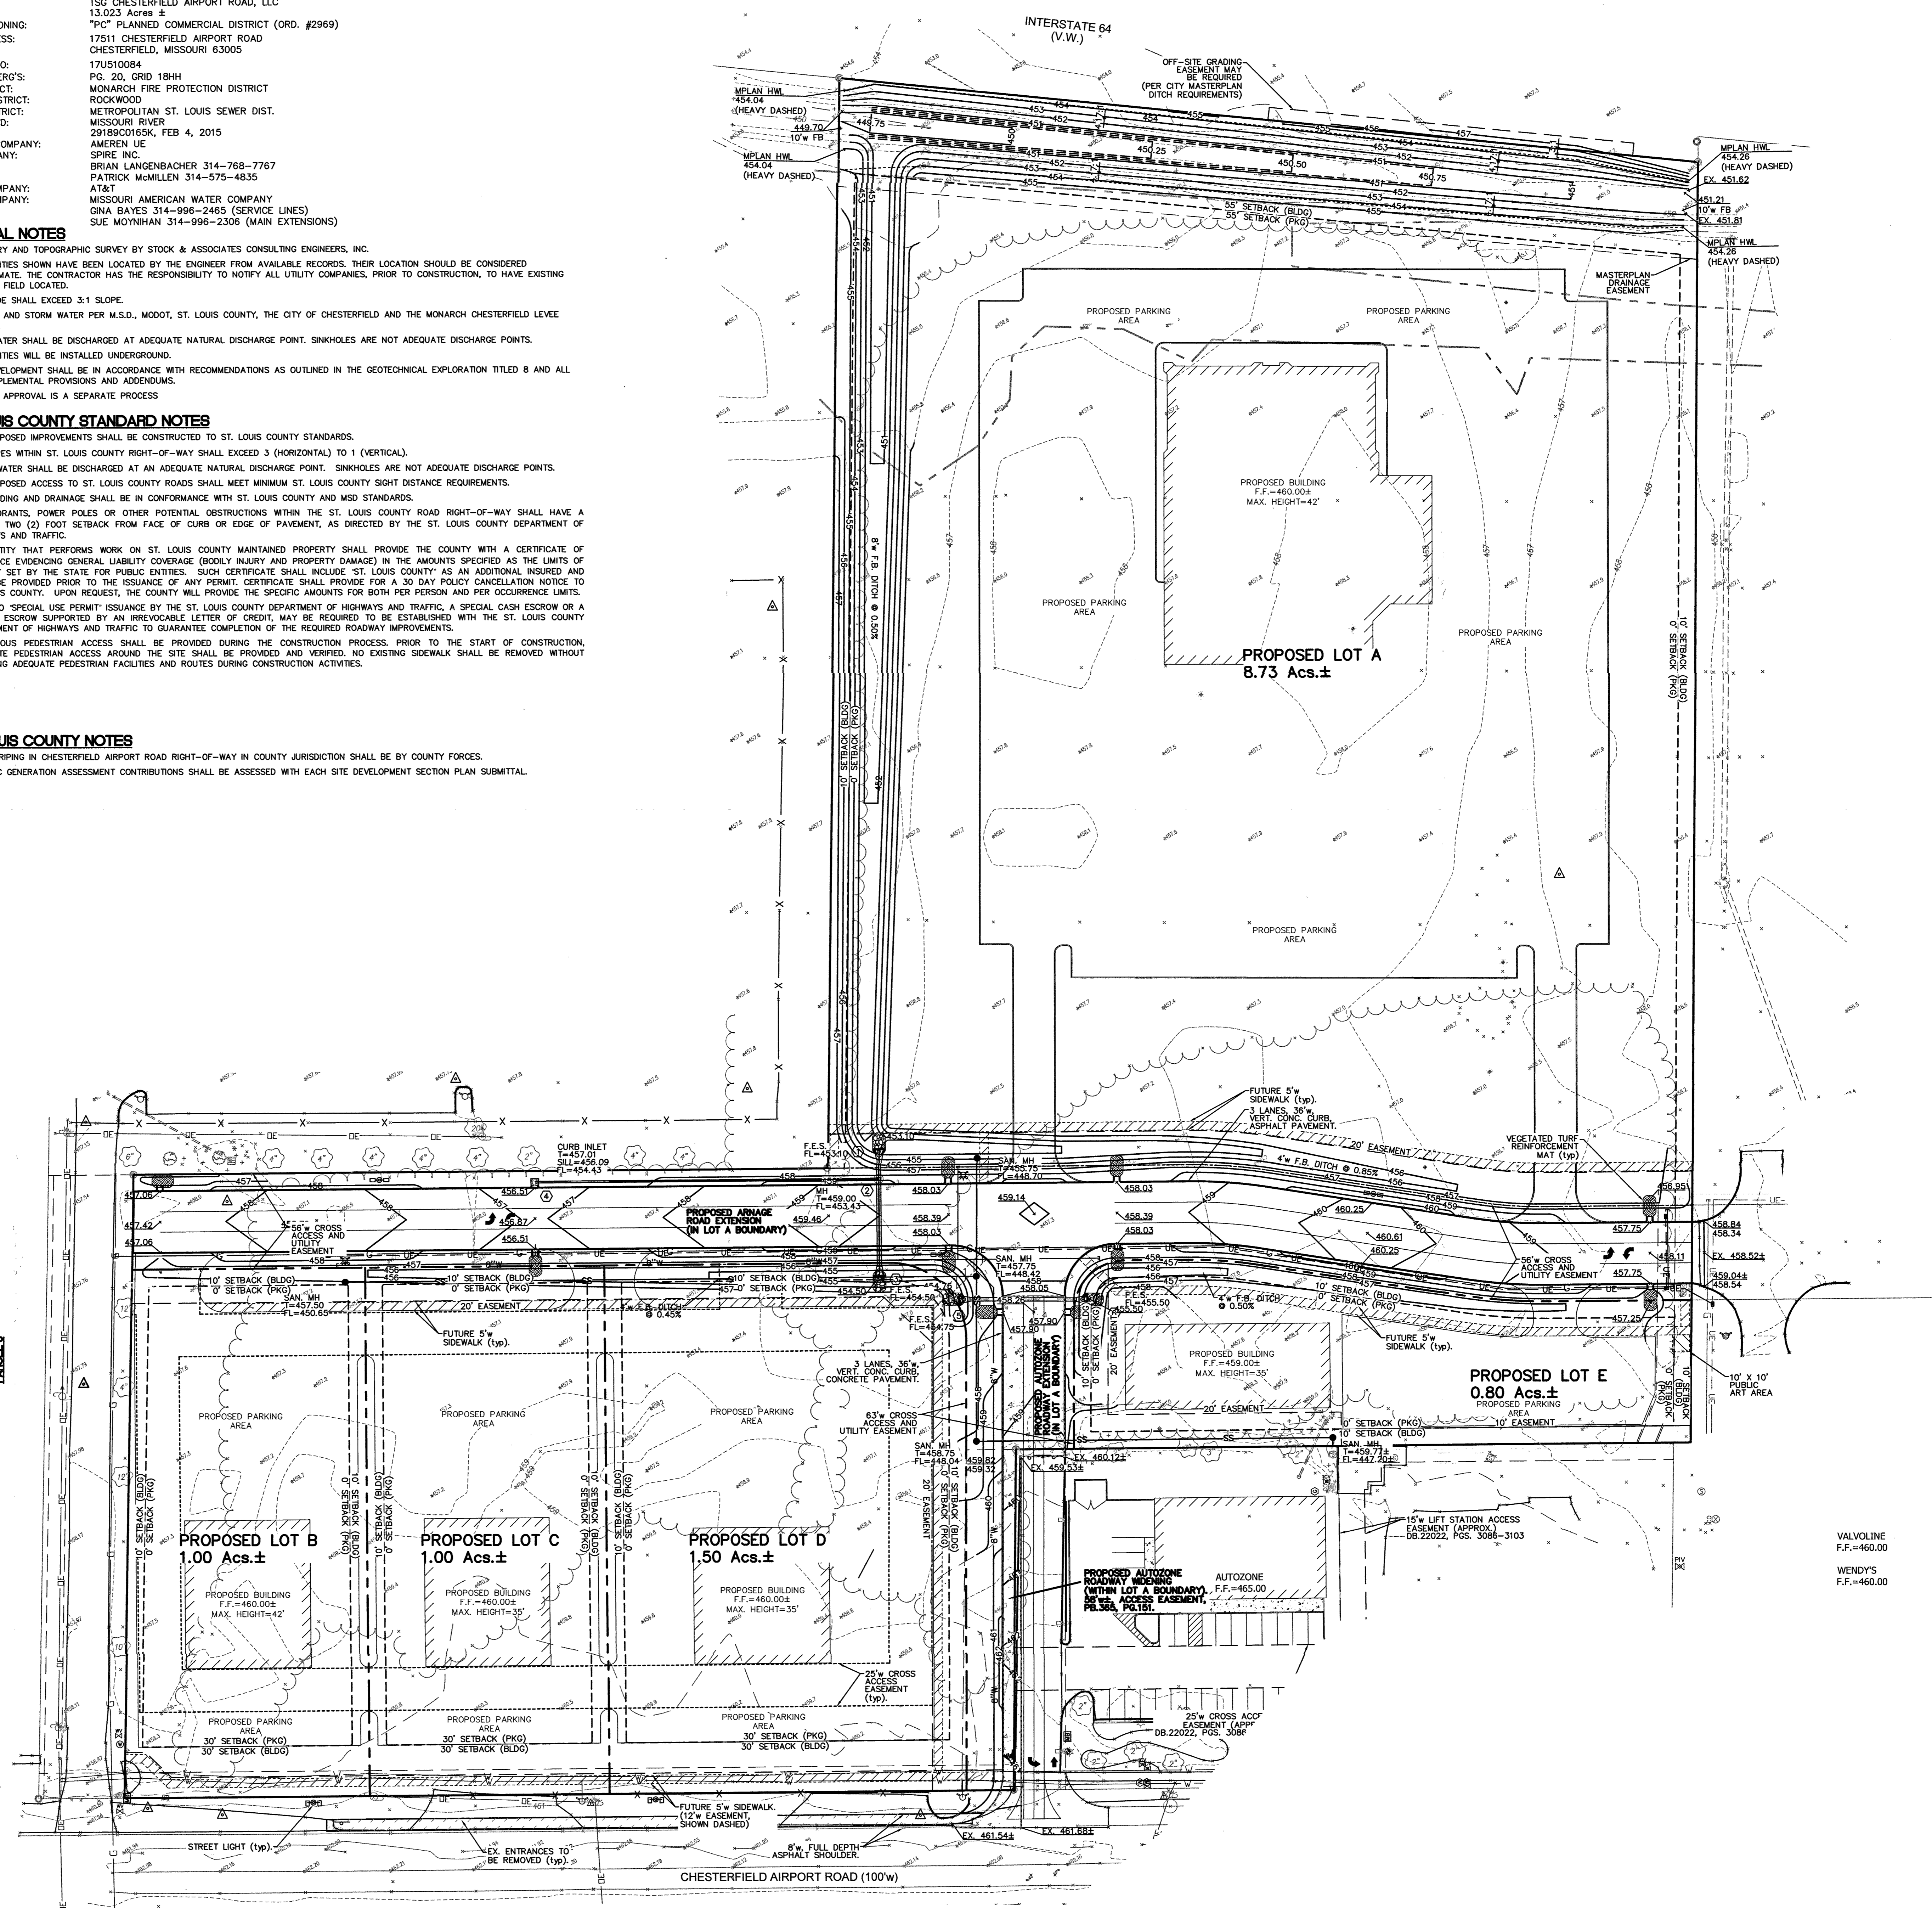


VALVOLINE  
F.F.=460.00

WENDY'S  
F.F.=460.00

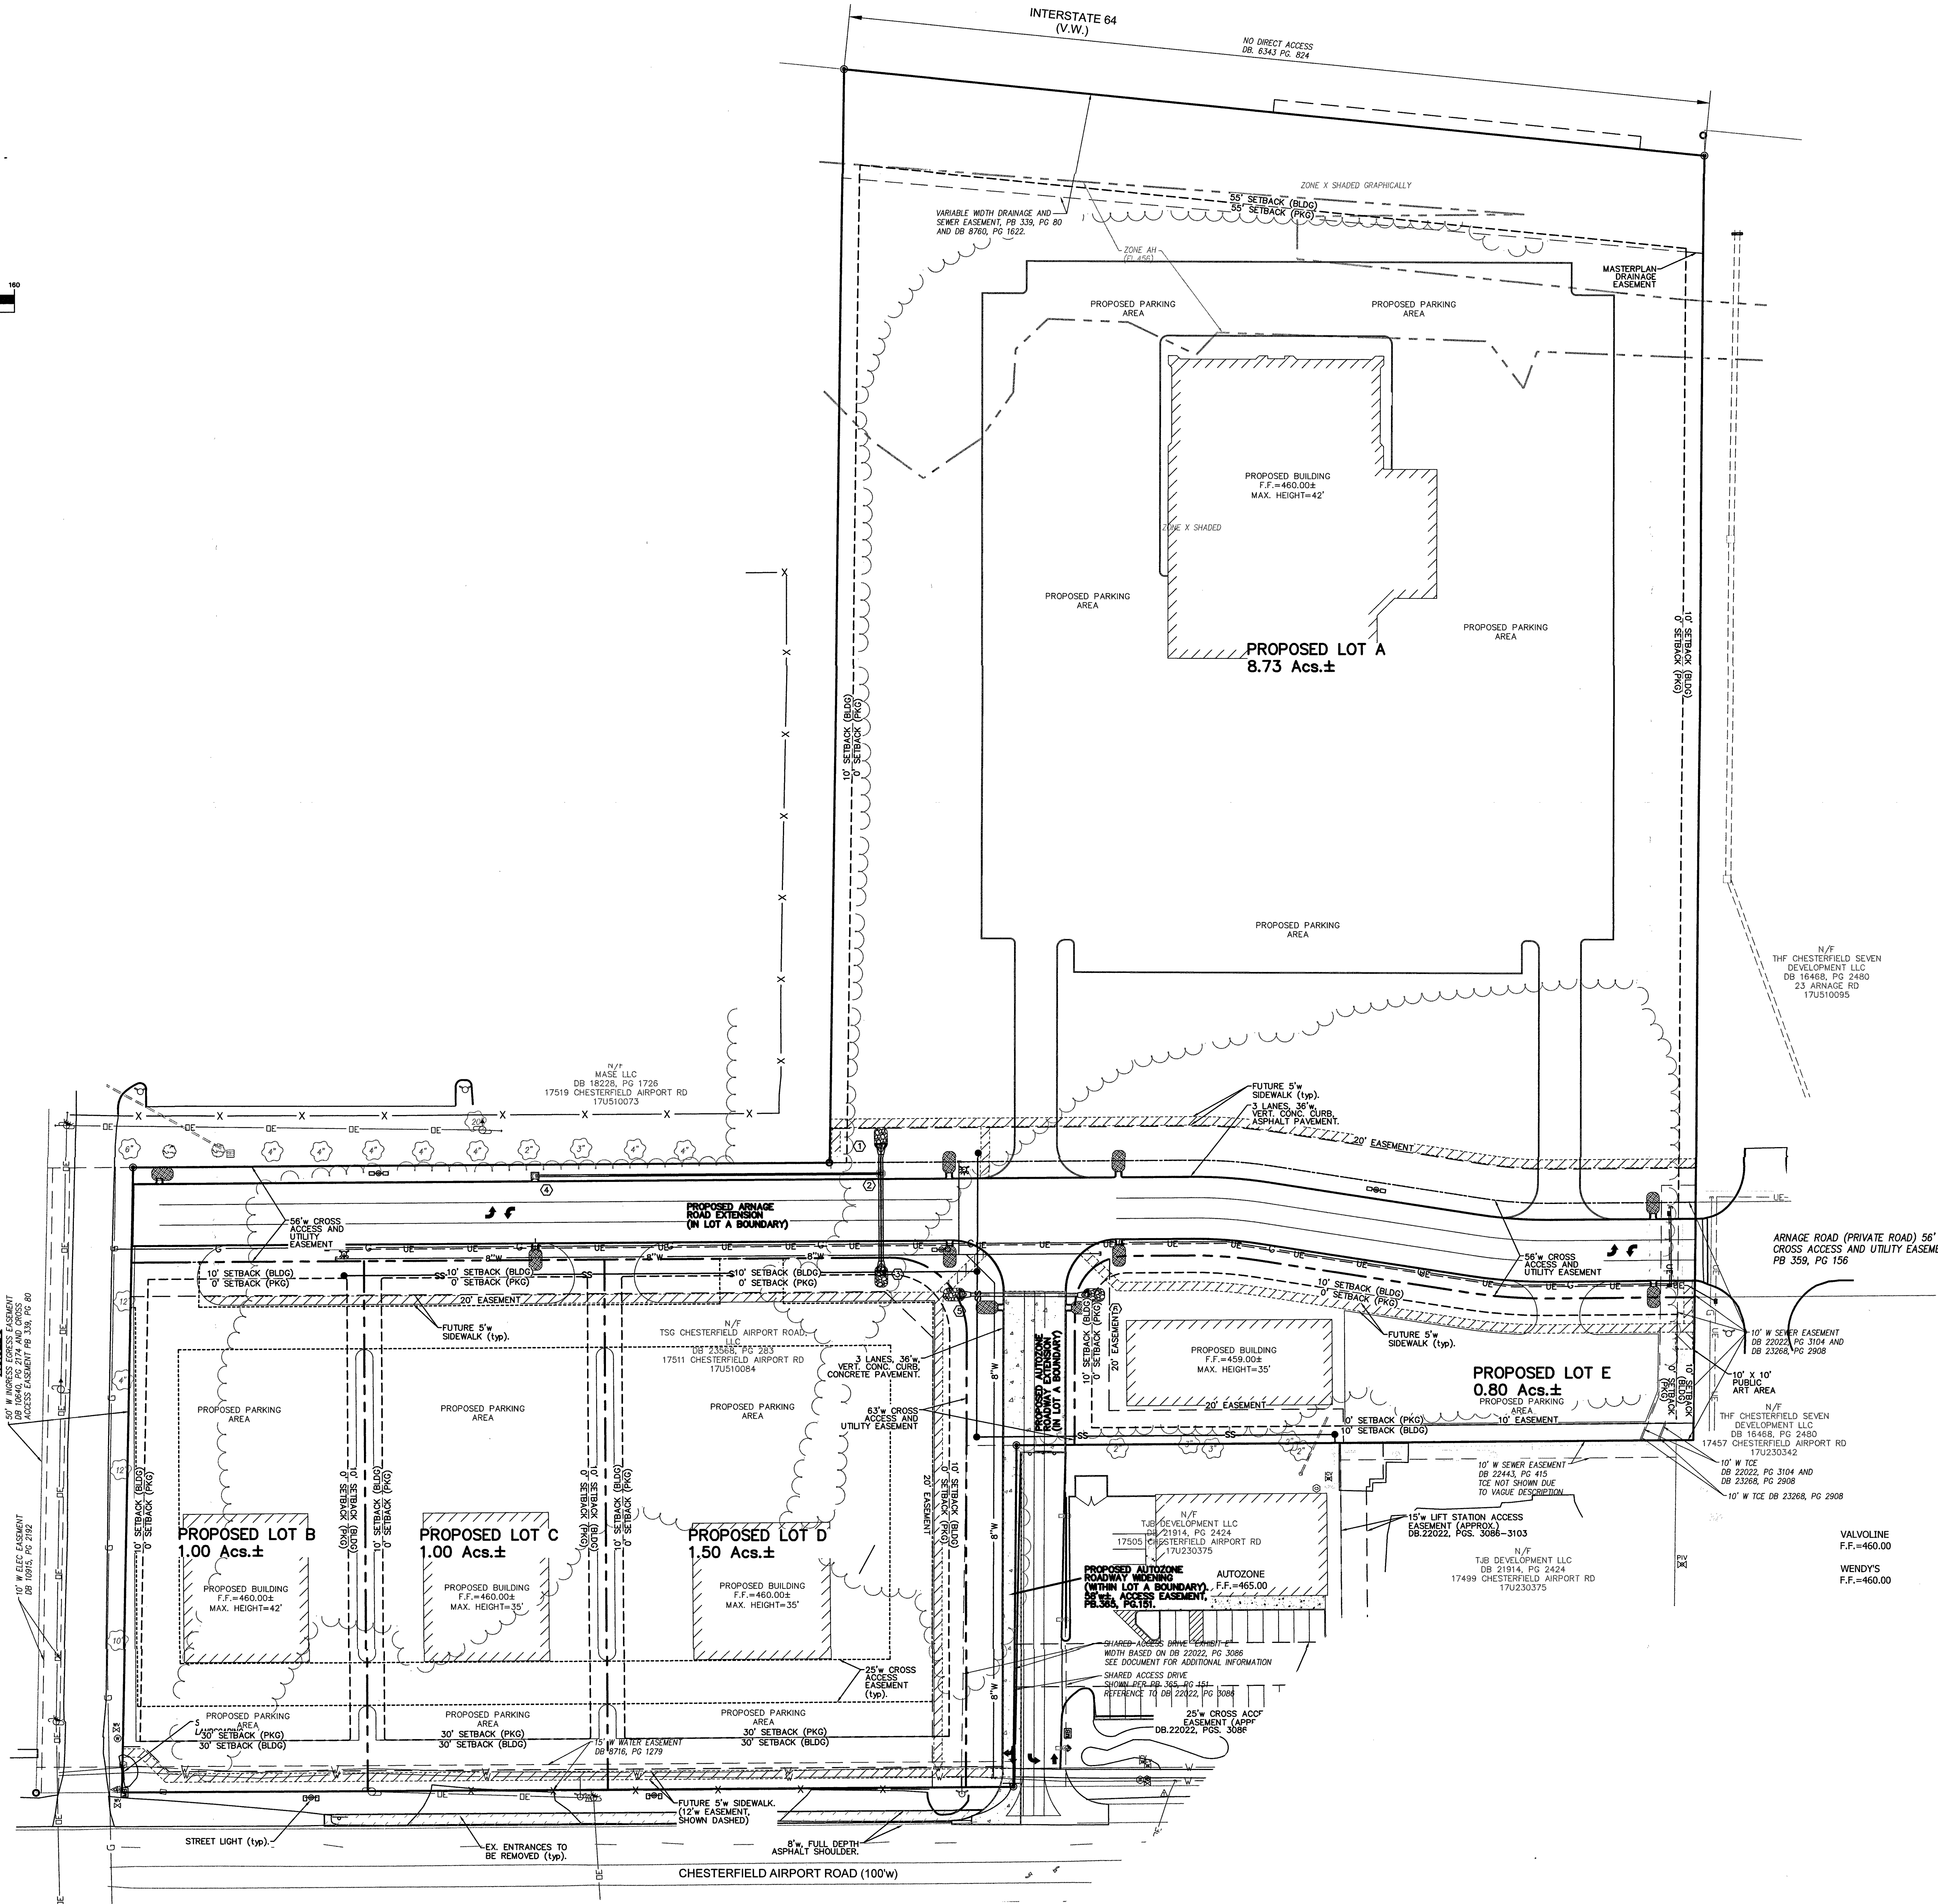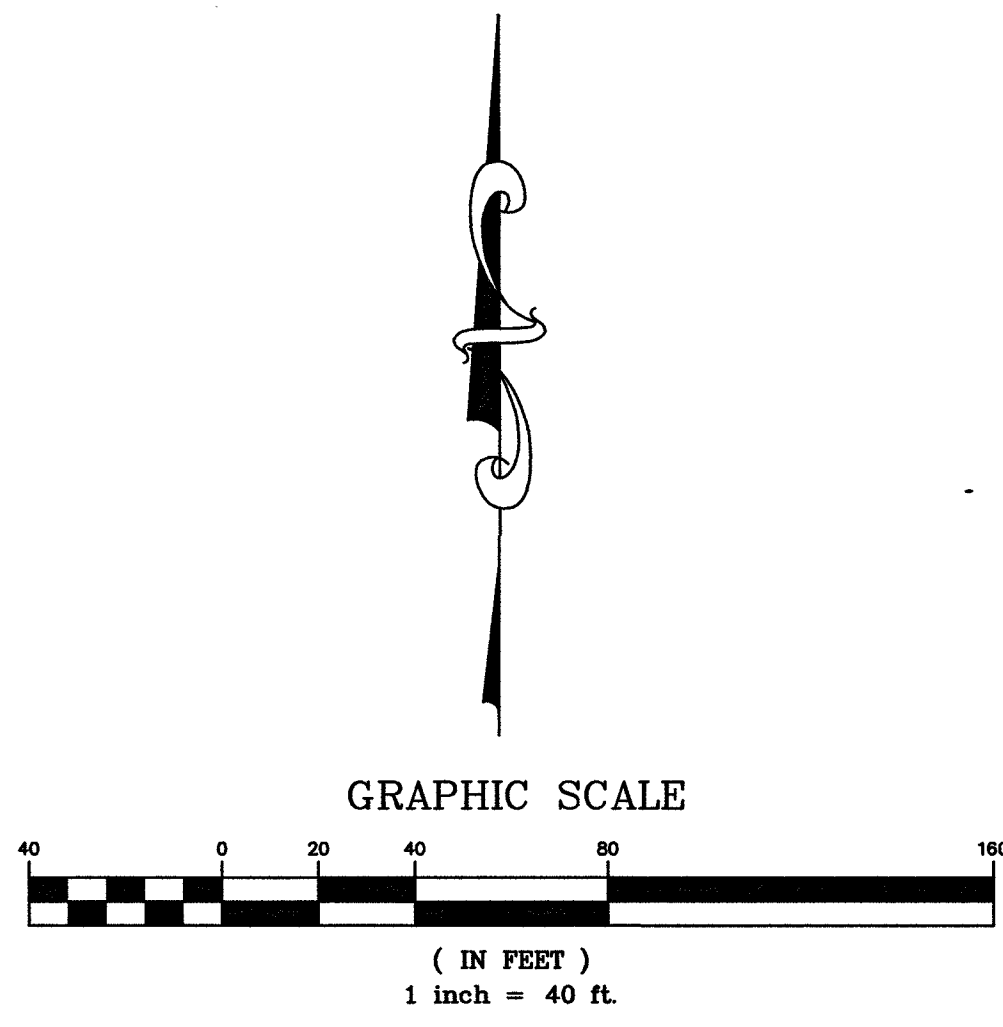


PREPARED BY:  
**STOCK & ASSOCIATES**  
 Consulting Engineers, Inc.  
 257 Chesterfield Business Parkway  
 Chesterfield, MO 63005  
 Phone: (636) 530-1800 FAX: (636) 530-1800  
 e-mail: general@stockassoc.com  
 Web: www.stockassoc.com

A SITE DEVELOPMENT CONCEPT PLAN FOR:  
**ADJUSTED LOT 2 - 84 LUMBER SUBDIVISION**  
 17511 CHESTERFIELD AIRPORT ROAD  
 CITY OF CHESTERFIELD, MO 63005

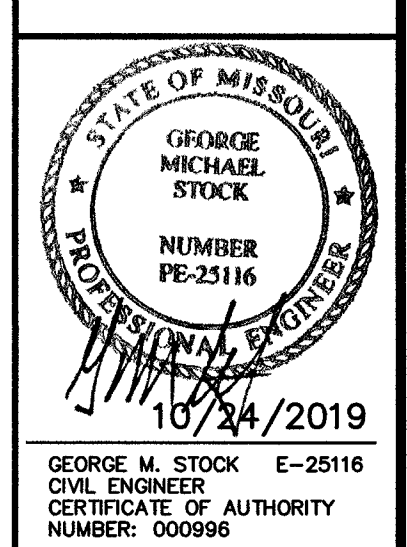


REVISIONS:  
 1 10/09/19 - CITY COMMENTS  
 2 10/24/19 - CITY COMMENTS


DRAWN BY: J.P.W. CHECKED BY: G.M.S.  
 DATE: 09/08/2019 JOB NO: 218-6407.2  
 M.S.D. P.F. BASE MAP: 17U  
 S.L.C. MAT # MAT SUP. #  
 W.D.N.A. #  
 SHEET TITLE: SITE DEVELOPMENT CONCEPT PLAN - EXISTING AND PROPOSED SETBACKS, ACCESS AND UTILITY EASEMENTS  
 SHEET NO.: SDCP-3

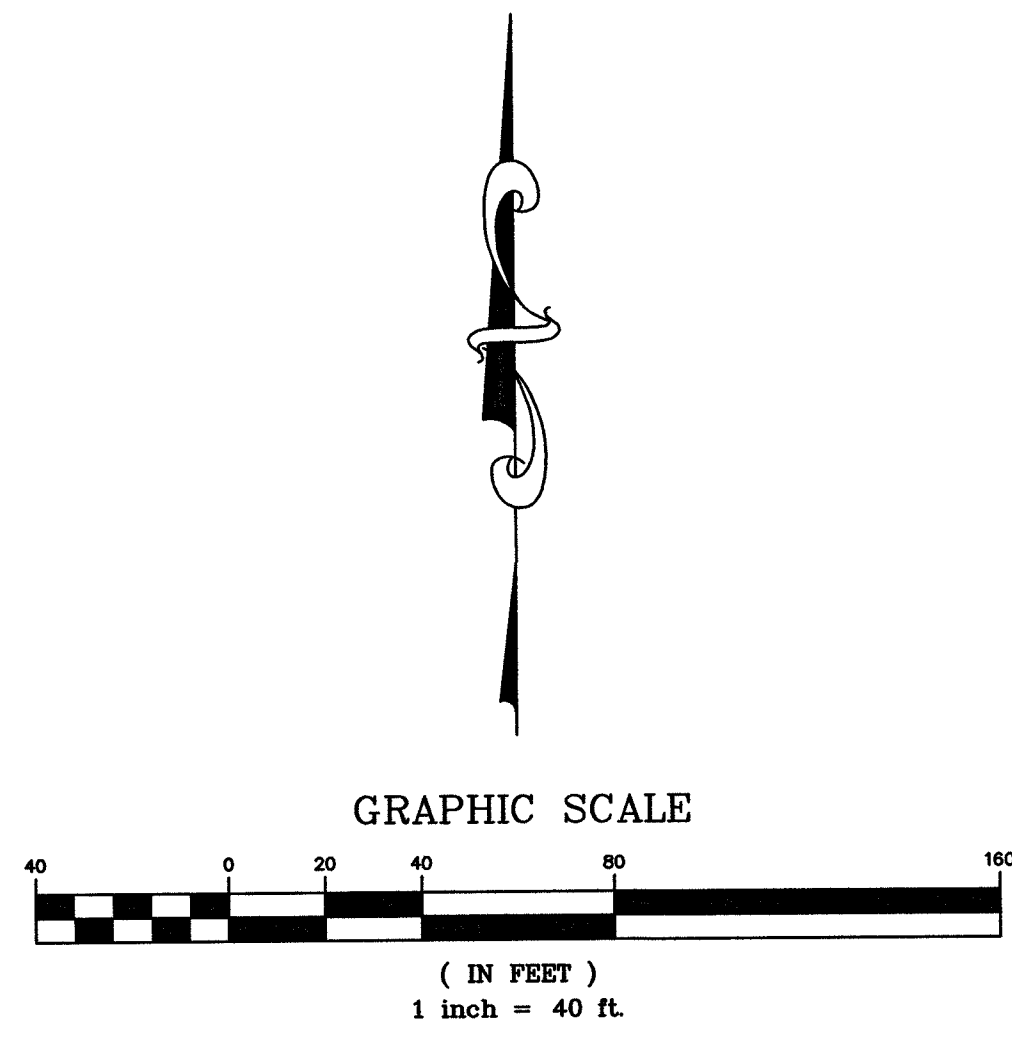

ABBREVIATIONS		LEGEND	
ATG	- ADJUST TO GRADE	EXISTING SANITARY SEWER	==
B.C.	- BACK OF CURB	EXISTING STORM SEWER	==
C.O.	- CLEANOUT	EXISTING TREE	---
DB.	- DEED BOOK	EXISTING BUILDING	---
E	- ELECTRIC	EXISTING CONTOUR	---
ELEV.	- ELEVATION	EXISTING SPOT ELEVATION	•
EX.	- EXISTING	EXISTING UTILITIES	---
F.C.	- FACE OF CURB	FOUND 1/2" IRON PIPE	○
FL.	- FLOWLINE	SET IRON PIPE	○
FT.	- FEET	FOUND CROSS	+
FND.	- FOUND	FOUND STONE	+
G	- GAS	FIRE HYDRANT	+
H.W.	- HIGH WATER	LIGHT STANDARD	+
LFB	- LOW FLOW BLOCKED	BUSH	+
M.H.	- MANHOLE	SIGN	+
N/F	- NOW OR FORMERLY	NOTES PARKING SPACES	+
PL.	- PLAT BOOK	GUY WIRE	+
PS.	- PAGE	POWER POLE	+
PR.	- PROPOSED	WATER VALVE	+
P.V.C.	- POLYVINYL CHLORIDE PIPE	DENOTES RECORD INFORMATION	+
R.C.P.	- REINFORCED CONCRETE PIPE	HANDICAPPED PARKING	+
R/W	- RIGHT-OF-WAY	PROPOSED CONTOUR	---
SQ.	- SQUARE	PROPOSED SPOT	•
T	- TELEPHONE CABLE	PROPOSED STORM	---
T.B.A.	- TO BE ABANDONED	PROPOSED SANITARY	---
T.B.R.	- TO BE REMOVED		
T.B.R.&R.	- TO BE REMOVED AND REPLACED		
TYP.	- TYPICALLY		
U.I.P.	- USE IN PLACE		
U.O.N.	- UNLESS OTHERWISE NOTED		
V.C.P.	- VITRIFIED CLAY PIPE		
W	- WATER		
(86'W)	- RIGHT-OF-WAY WIDTH		

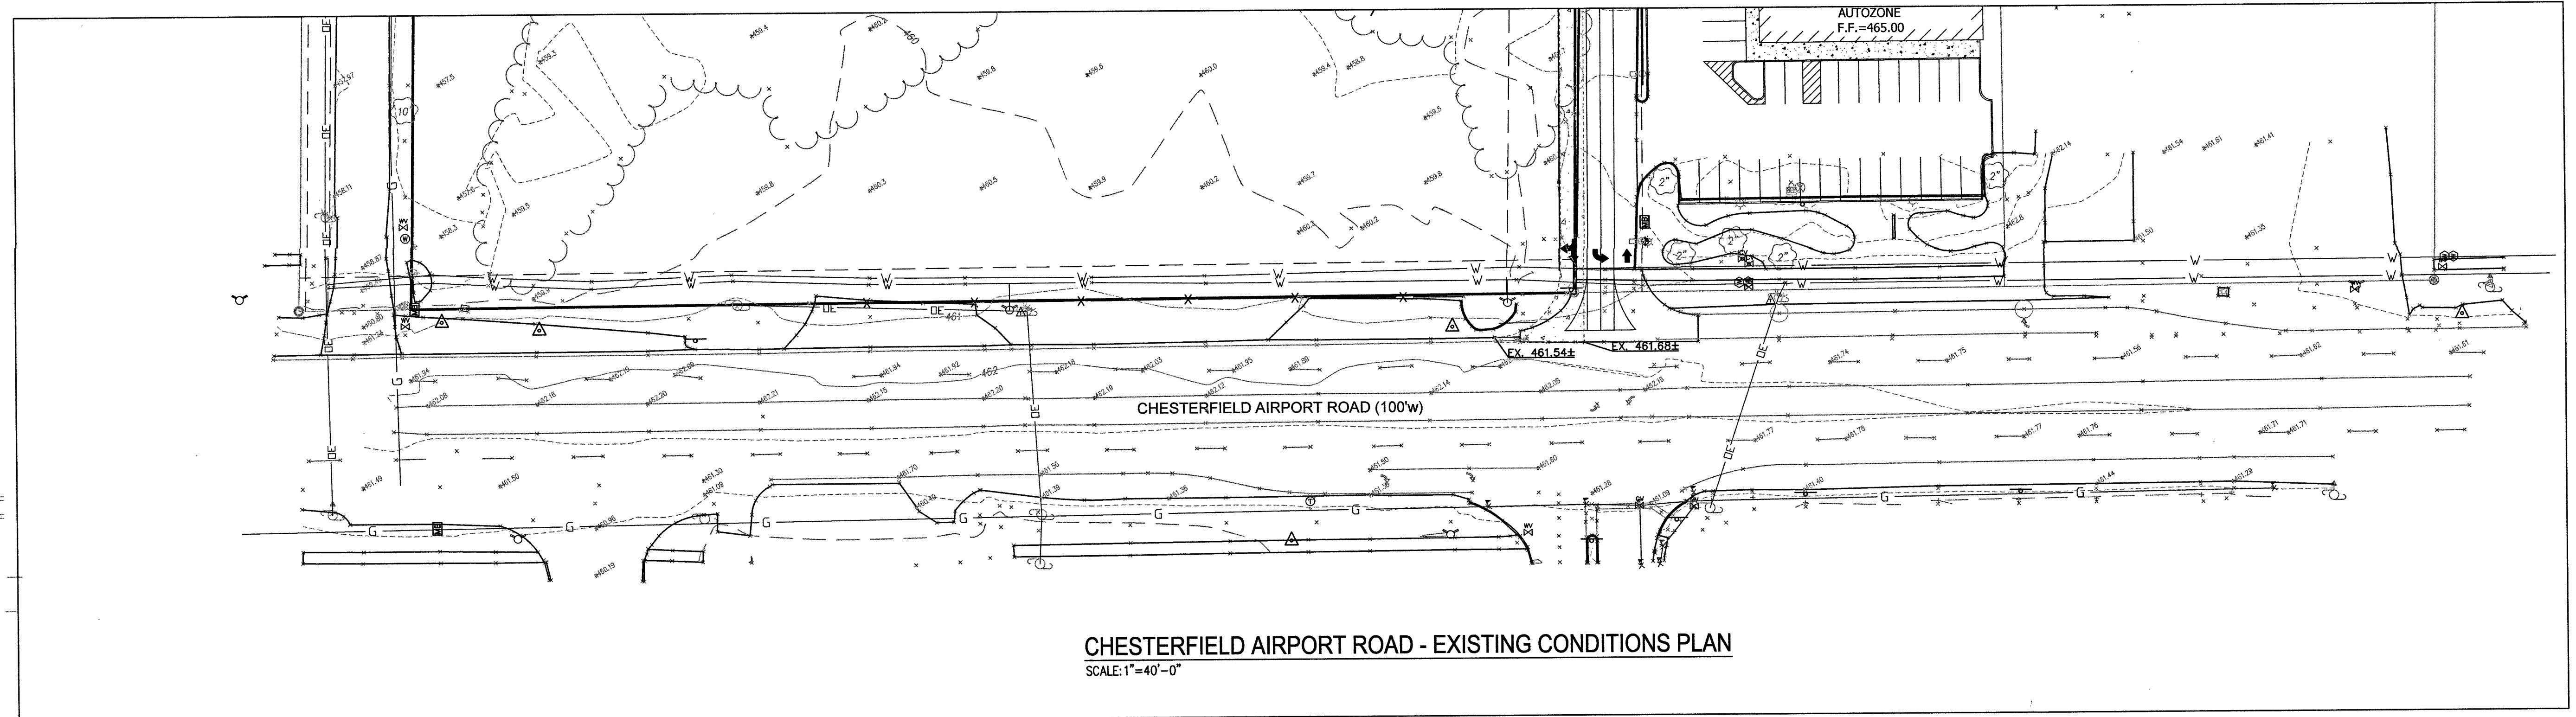


CHESTERFIELD AIRPORT ROAD - EXISTING CONDITIONS PLAN  
SCALE: 1"=40'-0"

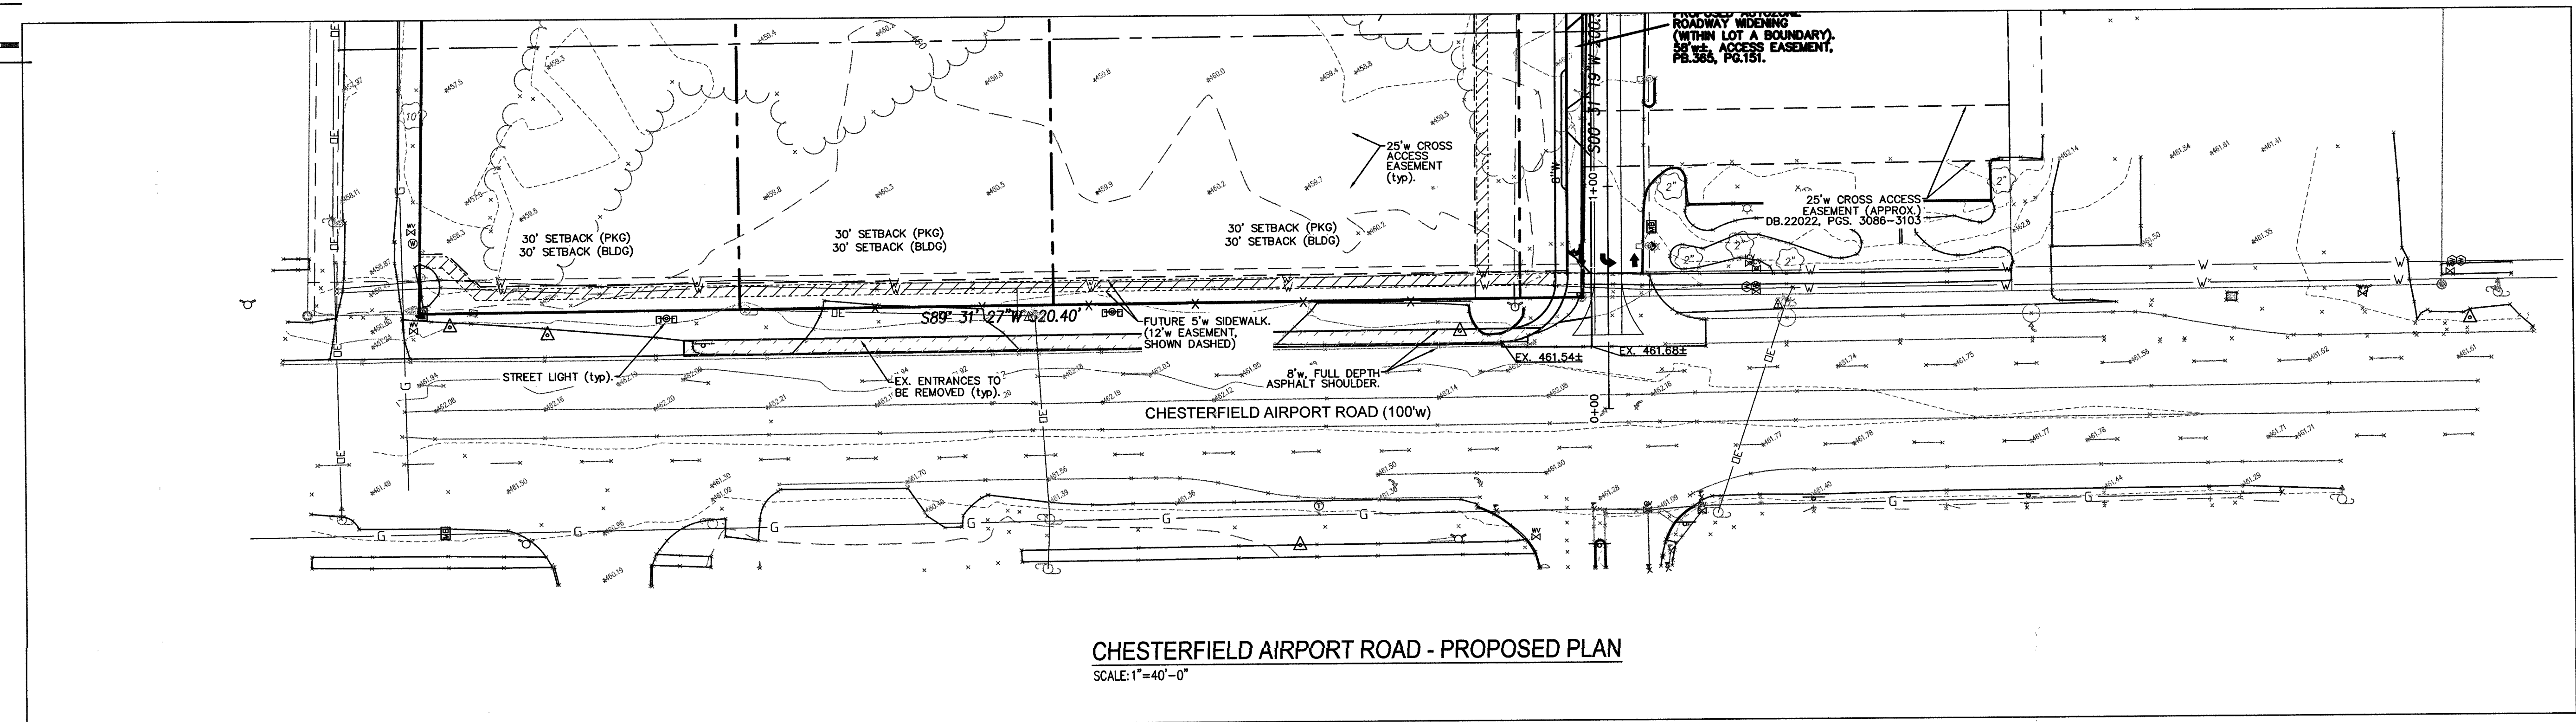

CHESTERFIELD AIRPORT ROAD - PROPOSED PLAN  
SCALE: 1"=40'-0"

PREPARED BY:  
**STOCK & ASSOCIATES**  
Consulting Engineers, Inc.  
257 Chesterfield Business Parkway  
St. Louis, MO 63015 PH: (636) 530-9100 FAX: (636) 530-8100  
e-mail: general@stockandassociates.com  
Web: www.stockandassociates.com

A SITE DEVELOPMENT CONCEPT PLAN FOR:  
**ADJUSTED LOT 2 - 84 LUMBER SUBDIVISION**  
17511 CHESTERFIELD AIRPORT ROAD  
CITY OF CHESTERFIELD, MO 63005

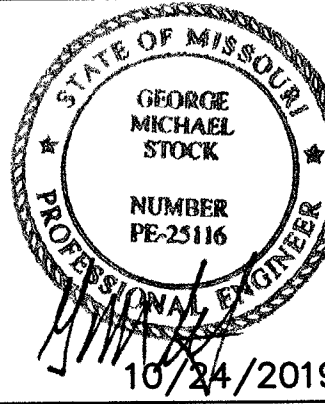

GEORGE M. STOCK E-25116  
CIVIL ENGINEER  
CERTIFICATE OF AUTHORITY  
NUMBER: 000996

REVISIONS:

1	10/09/19	- CITY COMMENTS
2	10/24/19	- CITY COMMENTS

DRAWN BY: J.P.W.	CHECKED BY: G.M.S.
DATE: 09/06/2019	JOB NO. #: 218-6407.2
M.S.D. P. #: -	BASE MAP #: 17U
S.L.C. H&T #: -	H&T SUP. #: -
M.D.A.R. #: -	


SHEET TITLE:  
CHESTERFIELD AIRPORT ROAD PLAN  
SHEET NO. #:  
SDCP-4



REVISIONS:

1	10/09/19 - CITY COMMENTS
2	10/24/19 - CITY COMMENTS

DRAWN BY: J.P.W.	CHECKED BY: G.M.S.
DATE: 09/05/2019	JOB NO. 218-6407.2
M.S.D. P.#	BASE MAP # 17U
S.L.C. HAT #	HAT SUX #
MDNR #	


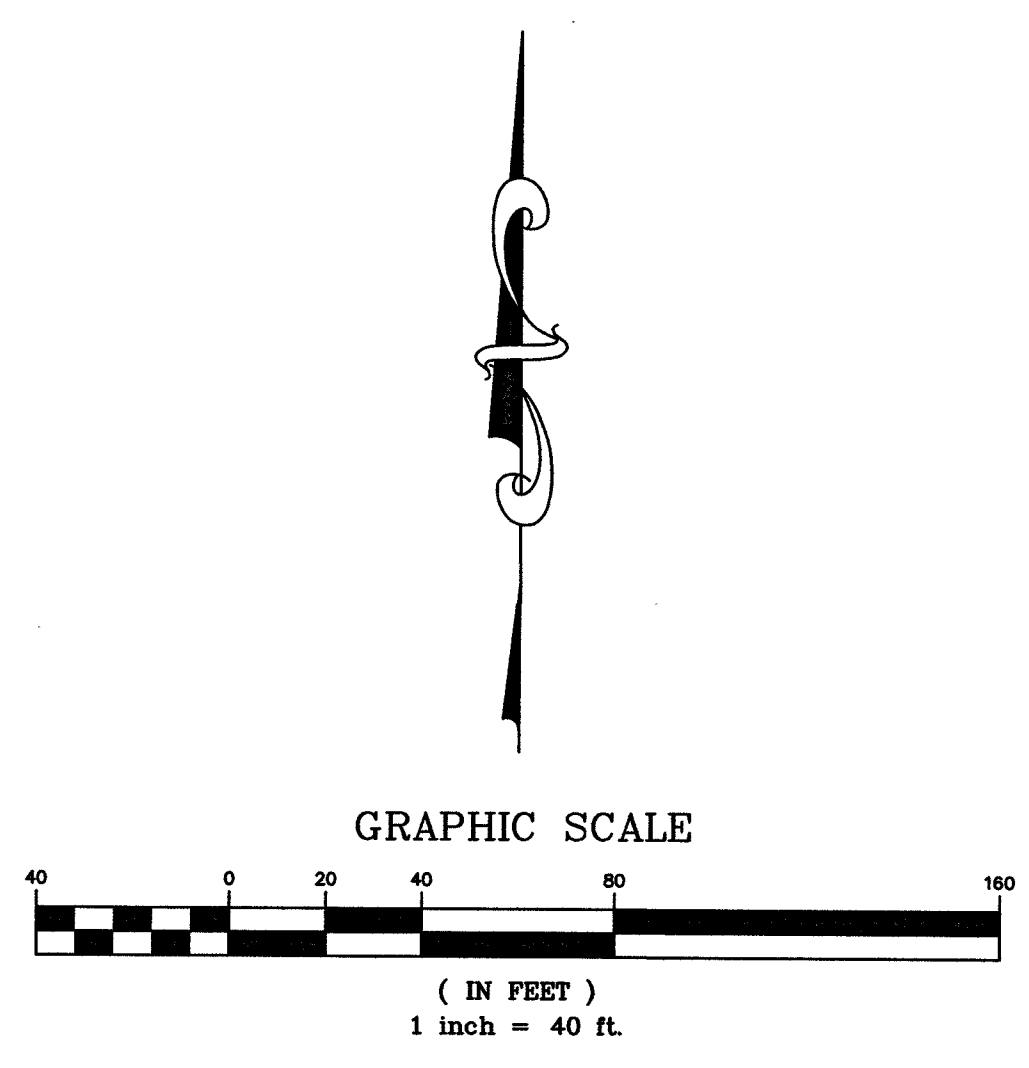


FIXTURES MOUNTED ON 25' POLE & 2.5' BASE  
 LIGHT LEVEL CALCULATED ON THE GROUND

Calculation Summary							
Label	Calc Type	Units	Avg	Max	Min	Avg/Min	Max/Min
CHESTERFIELD AIRPORT ROADWAY	Illuminance	Fc	1.20	7.9	0.0	N.A.	N.A.
	Illuminance	Fc	1.16	4.1	0.0	N.A.	N.A.

Luminaire Schedule							
Symbol	Qty	Label	Arrangement	LLF	Lum. Watts	Total Watts	Description
☐	3	F1	BACK-BACK	0.912	225	1350	GLEON-AF-04-LED-E1-5WQ
☐	2	F2	ROTATED OPTICS	0.912	166	664	GLEON-AF-03-LED-E1-T3R

DESIGN IS BASED ON CURRENT INFORMATION PROVIDED AT THE TIME OF REQUEST. ANY CHANGES IN MOUNTING HEIGHT OR LOCATION, LAMP WATTAGE, LAMP TYPE, AND EXISTING FIELD CONDITIONS THAT AFFECT ANY OF THE PREVIOUSLY MENTIONED, WILL VOID CURRENT LAYOUT AND REQUIRE A CHANGE REQUEST AND RE-CALCULATION.

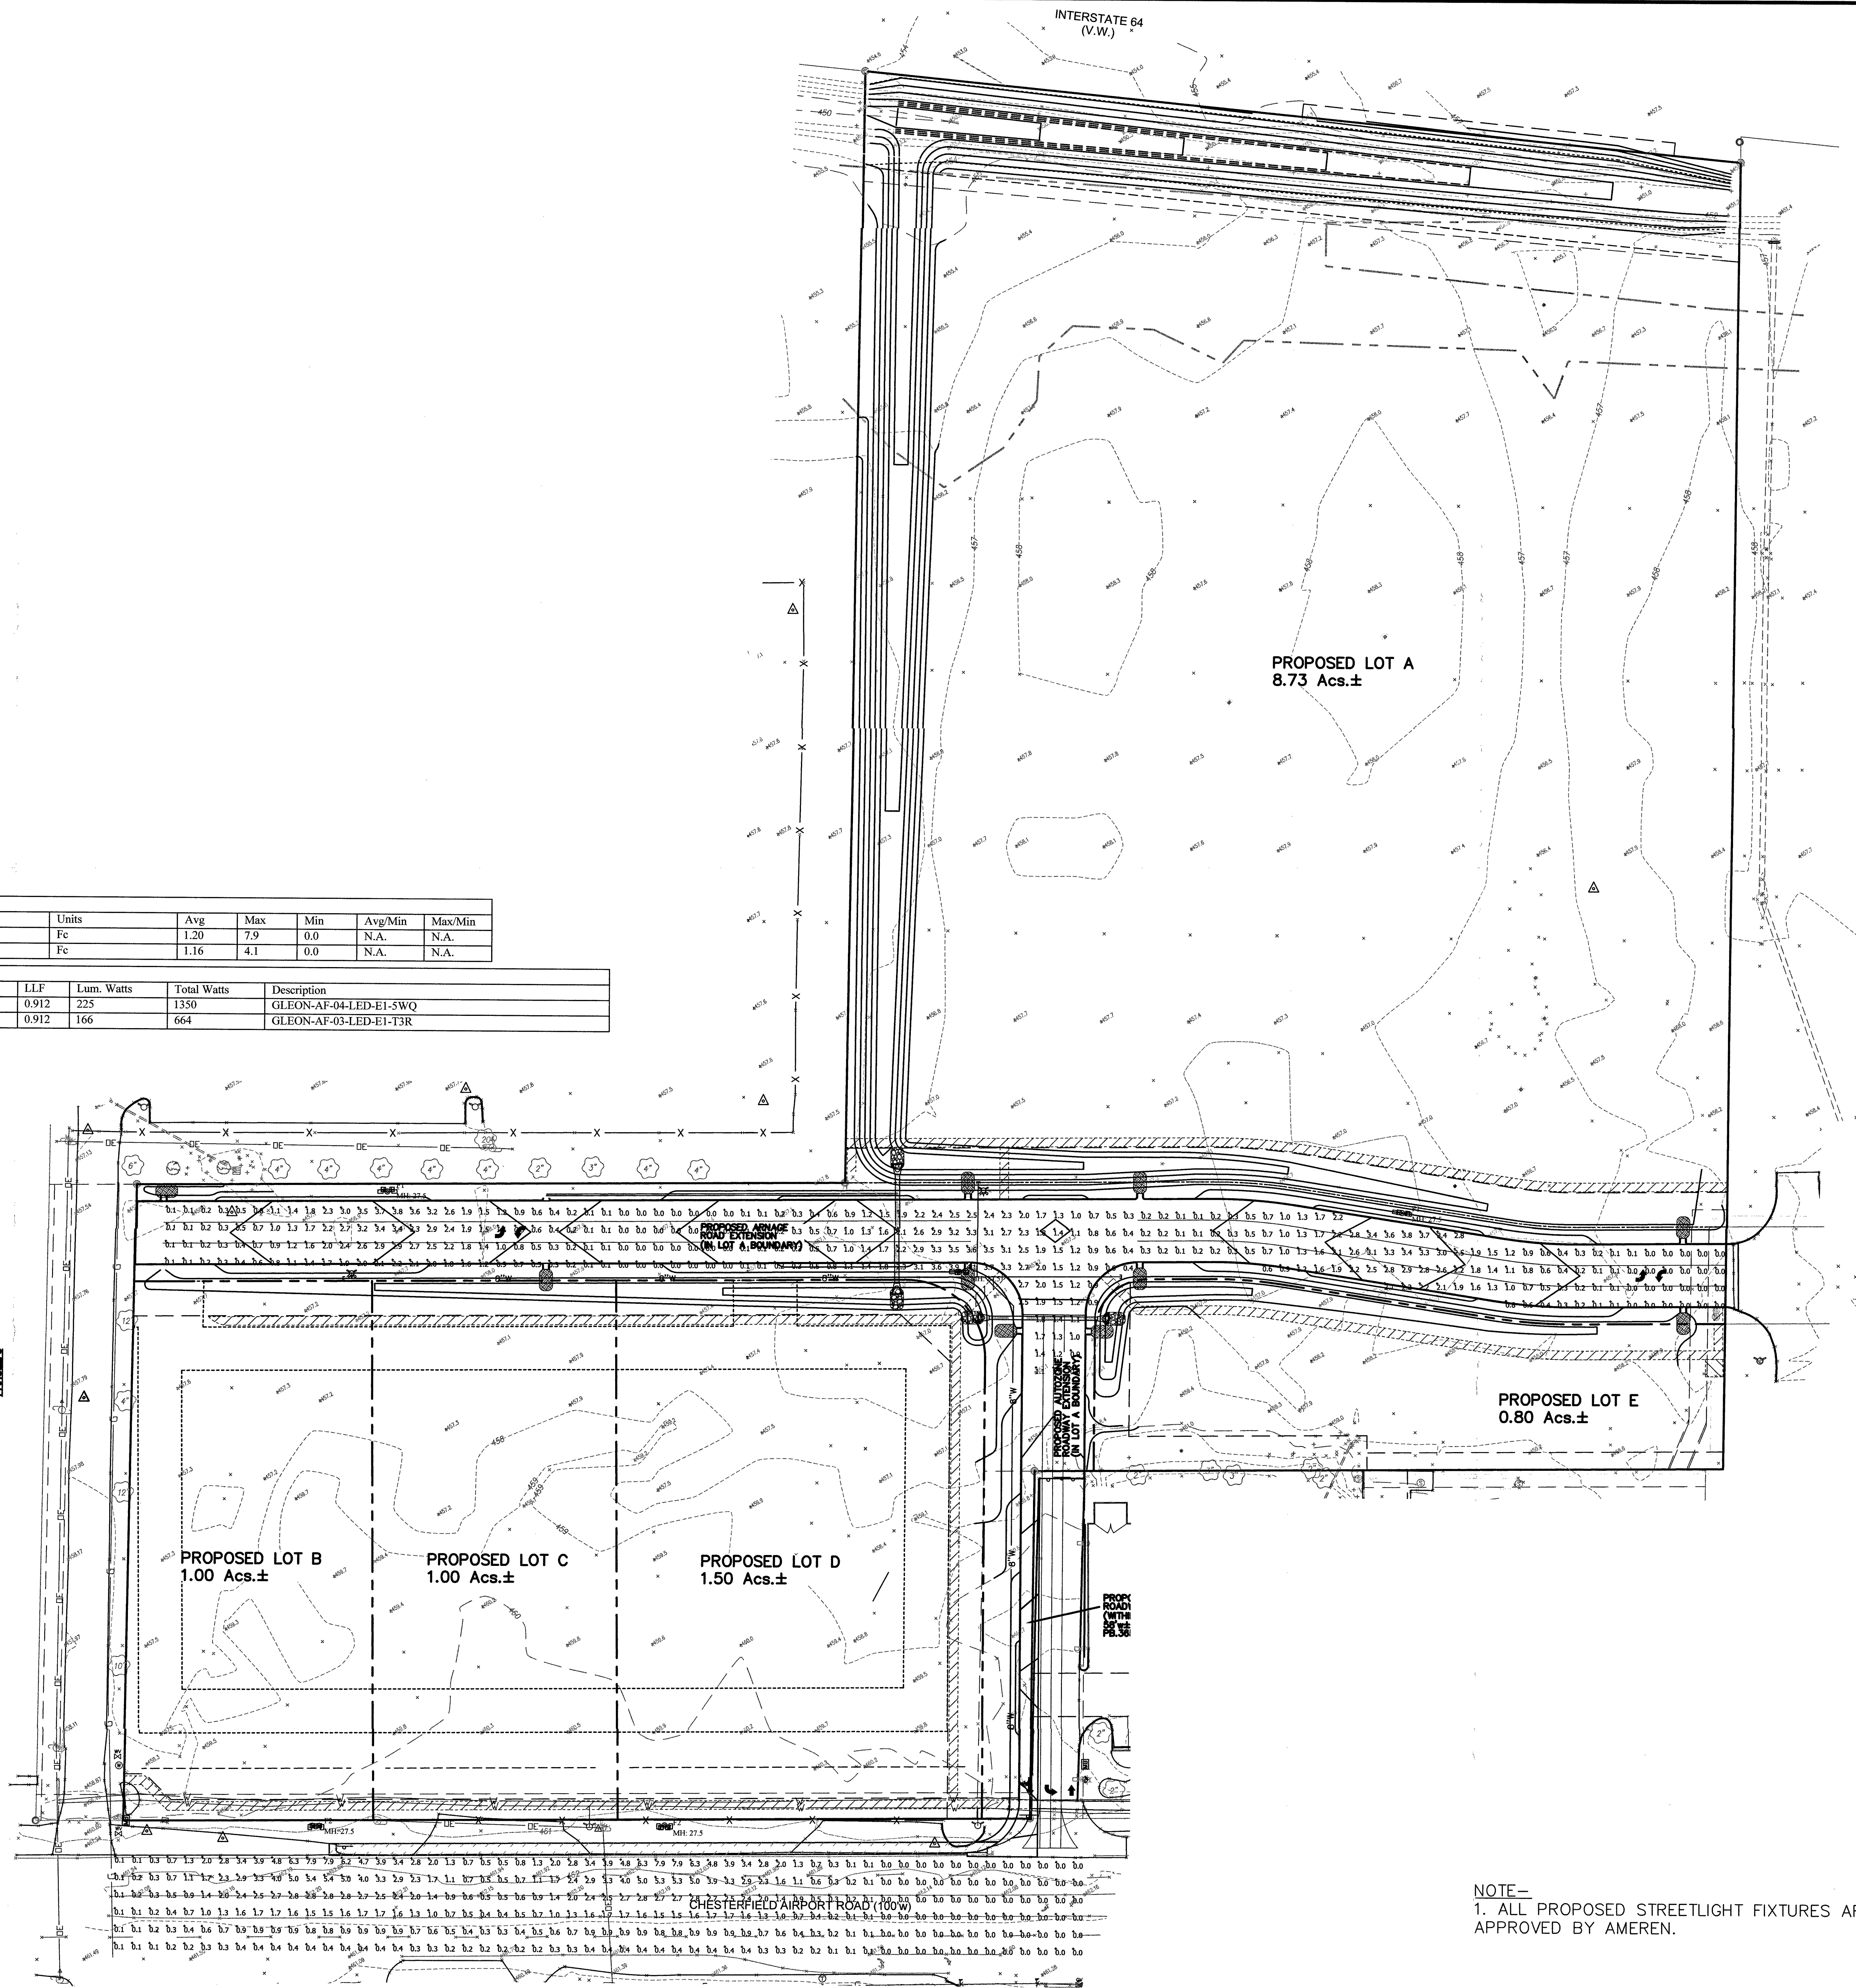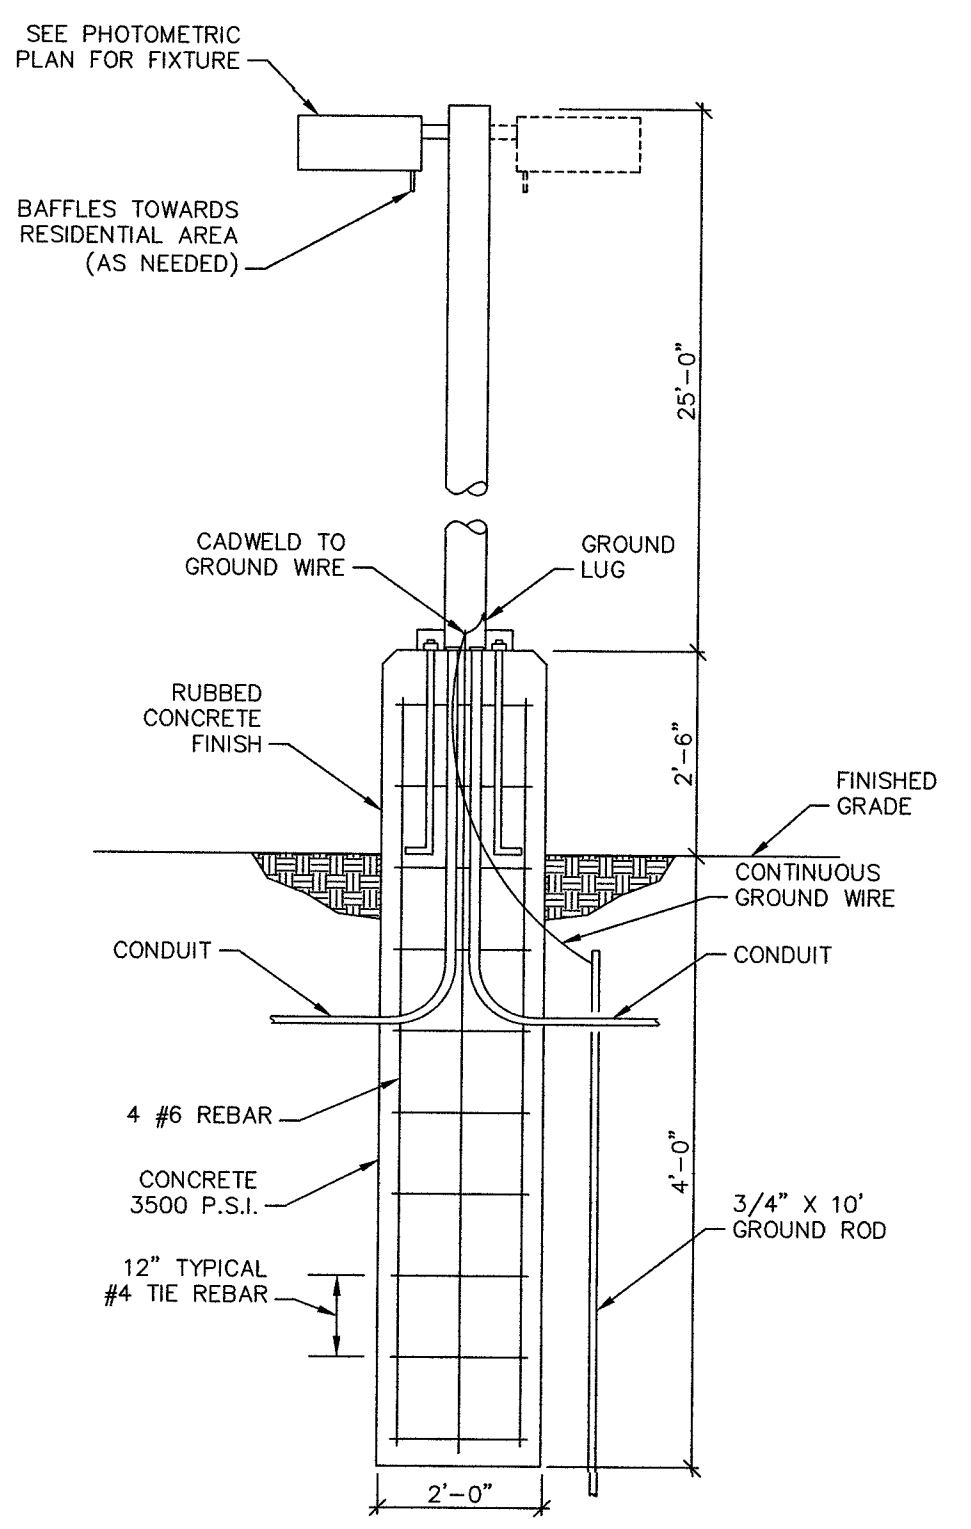

NOTE—  
 1. ALL PROPOSED STREETLIGHT FIXTURES ARE TO BE APPROVED BY AMEREN.

REVISIONS	BY
1/30/14	RMM
10/3/14	RMM
10/23/14	RMM

### LANDSCAPE GUIDELINE SPECS:

#### GENERAL:

- All natural vegetation shall be maintained where it does not interfere with construction or the permanent plan of operation. Every effort possible shall be made to protect existing structures or vegetation from damage due to equipment usage. Contractor shall at all times protect all materials and work against injury to public. The landscape contractor shall be responsible for any coordination and sequencing with other site related work being performed by other contractors. Refer to additional drawings for further coordination of work to be done.
- Underground facilities, structures and utilities must be considered approximate only. There may be others not presently known or shown. It shall be the landscape contractor's responsibility to determine or verify the existence of and exact location of the above. (Call utility location services in municipality).
- Plant material are to be planted in the same relationship to grade as was grown in nursery conditions. All planting beds shall be cultivated to 6" depth minimum and graded smooth immediately before planting of plants. Plant groundcover to within 12" of trunk of trees or shrubs planted within the area.
- It shall be the landscape contractor's responsibility to:
  - Verify all existing and proposed features shown on the drawings prior to commencement of work.
  - Report all discrepancies found with regard to existing conditions or proposed design to the landscape architect immediately for a decision.
  - Stake the locations of all proposed plant material and obtain the approval of the owner's representative or landscape architect ten (10) days prior to installation.
- Items shown on this drawing take precedence over the material list. It shall be the landscape contractor's responsibility to verify all quantities and conditions prior to implementation of this plan. No substitutions of types or size of plant materials will be accepted without written approval from the landscape architect.
- Provide site-specific trees otherwise noted in plant schedule.
- All plant material shall comply with the recommendations and requirements of ANSI Z60.1 "American Standards for Nursery Stock".
- It shall be the contractor's responsibility to provide for inspection of the plant material by the Landscape Architect (or Owner's Representative) prior to acceptance. Inspections may take place before, during or after installation. Plants not conforming exactly to the plant list will not be accepted and shall be replaced at the landscape contractor's expense.
- All bids are to have unit prices listed. The Owner has the option to delete any portion of the contract prior to signing the contract or beginning work. This will be a unit price contract; quotes shall be valid for 12 months.
- Should auger equipment be utilized in excavating any plant pits, vertical sides of plant pits shall be thoroughly scarified to avoid creation of "polished side walls" prior to plant material installation.
- All excess topsoil, rocks, debris and/or tainted soils shall be removed by the general contractor prior to signing the contract or beginning landscape contractor to commence landscape installation.
- Keep all plant material (except turf) a minimum of 36" clear of fire hydrants.
- Landscape contractor shall kill & remove all existing weeds within the project site.
- All tags, nursery stakes, labels, etc. shall be removed by the landscape contractor at completion of all landscape installation.
- Landscape contractor shall be in compliance with all federal, state and local laws / regulations relating to insect infestation and/or plant diseases.
- All substitutions of plant material shall be submitted to landscape architect for approval.

#### PRUNING:

- Lightly prune trees at time of planting. Prune only the crossover limbs, intermingled leaders and/or any broken branches. Some interior twigs and lateral branches may be pruned. However, do not remove the terminal buds of branches that extend to the edge of the crown.
- All pruning shall comply with ANSI A300 standards.

#### INSURANCE:

- The landscape contractor shall submit certificates of insurance for workman's compensation and general liability.

#### MULCH:

- All mulch to be shredded oak bark mulch at 3" depth (after compaction) unless otherwise noted. Mulch shall be clean and free of all foreign materials, including weeds, mold, deleterious materials, etc.
- No plastic sheeting or filter fabric shall be placed beneath shredded bark mulch beds. Mirafit fabric shall be used beneath all gravel mulch beds. Lap fabric 6" over adjacent coverages.
- Edge all beds with spade-cut edge unless otherwise noted.

#### MAINTENANCE:

- Landscape Contractor shall provide a separate proposal to maintain all plants, shrubs, groundcover, perennials and annuals for a period of 12 months after acceptance.
- Contractor shall ensure that only competent and trained personnel shall provide such services and that such services be provided in a timely manner.
- Watering of seeded or sodded lawns shall begin immediately and shall continue to be provided continuously for the following 12 hours. Regardless, the landscape contractor shall be responsible for all landscape maintenance until project turnover.

#### SIGHT TRIANGLES:


- No landscape material or other obstructions shall be placed or be maintained within the sight triangle area so as to impede the vision between a height of thirty inches (30") and ten feet (10') above the adjacent street or paving surfaces.
- Sight triangles at the intersection of a public street and a private access way (except for single family residences) shall also be formed by measuring from the point of intersection of the street frontage curb and the entrance curb lines a distance of 35' and connecting the points so established to form the sight triangle area.

#### TOPSOIL:

- Topsoil mix for all proposed landscape plantings shall be five (5) parts well-drained screened organic topsoil to one (1) part Condition sphagnum peat moss as per planting details. Rock-fill topsoil mix to a depth of 6" minimum and grade smooth.
- Provide a soil analysis, as requested, made by an independent soil-testing agency outlining the % of organic matter, inorganic matter, deleterious material, pH and mineral content.
- Any foreign topsoil used shall be free of roots, stumps, weeds, brush, stones (larger than 1"), litter or any other extraneous or toxic material. Landscape contractor shall be fully responsible for correcting all negative soil issues prior to plant installation. Killing and removal of all weeds shall be the responsibility of the landscape contractor as part of this task.
- Landscape contractor to apply pre-emergent herbicide to all planting beds upon completion of planting operations and before application of shredded bark mulch.
- Install siltation controls prior to commencement of any grading operations. Inspect and maintain all siltation fences on a weekly basis until vegetation is established.

#### WARRANTY:

- All plant material (excluding ground cover, perennials and annuals) are to be warranted for a period of 12 months after complete installation of all landscape material at 100% of the installed price.
- Any plant material found to be defective shall be removed and replaced within 30 days of notification or in growth season determined to be best for that plant.
- Only one replacement per tree or shrub shall be required at the end of the warranty period, unless loss is due to failure to comply with the warranty.
- Lawn establishment period will be in effect once the lawn has been mowed three times. Plant establishment period shall commence on the date of acceptance and 100% completion.
- A written guarantee shall be provided to the owner per conditions outlined in #1 above.

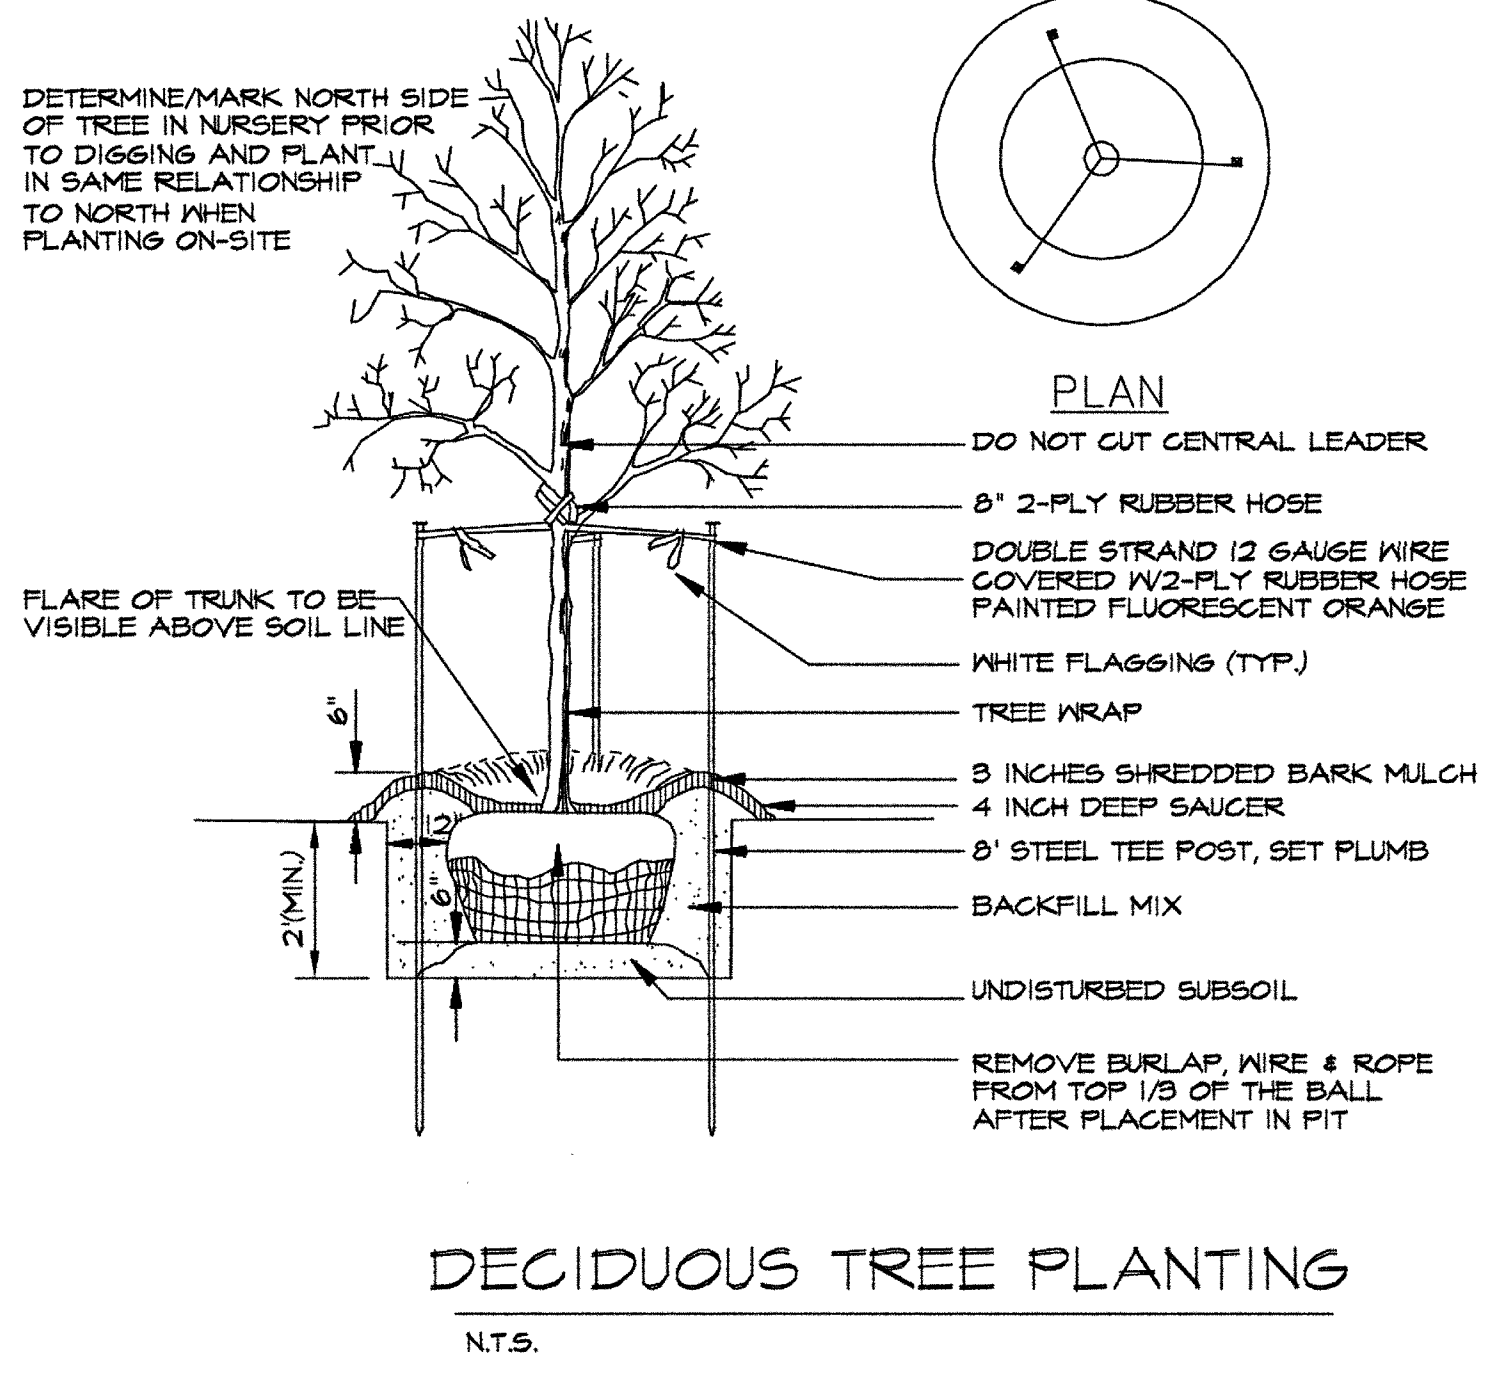

**DECIDUOUS TREE PLANTING**  
N.T.S.


TREES	QTY	COMMON / BOTANICAL NAME	SIZE	GROWTH RATE	MATURE SIZE
ALE	4	Athena Lacebark Elm / <i>Ulmus parvifolia</i> 'Emer 1'	2.5' Cal	FAST	45' +
SVZ	4	Green Vase Zelkova / <i>Zelkova serrata</i> 'Green Vase'	2.5' Cal	FAST	45' +
EH	6	European Hornbeam / <i>Carpinus betulus</i>	2.5' Cal	SLOW/MEDIUM	35' - 40'
RO	4	Red Oak / <i>Quercus rubra</i>	2.5' Cal	SLOW/MEDIUM	45' +
SVRM	8	Sun Valley Red Maple / <i>Acer rubrum</i> 'Sun Valley'	2.5' Cal	FAST	45' +
SWO	1	Swamp White Oak / <i>Quercus bicolor</i>	2.5' Cal	SLOW/MEDIUM	45' +
OSRM	2	'October Glory' Maple / <i>Acer rubrum</i> 'October Glory'	2.5' Cal	FAST	45' +
SHL	2	'Skyline' Locust / <i>Gleditsia triacanthos</i> 'Skyline'	2.5' Cal	FAST	45' +

#### LANDSCAPE DATA:


TOTAL TREES = 41 -- 30 FAST GROWTH (73%) / 11 SLOW-MEDIUM GROWTH (27%)

#### PLEASE NOTE:

- STREET TREES SHALL NOT BE PLANTED CLOSER THAN THREE (3) FEET FROM ANY CURB.
- STREET TREES SHALL NOT BE PLACED WITHIN 25 FEET OF STREETLIGHTS, STREET SIGNS AND INTERSECTIONS.
- NO TREES SHALL BE PLANTED WITHIN TEN (10) FEET OF STREET INLETS OR MANHOLES.

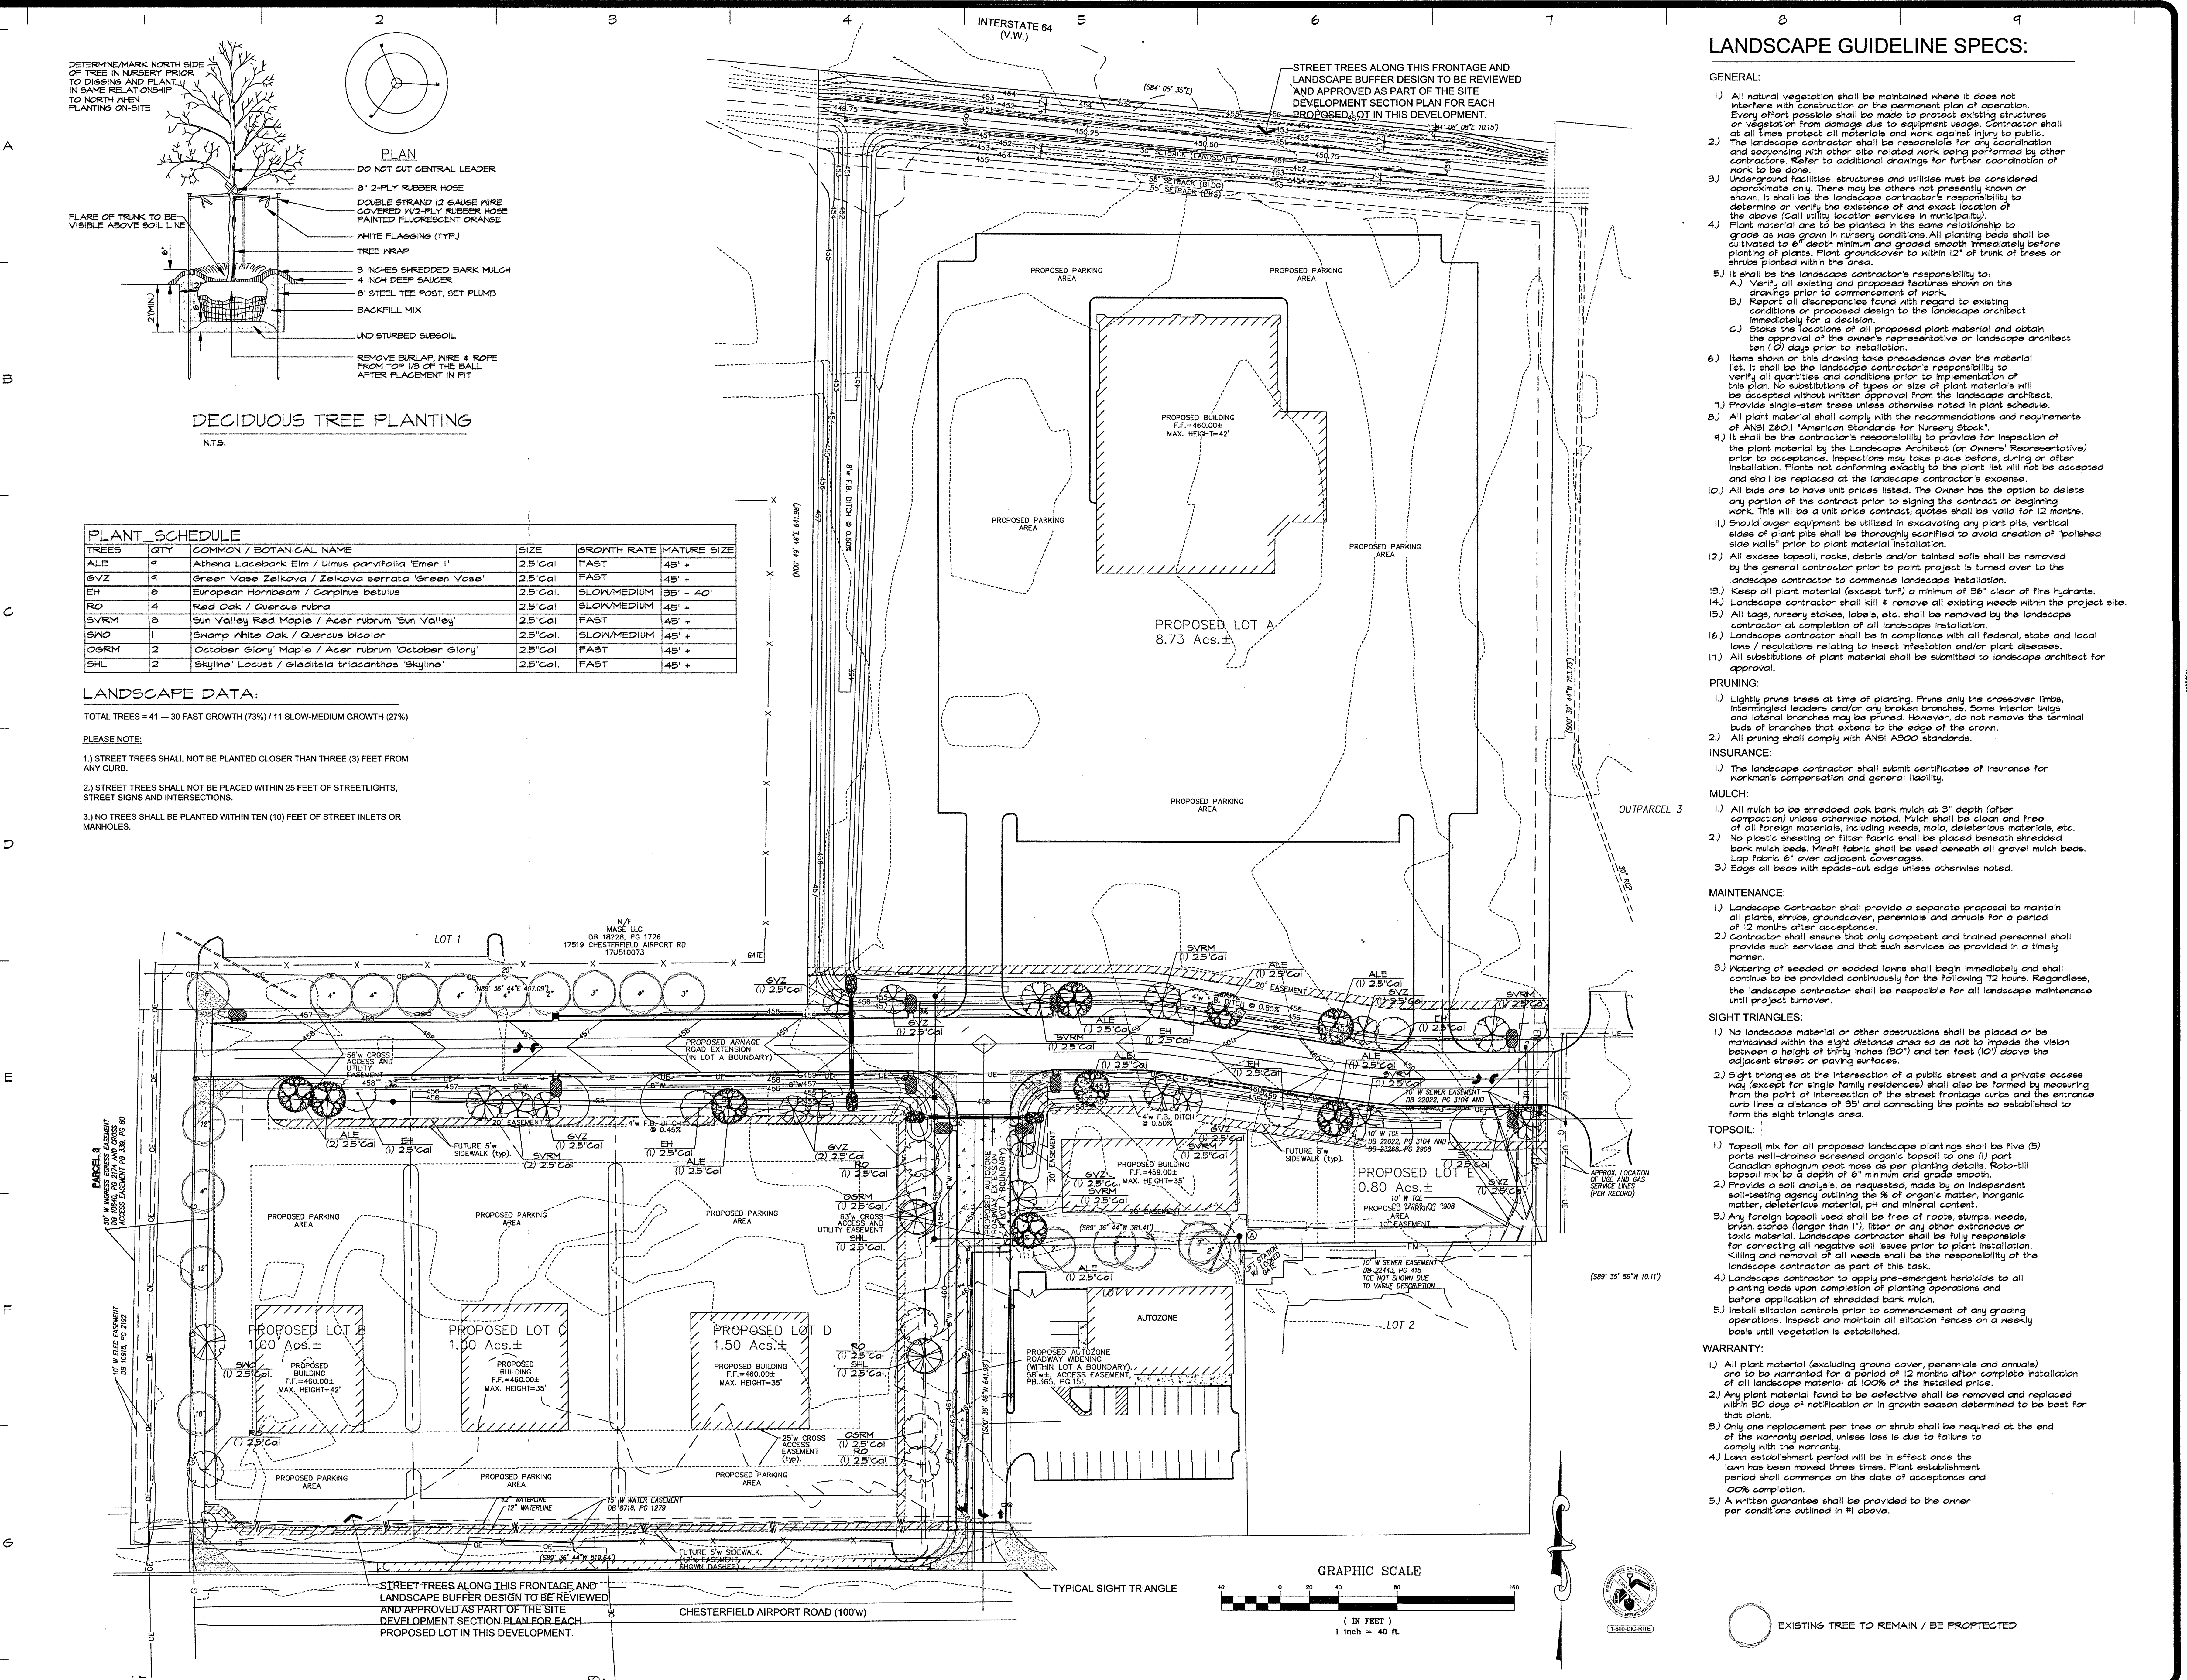

**Landscaping TECHNOLOGIES**  
67 Jacobs Creek Drive  
(636) 498-1280  
PO Landscape Professionals Corporation, MO 63003

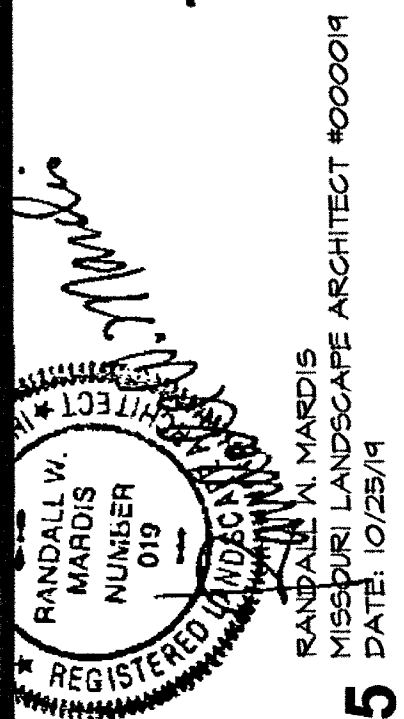


**STREET TREE PLANTING PLAN FOR THE PROPOSED Proposed Adjusted Lot 2 - 84 Lumber Subdivision**  
17511 CHESTERFIELD AIRPORT RD. CHESTERFIELD, MO 63005

DRAWN	R. MARK B.
CHECKED	RMM/EL
DATE	8/26/14
SCALE	1"=40'-0"
JOB NO.	2014-158
SHEET	L-1
OF ONE SHEET	

# Proposed Adjusted Lot 2-84 Lumber Subdivision 17511 Chesterfield Airport Road

Chesterfield, MO 63005

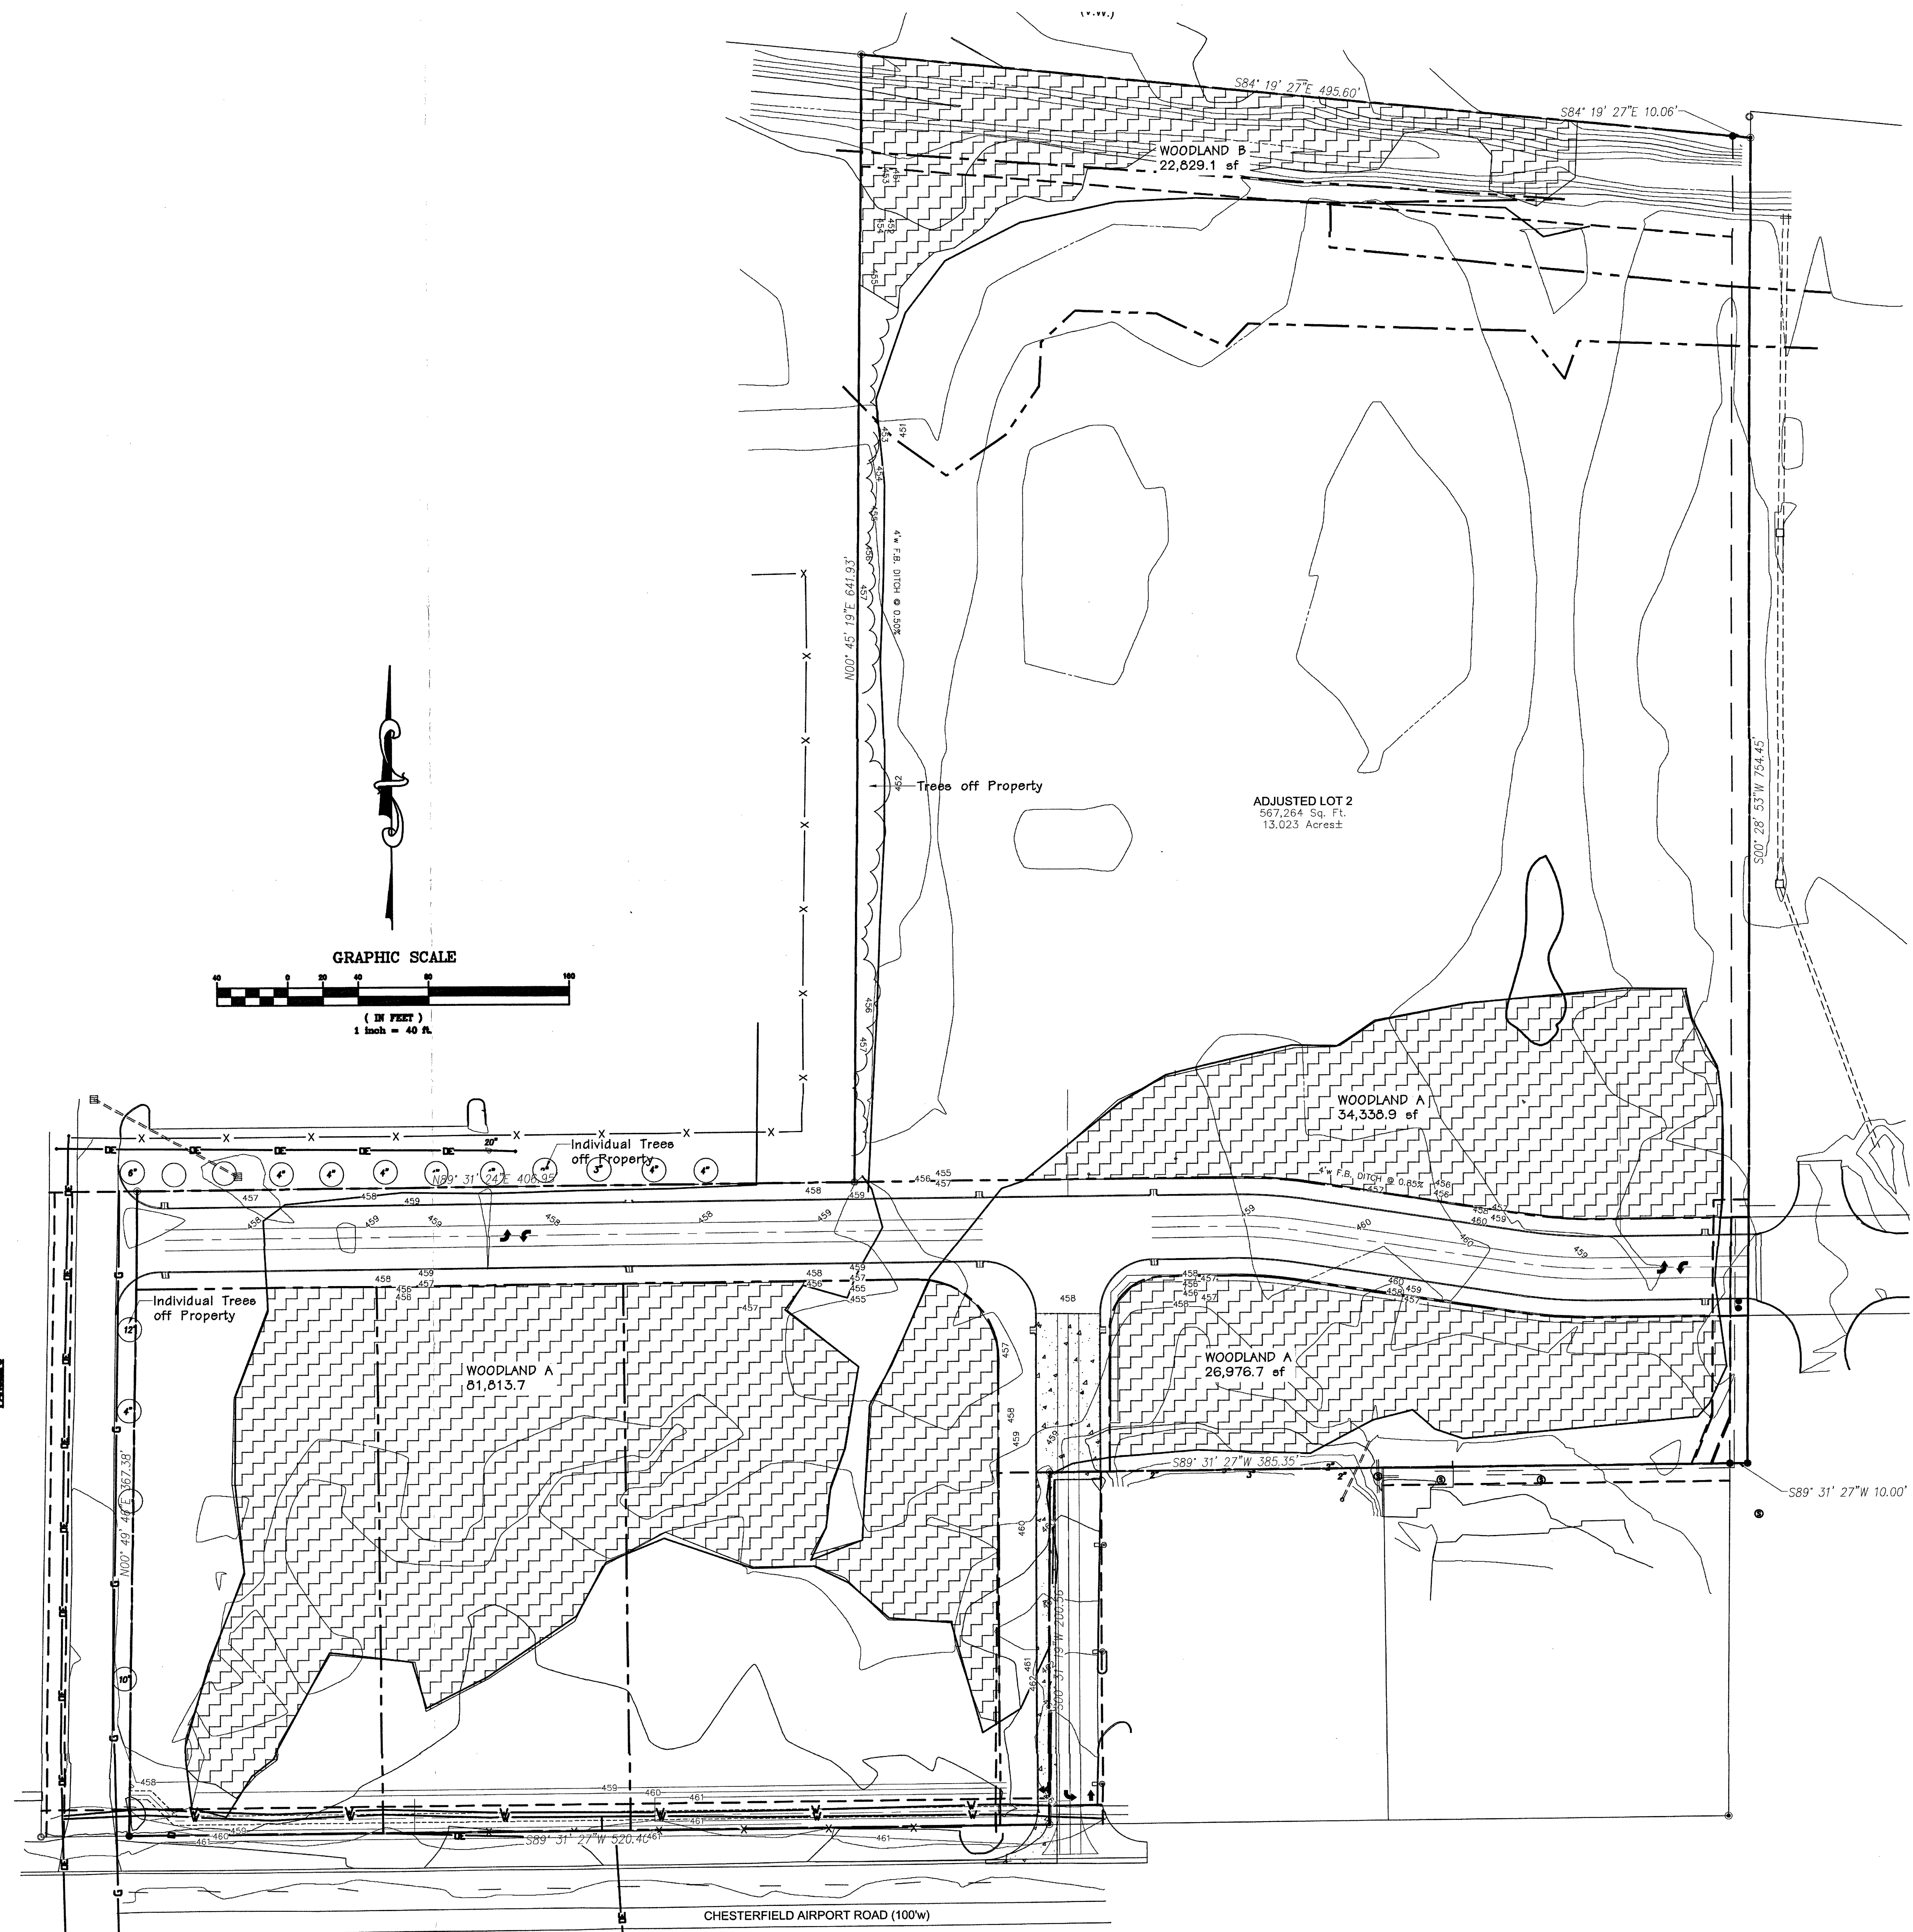

**LEGEND**  
 Location  
 109 - Reference Number

**Tree Stand Delineation Narrative**  
 August 30, 2019  
 The overall lot comprises a total of 13.023 Ac and has a total of 3.8 AC. of Woodlands. The attached detailed Tree Stand Delineation map was completed by field inspection.  
 Woodland A: The woodland area is located mid site to southern property line. The dominant canopy is Elm, Cottonwood, Silver Maple, Boxelder, and Mulberry. The size ranges from 5-20' on a majority of the trees. There are no trees that meet the definition of Monarch.  
 Woodland B: The woodland area is located at the northern property line and on Midco ROW of I 64. This woodland's dominant canopy is made up of Ash, Cottonwood, Boxelder and Mulberry. The size ranges from 4-10' primarily. The overall quality is low. There are no trees that meet the definition of Monarch.  
 No state champion or rare trees were found on the site.  
 WOODLAND A = 3.28 Ac. (143,129.3 sq. ft.)  
 WOODLAND B = 0.53 Ac. (22,829 sq. ft.)  
 Total Existing Canopy 3.83 Ac (165,958.4 sq. ft.)

Revisions:

Date	Description	No.
9/10/19	Comments	1
9/25/19	Comments	2

Drawn: **BD**  
 Checked: **DD**

**D** DeLong Landscape Architecture, LLC  
 7620 West Bruno Ave  
 St. Louis, MO. 63117  
 (314) 346-4856  
 dalong\_la@gmail.com


Tree Stand Delineation Plan Prepared under supervision of Colleen Baum  
 Droege Tree Care  
 Certified Arborist MW-47777A

*Colleen L. Baum*

Base Map Provided by: Stock & Associates


**Tree Stand Delineation**  
 SCALE 1" = 40'-0"

Sheet Title:	Tree Stand Delineation
Sheet No:	TSD-1
Date:	09/5/2019
Job #:	135.020

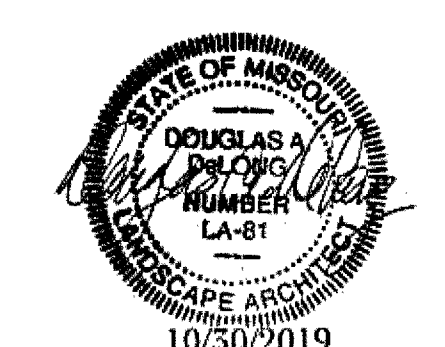

Douglas A. DeLong, Landscape Architect LA-81

Consultants:

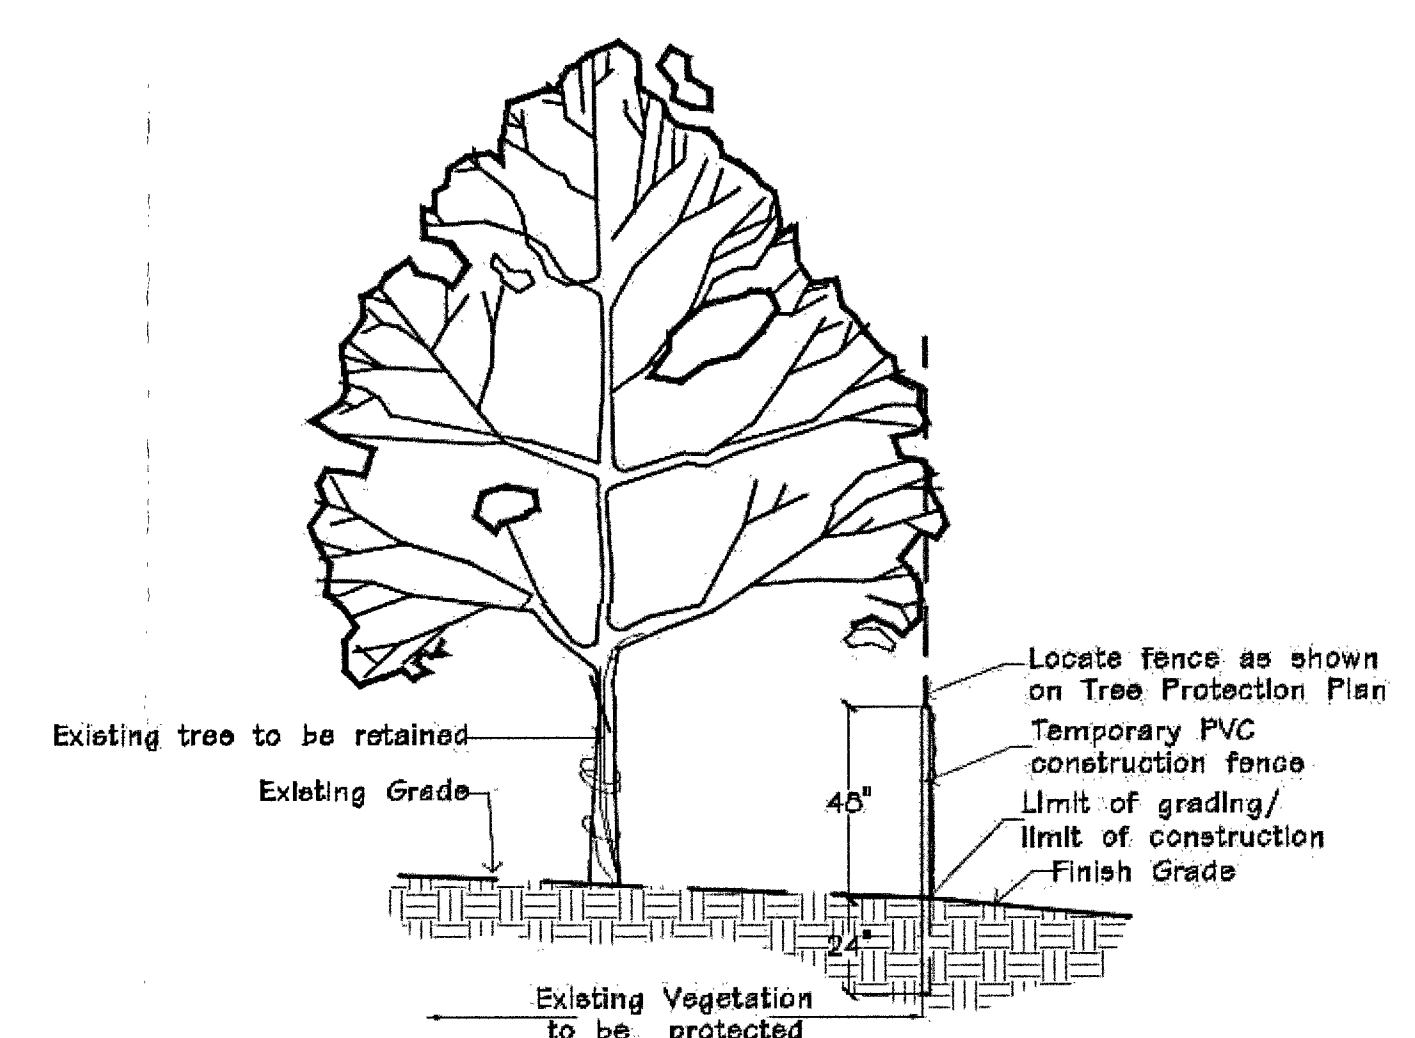

TREE PROTECTION DETAIL  
n.t.e.

TREE PROTECTION NOTES:

- 1) Pre-construction meeting to be held on-site to include a presentation of tree protection measures to operators; construction supervisors; developer's representative; and city zoning inspector.
- 2) Clearing limits shall be rough staked or marked by the applicant's surveyor in order to facilitate location for trenching and fencing installation.
- 3) No early maintenance schedule is required. Where noted on plan, contractor to trench and root prune prior to any grading activity. Required siltation devices to be installed along limit of disturbance line.
- 4) No clearing or grading shall begin in areas where the treatment and preservation measures have not been completed including the installation of tree protection fencing along all "Limit of Disturbance" lines shown on the plan.
- 5) Tree Protection Fencing shall be 4-foot high temporary plastic construction fence. No equipment traffic/parking, concrete washout, material storage or other such construction activity shall be permitted to penetrate the protection fencing or disrupt the Protected Woodland Area except for the removal of dead or invasive plant material. Any proposed plantings shall be subject to the review and approval of the City Arborist. All ground plane shall be mulched with hardwood bark mulch. Tree Protection Signage will be placed along the Protection Fencing as shown as the dashed line on the plan.
- 6) Tree protection measures to be maintained throughout construction sequence.

TOTAL WOODLAND = 3.83 Ac. (165,958.4 sq. ft.)  
 PRESERVATION REQUIRED @ 30% = 1.14 Ac. (49,787.5 sq. ft.)  
 PROPOSED REMOVAL 100% = 3.83 Ac. (165,958.4 sq. ft.)



MITIGATION PLANTINGS REQUIRED OR CONTRIBUTION TO THE CHESTERFIELD TREE FUND BASED ON 49,787.5 SQ. FT. OF CANOPY REMOVED.

MITIGATION PLANTINGS REQUIRED: 55 LARGE TREES X 400 SF = 22,000 SF  
 56 MEDIUM TREES X 300 SF = 16,800 SF  
 55 SMALL TREES X 200 SF = 11,000 SF  
 TOTAL 49,800 SF

MITIGATION PLANTINGS WILL BE DISTRIBUTED OVER EACH LOT BASE ON ACREAGE.

LOT A: 37 LARGE, 38 MEDIUM, AND 37 SMALL TREES  
 LOT B: 4 LARGE, 4 MEDIUM, AND 4 SMALL TREES  
 LOT C: 4 LARGE, 4 MEDIUM, AND 4 SMALL TREES  
 LOT D: 7 LARGE, 7 MEDIUM, AND 7 SMALL TREES  
 LOT E: 3 LARGE, 3 MEDIUM, AND 3 SMALL TREES  
 55 LARGE, 56 MEDIUM, AND 55 SMALL TREES

LEGEND

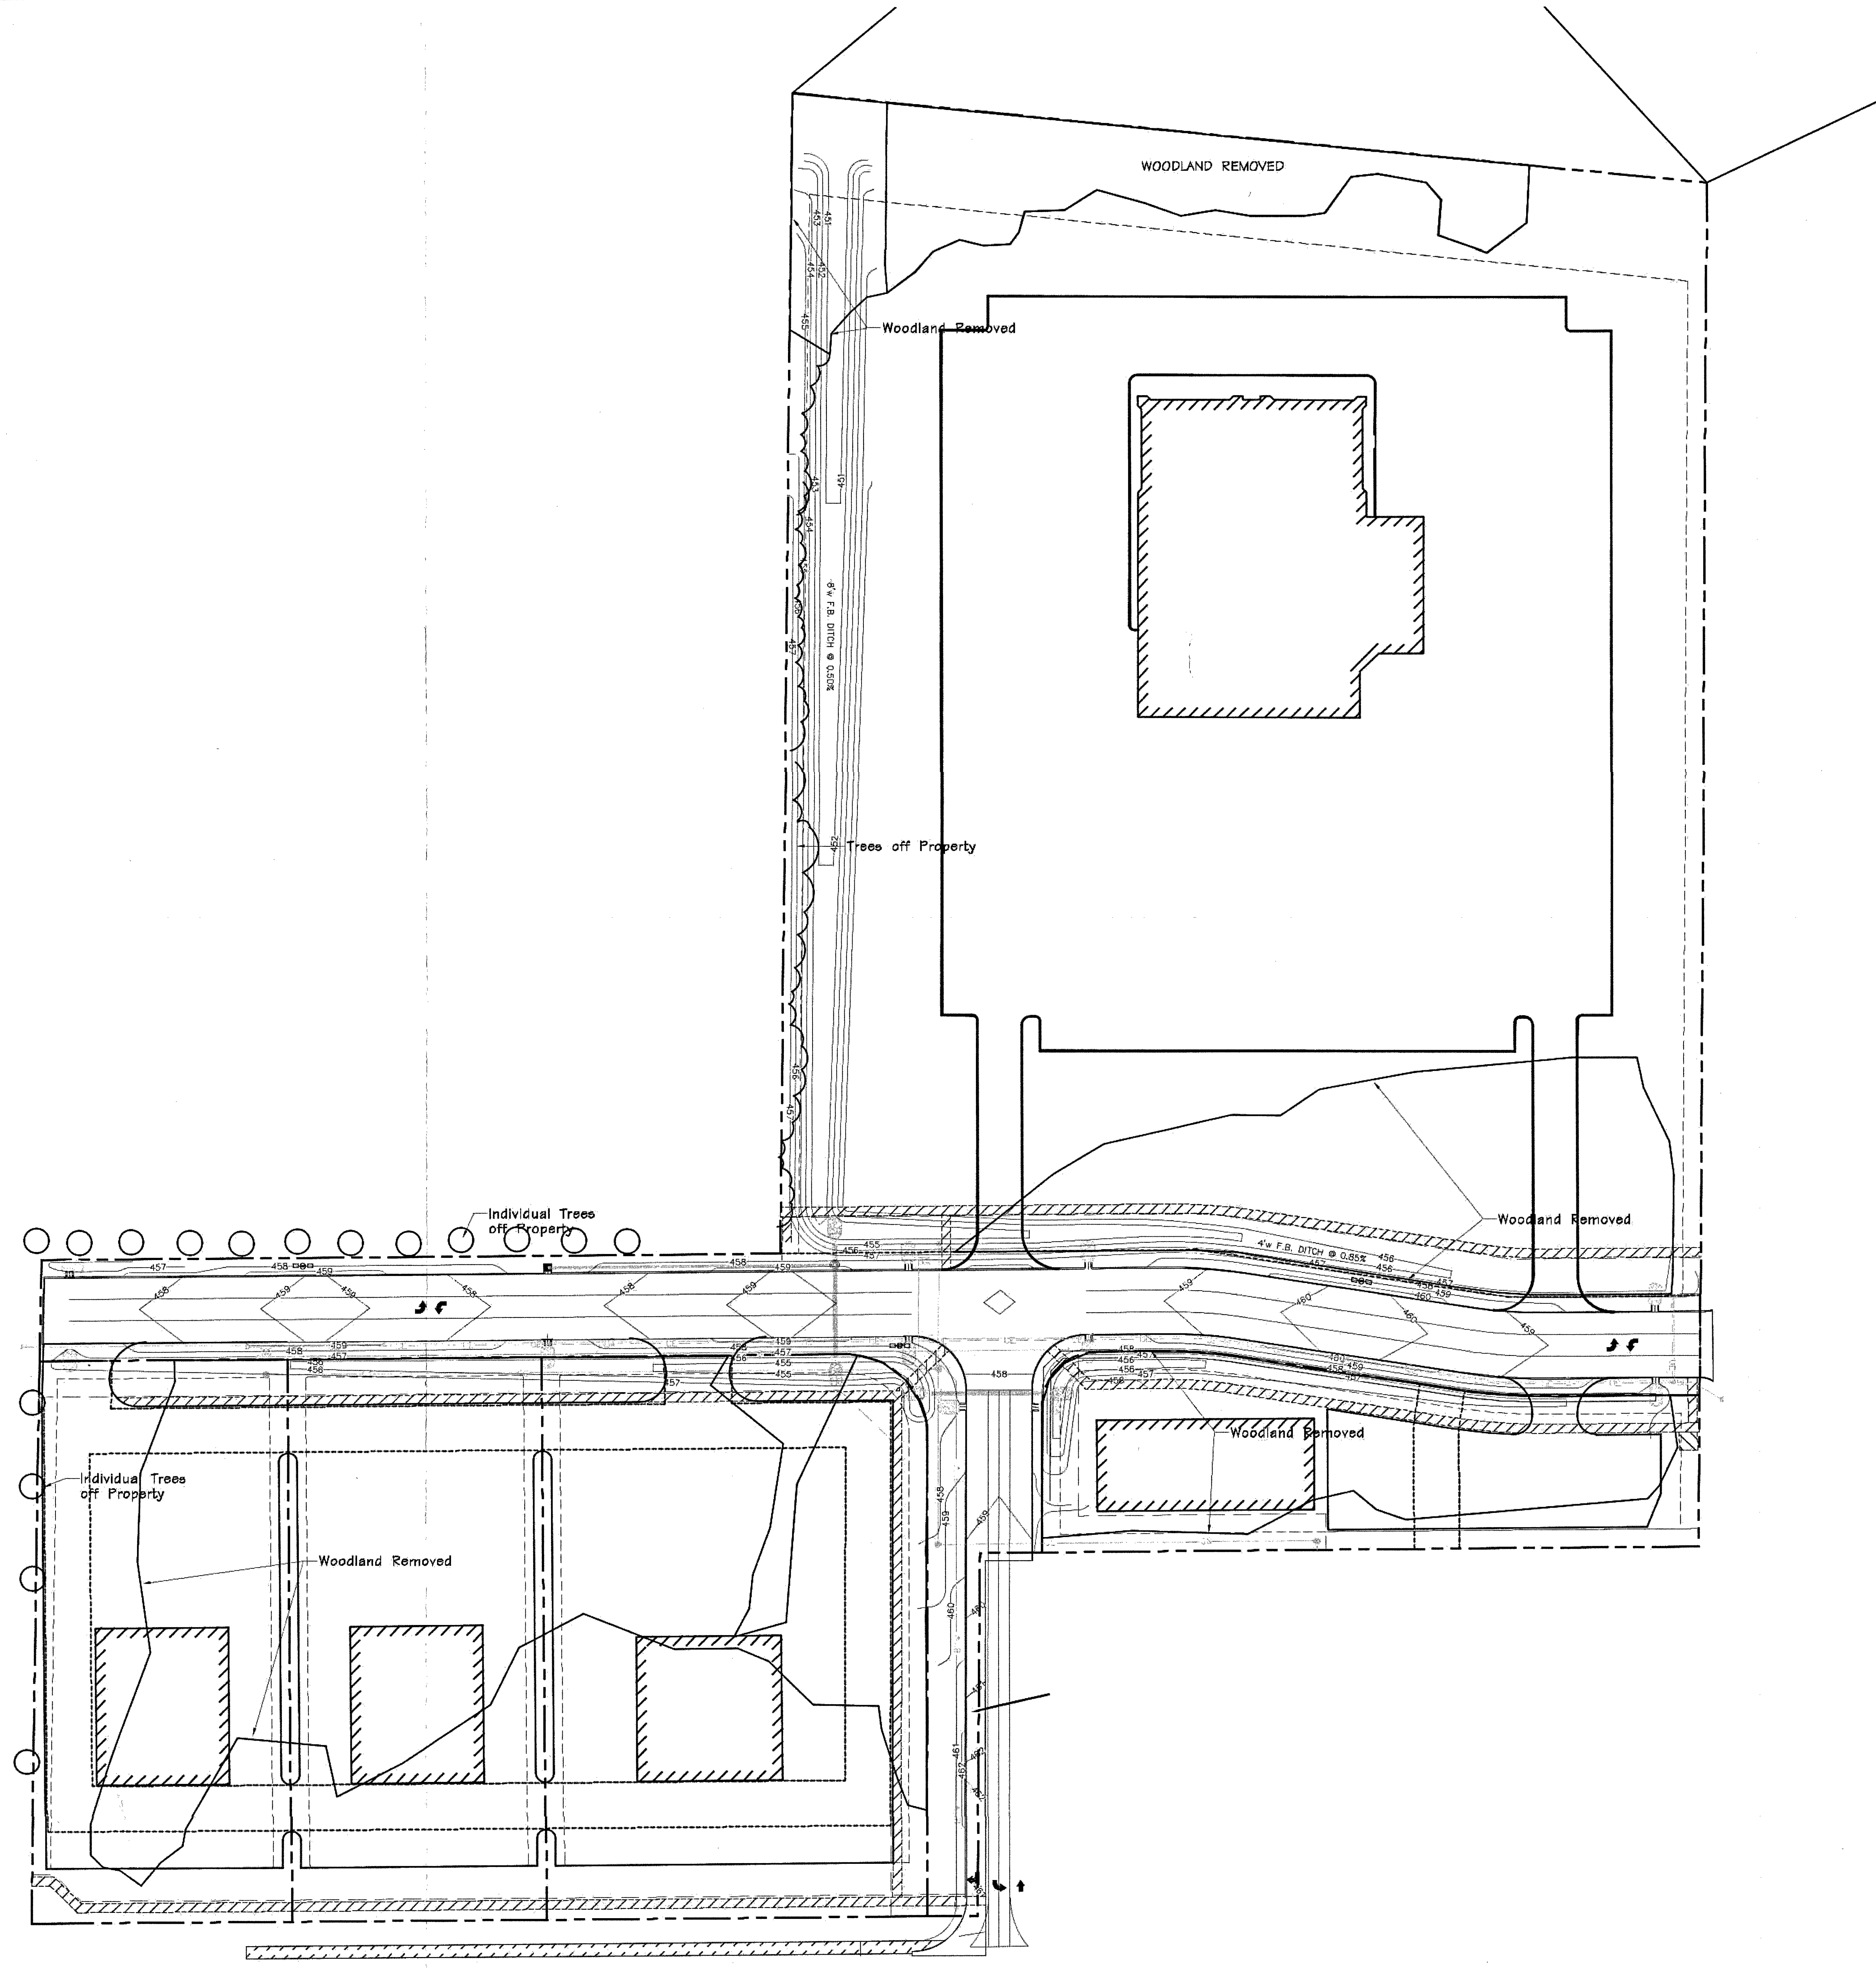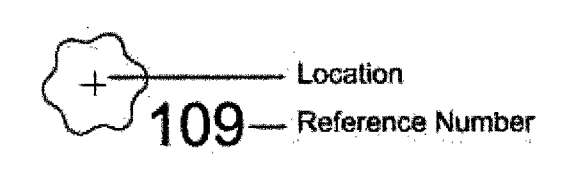

Tree Protection Plan  
SCALE 1" = 40'-0"

Proposed Adjusted Lot 2-84 Lumber Subdivision  
17511 Chesterfield Airport Road

Chesterfield, MO 63005

Revisions:

Date	Description	No.
9/10/19	Comments	1
9/30/19	Comments	2
10/30/19	Comments	3

Drawn: **BD**  
Checked: **DD**

**DeLong and Landscape Architecture, LLC**  
 7620 West Bruno Ave  
 St. Louis, MO. 63117  
 (314) 346-4856  
 delong.la@gmail.com


Sheet Title: **Tree Protection Plan**

Sheet No: **TPP-1**

Date: **09/5/2019**  
Job #: **135.020**

## DESCRIPTION

The Galleon™ LED luminaire delivers exceptional performance in a highly scalable, low-profile design. Patented, high-efficiency AccuLED Optics™ system provides uniform and energy conscious illumination to walkways, parking lots, roadways, building areas and security lighting applications. IP66 rated and UL/cUL Listed for wet locations.

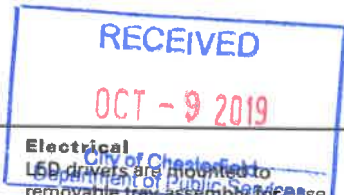

## SPECIFICATION FEATURES

### Construction

Extruded aluminum driver enclosure thermally isolated from Light Squares for optimal thermal performance. Heavy-wall, die-cast aluminum end caps enclose housing and die-cast aluminum heat sinks. A unique, patent pending interlocking housing and heat sink provides scalability with superior structural rigidity. 3G vibration tested and rated. Optional tool-less hardware available for ease of entry into electrical chamber. Housing is IP66 rated.

### Optics

Patented, high-efficiency injection-molded AccuLED Optics technology. Optics are precisely designed to shape the distribution maximizing efficiency and application spacing. AccuLED Optics create consistent distributions with the scalability to meet customized application requirements. Offered standard in 4000K (+/- 275K) CCT 70 CRI. Optional 3000K, 5000K and 6000K CCT.

### Electrical

LED drivers are mounted to removable tray assembly for ease of maintenance. 120-277V 50/60Hz, 347V 60Hz or 480V 60Hz operation. 480V is compatible for use with 480V Wye systems only. Standard with 0-10V dimming. Shipped standard with Eaton proprietary circuit module designed to withstand 10kV of transient line surge. The Galleon LED luminaire is suitable for operation in -40°C to 40°C ambient environments. For applications with ambient temperatures exceeding 40°C, specify the HA (High Ambient) option. Light Squares are IP66 rated. Greater than 90% lumen maintenance expected at 60,000 hours. Available in standard 1A drive current and optional 600mA, 800mA and 1200mA drive currents (nominal).

### Mounting

**STANDARD ARM MOUNT:** Extruded aluminum arm includes internal bolt guides allowing for easy positioning of fixture during mounting. When mounting two or more luminaires at 90° and 120° apart, the EA extended arm may be required. Refer to the

Catalog #	(2) GLEON-AF-04-LED-EI-5WQ	Type
Project	84 Lumber	
Comments		Date
Prepared by		

arm mounting requirement table. Round pole adapter included. For wall mounting, specify wall mount bracket option. **QUICK MOUNT ARM:** Adapter is bolted directly to the pole. Quick mount arm slide into place on the adapter and is secured via two screws, facilitating quick and easy installation. The versatile, patent pending, quick mount arm accommodates multiple drill patterns ranging from 1-1/2" to 4-7/8". Removal of the door on the quick mount arm enables wiring of the fixture without having to access the driver compartment. A knock-out enables round pole mounting.

### Finish

Housing finished in super durable TGIC polyester powder coat paint, 2.5 mil nominal thickness for superior protection against fade and wear. Heat sink is powder coated black. Standard housing colors include black, bronze, grey, white, dark platinum and graphite metallic. RAL and custom color matches available.

### Warranty

Five-year warranty.



## GLEON GALLEON LED

1-10 Light Squares  
Solid State LED


AREA/SITE LUMINAIRE



LumenSafe Technology  
CLICK HERE

WaveLinX

## DIMENSIONS

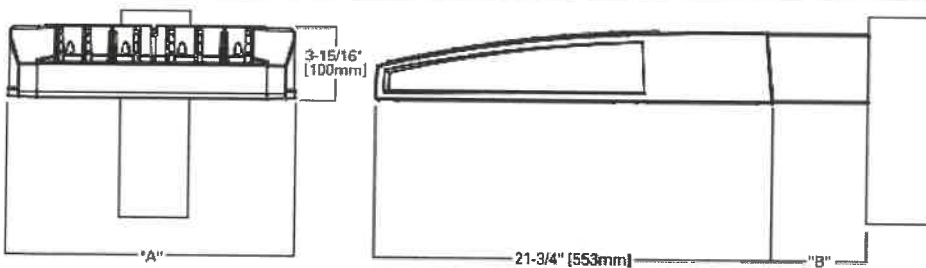


## DIMENSION DATA

Number of Light Squares	"A" Width	"B" Standard Arm Length	"B" Optional Arm Length 1	Weight with Arm (lbs.)	EPA with Arm 2 (Sq. Ft.)
1-4	15-1/2" (394mm)	7" (178mm)	10" (254mm)	33 (15.0 kgs.)	0.96
5-6	21-5/8" (549mm)	7" (178mm)	10" (254mm)	44 (20.0 kgs.)	1.00
7-8	27-5/8" (702mm)	7" (178mm)	13" (330mm)	54 (24.5 kgs.)	1.07
9-10	33-3/4" (857mm)	7" (178mm)	18" (406mm)	63 (28.6 kgs.)	1.12

NOTES: 1. Optional arm length to be used when mounting two fixtures at 90° on a single pole. 2. EPA calculated with optional arm length.



## DRILLING PATTERN



## CERTIFICATION DATA

3G Vibration Rated  
DesignLights Consortium® Qualified\*  
IP66 Rated  
ISO 9001  
LM79 / LM80 Compliant  
UL/cUL Wet Location Listed


## ENERGY DATA

Electronic LED Driver  
>0.9 Power Factor  
<20% Total Harmonic Distortion  
120V-277V 50/60Hz  
347V, 480V 60Hz  
-40°C Min. Temperature  
40°C Max. Temperature  
50°C Max. Temperature (HA Option)




**ARM MOUNTING REQUIREMENTS**

Configuration	90° Apart	120° Apart
GLEON-AF-01	7" Arm (Standard)	7" Arm (Standard)
GLEON-AF-02	7" Arm (Standard)	7" Arm (Standard)
GLEON-AF-03	7" Arm (Standard)	7" Arm (Standard)
GLEON-AF-04	7" Arm (Standard)	7" Arm (Standard)
GLEON-AF-05	10" Extended Arm (Required)	7" Arm (Standard)
GLEON-AF-06	10" Extended Arm (Required)	7" Arm (Standard)
GLEON-AF-07	13" Extended Arm (Required)	13" Extended Arm (Required)
GLEON-AF-08	13" Extended Arm (Required)	13" Extended Arm (Required)
GLEON-AF-09	16" Extended Arm (Required)	16" Extended Arm (Required)
GLEON-AF-10	16" Extended Arm (Required)	16" Extended Arm (Required)

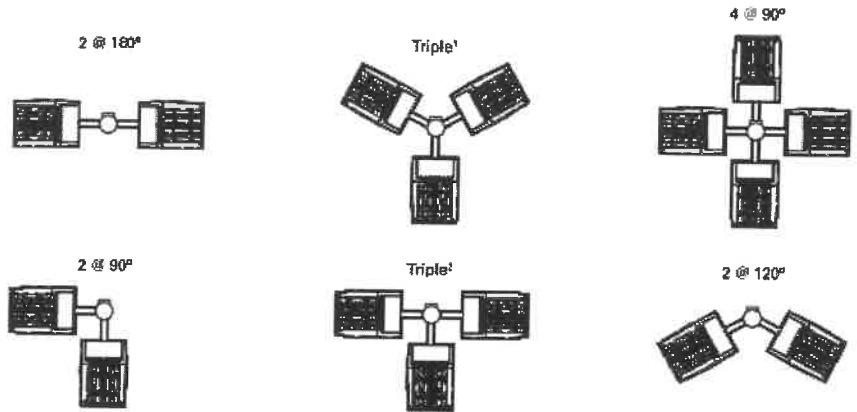


NOTES: 1 Round poles are 3 @ 120°, Square poles are 3 @ 90°. 2 Round poles are 3 @ 90°


**STANDARD WALL MOUNT**

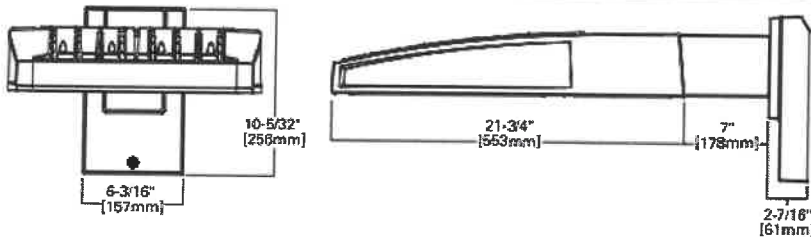

**MAST ARM MOUNT**

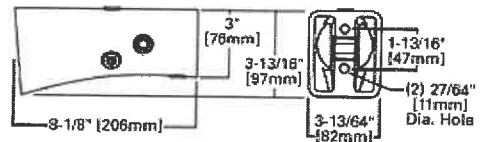


**QUICK MOUNT ARM (INCLUDES FIXTURE ADAPTER)**

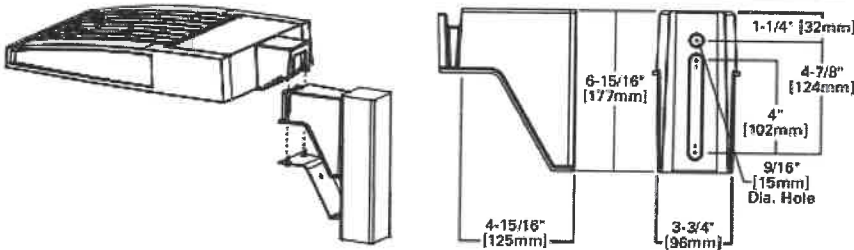

QM Quick Mount Arm (Standard)

QMEA Quick Mount Arm (Extended)

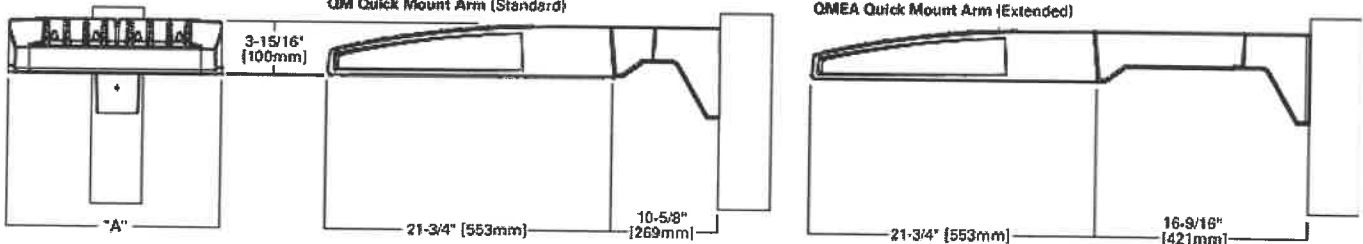


**QUICK MOUNT ARM DATA**


Number of Light Squares 1,2	"A" Width	Weight with QM Arm (lbs.)	Weight with QMEA Arm (lbs.)	EPA (Sq. Ft.)
1-4	15-1/2" [394mm]	35 (15.91 kgs.)	38 (17.27 kgs.)	1.11
5-6 3	21-5/8" [549mm]	46 (20.91 kgs.)	49 (22.27 kgs.)	
7-8	27-5/8" [702mm]	56 (25.45 kgs.)	N/A	

NOTES: 1 QM option available with 1-8 light square configurations. 2 QMEA option available with 1-6 light square configurations. 3 QMEA arm to be used when mounting two fixtures at 90° on a single pole.


**OPTIC ORIENTATION**

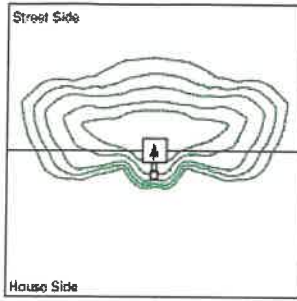

Standard

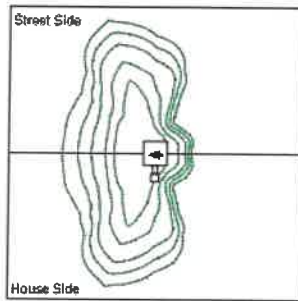


Optics Rotated Left @ 90° (L90)

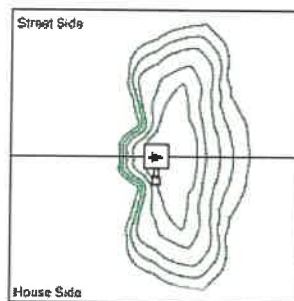


Optics Rotated Right @ 90° (R90)

**OPTICAL DISTRIBUTIONS**


**Asymmetric Area Distributions**

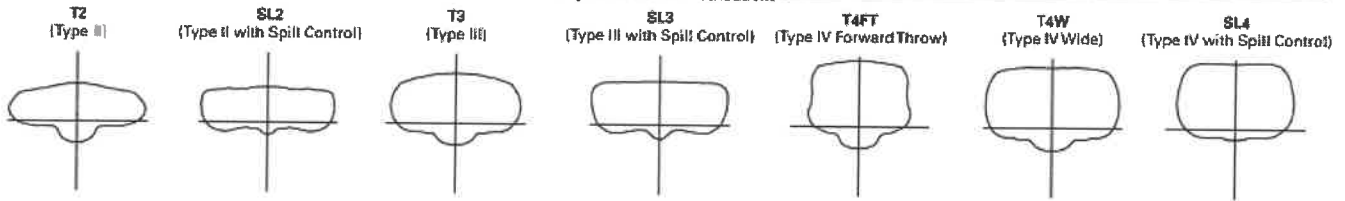


**Asymmetric Roadway Distributions**

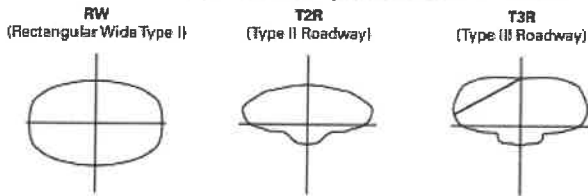

**Symmetric Distributions**

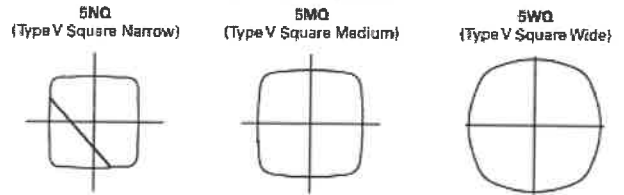

**Specialized Distributions**

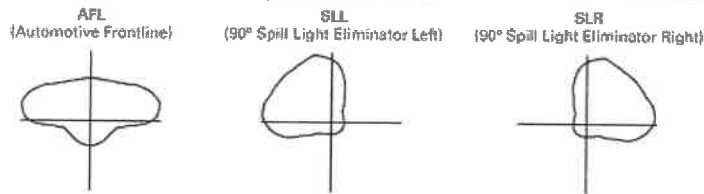


**LUMEN MAINTENANCE**

Drive Current	Ambient Temperature	TM-21 Lumen Maintenance (60,000 Hours)	Projected L70 (Hours)
Up to 1A	Up to 50°C	> 95%	416,000
1.2A	Up to 40°C	> 90%	205,000

**LUMEN MULTIPLIER**

Ambient Temperature	Lumen Multiplier
0°C	1.02
10°C	1.01
25°C	1.00
40°C	0.99
50°C	0.97

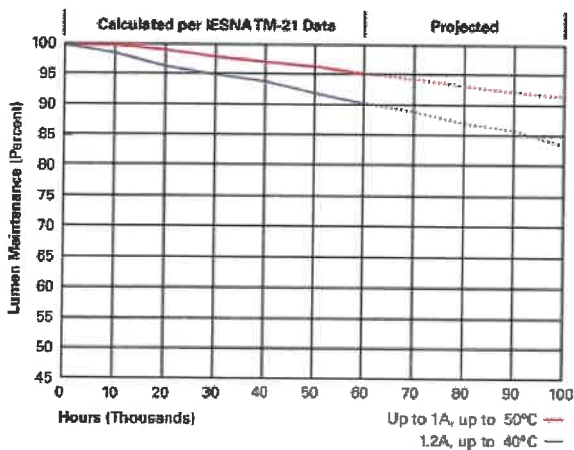

**NOMINAL POWER LUMENS (1.2A)**

Number of Light Squares		1	2	3	4	5	6	7	8	9	10
Nominal Power (Watts)		67	129	191	259	320	382	448	511	575	640
Input Current @ 120V (A)		0.58	1.16	1.78	2.31	2.94	3.56	4.09	4.71	5.34	5.87
Input Current @ 208V (A)		0.33	0.63	0.93	1.27	1.57	1.87	2.22	2.52	2.8	3.14
Input Current @ 240V (A)		0.29	0.55	0.80	1.10	1.35	1.61	1.93	2.18	2.41	2.71
Input Current @ 277V (A)		0.25	0.48	0.70	0.96	1.18	1.39	1.69	1.90	2.09	2.36
Input Current @ 347V (A)		0.20	0.39	0.57	0.78	0.96	1.15	1.36	1.54	1.72	1.92
Input Current @ 480V (A)		0.15	0.30	0.43	0.60	0.73	0.85	1.03	1.16	1.28	1.45
<b>Optics</b>											
T2	4000K/5000K Lumens	6,863	13,412	20,011	26,441	32,761	39,205	46,364	52,534	58,601	64,880
	3000K Lumens	6,489	12,681	18,919	25,000	30,974	37,066	43,836	49,668	55,405	61,341
	BUG Rating	B1-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
T2R	4000K/5000K Lumens	7,285	14,238	21,246	28,072	34,780	41,821	49,221	55,770	62,212	68,878
	3000K Lumens	6,888	13,482	20,087	26,541	32,884	39,351	46,537	52,729	58,819	65,122
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5
T3	4000K/5000K Lumens	6,985	13,670	20,397	26,951	33,391	39,959	47,256	53,544	59,728	66,130
	3000K Lumens	6,613	12,924	19,284	25,480	31,570	37,780	44,679	50,624	56,471	62,524
	BUG Rating	B1-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
T3R	4000K/5000K Lumens	7,150	13,973	20,850	27,549	34,134	40,846	48,307	54,734	61,056	67,598
	3000K Lumens	6,761	13,212	19,713	26,046	32,272	38,619	45,673	51,750	57,726	63,911
	BUG Rating	B1-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
T4FT	4000K/5000K Lumens	7,036	13,748	20,515	27,107	33,586	40,191	47,530	53,864	60,074	66,512
	3000K Lumens	6,652	12,999	19,397	25,629	31,754	37,899	44,938	50,917	56,797	62,885
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
T4W	4000K/5000K Lumens	6,945	13,571	20,249	26,756	33,152	39,671	46,917	53,160	59,298	65,653
	3000K Lumens	6,566	12,831	19,146	25,297	31,344	37,508	44,358	50,260	56,064	62,072
	BUG Rating	B1-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
SL2	4000K/5000K Lumens	6,851	13,388	19,977	26,396	32,704	39,137	46,283	52,444	58,498	64,768
	3000K Lumens	6,477	12,658	18,888	24,957	30,920	37,003	43,759	49,584	55,308	61,235
	BUG Rating	B1-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
SL3	4000K/5000K Lumens	6,994	13,668	20,394	26,947	33,388	39,853	47,249	53,537	59,720	66,119
	3000K Lumens	6,612	12,922	19,281	25,477	31,567	37,774	44,673	50,818	56,463	62,514
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
SL4	4000K/5000K Lumens	6,645	12,986	19,378	25,603	31,723	37,962	44,893	50,868	56,743	62,824
	3000K Lumens	6,282	12,279	18,321	24,207	29,993	35,892	42,445	48,094	53,648	59,398
	BUG Rating	B1-U0-G2	B1-U0-G3	B2-U0-G4	B2-U0-G4	B2-U0-G6	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G6
5WQ	4000K/5000K Lumens	7,214	14,087	21,036	27,795	34,437	41,210	48,734	55,220	61,597	68,199
	3000K Lumens	6,820	13,329	19,888	26,279	32,558	38,962	46,077	52,208	58,237	64,479
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4
5MQ	4000K/5000K Lumens	7,347	14,356	21,423	28,306	35,071	41,969	49,632	56,237	62,730	69,454
	3000K Lumens	6,947	13,573	20,254	26,762	33,158	39,680	46,925	53,170	59,309	65,667
	BUG Rating	B3-U0-G1	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5
5WQ	4000K/5000K Lumens	7,366	14,396	21,480	28,381	35,164	42,080	49,765	56,386	62,898	69,639
	3000K Lumens	6,964	13,610	20,308	26,833	33,247	39,786	47,050	53,311	59,468	65,842
	BUG Rating	B3-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5
SLL/SLR	4000K/5000K Lumens	6,147	12,010	17,921	23,879	29,339	35,109	41,521	47,046	52,478	58,102
	3000K Lumens	5,811	11,355	16,944	22,388	27,739	33,194	39,256	44,479	49,617	54,933
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
RW	4000K/5000K Lumens	7,149	13,970	20,846	27,543	34,126	40,837	48,295	54,722	61,042	67,582
	3000K Lumens	6,780	13,208	19,709	26,041	32,264	38,610	45,661	51,738	57,713	63,897
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G4
AFL	4000K/5000K Lumens	7,175	14,021	20,921	27,643	34,249	40,986	48,470	54,920	61,262	67,828
	3000K Lumens	6,784	13,256	19,780	26,136	32,381	38,750	45,827	51,925	57,922	64,129
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3	B4-U0-G4	B4-U0-G4

\* Nominal data for 70 CRI.



Eaton  
 #21 Highway 74 South  
 Peachtree City, GA 30269  
 P: 770-416-4100  
 www.eaton.com/lighting

Specifications and  
 dimensions subject to  
 change without notice



**NOMINAL POWER LUMENS (1A)**

Number of Light Squares	1	2	3	4	5	6	7	8	9	10	
Nominal Power (Watts)	59	113	166	225	279	333	391	445	501	558	
Input Current @ 120V (A)	0.51	1.02	1.53	2.03	2.55	3.06	3.56	4.08	4.60	5.07	
Input Current @ 208V (A)	0.29	0.56	0.82	1.11	1.37	1.64	1.93	2.19	2.46	2.75	
Input Current @ 240V (A)	0.26	0.48	0.71	0.96	1.19	1.41	1.67	1.89	2.12	2.39	
Input Current @ 277V (A)	0.23	0.42	0.61	0.83	1.03	1.23	1.45	1.65	1.84	2.09	
Input Current @ 347V (A)	0.17	0.32	0.50	0.64	0.82	1.00	1.14	1.32	1.50	1.68	
Input Current @ 480V (A)	0.14	0.24	0.37	0.48	0.61	0.75	0.91	0.99	1.12	1.28	
<b>Optics</b>											
T2	4000K/5000K Lumens	6,256	12,225	18,242	24,104	29,865	35,739	42,265	47,888	53,420	59,144
	3000K Lumens	5,915	11,559	17,248	22,789	28,238	33,790	39,960	45,277	50,506	55,919
	BUG Rating	B1-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
T2R	4000K/5000K Lumens	6,642	12,979	19,366	25,589	31,705	37,941	44,870	50,840	56,711	62,789
	3000K Lumens	6,280	12,271	18,311	24,193	29,976	35,872	42,423	48,068	53,619	58,365
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5
T3	4000K/5000K Lumens	6,377	12,461	18,593	24,568	30,439	36,426	43,077	48,810	54,447	60,282
	3000K Lumens	6,029	11,781	17,580	23,229	28,781	34,441	40,731	46,150	51,480	56,997
	BUG Rating	B1-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
T3R	4000K/5000K Lumens	6,518	12,739	19,006	25,113	31,116	37,235	44,038	49,895	55,658	61,622
	3000K Lumens	6,029	11,781	17,579	23,229	28,779	34,440	40,729	46,148	51,478	56,995
	BUG Rating	B1-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
T4FT	4000K/5000K Lumens	6,414	12,533	18,702	24,710	30,616	36,637	43,328	49,093	54,763	60,631
	3000K Lumens	6,064	11,849	17,681	23,363	28,946	34,638	40,966	46,417	51,776	57,325
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
T4W	4000K/5000K Lumens	6,331	12,372	18,459	24,391	30,221	36,163	42,769	48,459	54,056	59,849
	3000K Lumens	5,986	11,697	17,452	23,061	28,572	34,192	40,436	45,817	51,108	56,585
	BUG Rating	B1-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
SL2	4000K/5000K Lumens	6,245	12,205	18,212	24,062	29,813	35,677	42,192	47,807	53,326	59,042
	3000K Lumens	5,904	11,539	17,218	22,750	28,187	33,732	39,891	45,199	50,418	55,822
	BUG Rating	B1-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
SL3	4000K/5000K Lumens	6,376	12,460	18,591	24,564	30,436	36,421	43,072	48,803	54,439	60,273
	3000K Lumens	6,028	11,780	17,578	23,224	28,778	34,435	40,723	46,141	51,471	56,986
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
SL4	4000K/5000K Lumens	6,058	11,839	17,664	23,340	28,918	34,605	40,924	46,370	51,727	57,269
	3000K Lumens	5,727	11,193	16,701	22,067	27,341	32,718	38,692	43,841	48,908	54,146
	BUG Rating	B1-U0-G2	B1-U0-G3	B2-U0-G4	B2-U0-G4	B2-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
5N0	4000K/5000K Lumens	6,577	12,851	19,176	25,336	31,392	37,668	44,426	50,337	56,151	62,170
	3000K Lumens	6,218	12,151	18,131	23,955	29,680	35,517	42,003	47,592	53,089	58,779
	BUG Rating	B2-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4
5M0	4000K/5000K Lumens	6,697	13,068	19,528	25,803	31,970	38,258	45,243	51,264	57,185	63,313
	3000K Lumens	6,332	12,374	18,463	24,395	30,227	36,171	42,776	48,468	54,066	59,861
	BUG Rating	B3-U0-G1	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5
5W0	4000K/5000K Lumens	6,715	13,122	19,580	25,871	32,055	38,360	45,365	51,401	57,337	63,482
	3000K Lumens	6,348	12,406	18,513	24,461	30,307	36,268	42,891	48,599	54,210	60,021
	BUG Rating	B3-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5
SL1/SLR	4000K/5000K Lumens	5,604	10,949	16,337	21,586	26,745	32,004	37,850	42,886	47,838	52,965
	3000K Lumens	5,298	10,351	15,446	20,409	25,287	30,258	35,786	40,547	45,229	50,077
	BUG Rating	B1-U0-G2	B1-U0-G3	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
RW	4000K/5000K Lumens	6,517	12,735	19,002	25,107	31,109	37,227	44,025	49,883	55,644	61,607
	3000K Lumens	6,162	12,040	17,965	23,738	29,413	35,197	41,623	47,163	52,609	58,247
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4
AFL	4000K/5000K Lumens	6,541	12,781	19,072	25,199	31,221	37,362	44,185	50,065	55,846	61,831
	3000K Lumens	6,184	12,084	18,032	23,825	29,519	35,325	41,775	47,334	52,901	58,459
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3	B4-U0-G4	B4-U0-G4

\* Nominal data for 70 CRI

**NOMINAL POWER LUMENS (800MA)**

Number of Light Squeres	1	2	3	4	5	6	7	8	9	10	
Nominal Power (Watts)	44	85	124	171	210	248	295	334	374	419	
Input Current @ 120V (A)	0.39	0.77	1.13	1.54	1.90	2.26	2.67	3.03	3.39	3.80	
Input Current @ 208V (A)	0.22	0.44	0.62	0.88	1.06	1.24	1.50	1.68	1.87	2.12	
Input Current @ 240V (A)	0.19	0.38	0.54	0.76	0.92	1.08	1.30	1.46	1.62	1.84	
Input Current @ 277V (A)	0.17	0.36	0.47	0.72	0.83	0.95	1.19	1.31	1.42	1.67	
Input Current @ 347V (A)	0.15	0.24	0.38	0.49	0.63	0.77	0.87	1.01	1.15	1.52	
Input Current @ 480V (A)	0.11	0.18	0.29	0.37	0.48	0.59	0.66	0.77	0.88	0.96	
<b>Optics</b>											
T2	4000K/5000K Lumens	5,054	9,878	14,739	19,475	24,129	28,875	34,148	38,691	43,159	47,785
	3000K Lumens	4,779	9,338	13,935	18,412	22,813	27,301	32,286	36,561	40,805	45,179
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B4-U0-G5	B4-U0-G5
T2R	4000K/5000K Lumens	5,366	10,486	15,647	20,675	25,616	30,654	36,252	41,076	45,819	50,730
	3000K Lumens	5,074	9,914	14,794	19,548	24,218	28,982	34,276	38,835	43,320	47,964
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5
T3	4000K/5000K Lumens	5,153	10,068	15,022	19,849	24,593	29,430	34,805	39,436	43,990	48,705
	3000K Lumens	4,872	9,519	14,203	18,786	23,251	27,825	32,907	37,285	41,591	46,048
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5
T3R	4000K/5000K Lumens	5,266	10,292	15,356	20,290	25,140	30,084	35,578	40,312	44,968	49,788
	3000K Lumens	4,979	9,731	14,518	19,184	23,769	28,443	33,638	38,114	42,516	47,071
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
T4FT	4000K/5000K Lumens	5,182	10,126	15,109	19,964	24,736	29,600	35,006	39,664	44,245	48,987
	3000K Lumens	4,899	9,574	14,285	18,876	23,387	27,986	33,097	37,501	41,832	46,315
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
T4W	4000K/5000K Lumens	5,115	9,995	14,914	19,706	24,417	29,218	34,554	39,152	43,674	48,354
	3000K Lumens	4,836	9,450	14,100	18,631	23,085	27,524	32,670	37,017	41,292	45,717
	BUG Rating	B1-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
SL2	4000K/5000K Lumens	5,046	9,860	14,713	19,441	24,087	28,826	34,089	38,625	43,085	47,702
	3000K Lumens	4,771	9,322	13,911	18,381	22,774	27,263	32,229	36,518	40,735	45,101
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B4-U0-G5
SL3	4000K/5000K Lumens	5,152	10,067	15,020	19,846	24,591	29,428	34,800	39,431	43,984	48,698
	3000K Lumens	4,871	9,518	14,200	18,764	23,249	27,822	32,902	37,280	41,585	46,042
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
SL4	4000K/5000K Lumens	4,894	9,565	14,271	18,857	23,364	27,959	33,085	37,465	41,792	46,270
	3000K Lumens	4,627	9,043	13,492	17,829	22,090	26,434	31,261	35,422	39,513	43,746
	BUG Rating	B1-U0-G2	B1-U0-G3	B1-U0-G3	B2-U0-G4	B2-U0-G4	B2-U0-G4	B2-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
5N0	4000K/5000K Lumens	5,313	10,383	15,493	20,470	25,363	30,351	35,893	40,669	45,367	50,229
	3000K Lumens	5,024	9,817	14,647	19,354	23,980	28,696	33,936	38,452	42,893	47,490
	BUG Rating	B2-U0-G1	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3	B5-U0-G3
5M0	4000K/5000K Lumens	5,411	10,574	15,778	20,848	25,830	30,911	36,554	41,418	46,202	51,154
	3000K Lumens	5,117	9,997	14,917	19,710	24,421	29,225	34,561	39,160	43,682	48,364
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G4
5W0	4000K/5000K Lumens	5,426	10,603	15,820	20,903	25,899	30,992	36,652	41,529	46,325	51,290
	3000K Lumens	5,130	10,025	14,958	19,763	24,466	29,302	34,654	39,263	43,799	48,493
	BUG Rating	B3-U0-G1	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5
SLL/SLR	4000K/5000K Lumens	4,528	8,846	13,199	17,440	21,609	25,858	30,580	34,649	38,851	42,792
	3000K Lumens	4,281	8,364	12,480	16,489	20,430	24,448	28,912	32,759	36,543	40,459
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
RW	4000K/5000K Lumens	5,265	10,289	15,353	20,285	25,134	30,077	35,569	40,303	44,958	49,775
	3000K Lumens	4,978	9,727	14,516	19,178	23,763	28,437	33,629	38,105	42,506	47,060
	BUG Rating	B2-U0-G1	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3	B5-U0-G4
AFL	4000K/5000K Lumens	5,285	10,327	15,409	20,380	25,225	30,186	35,699	40,450	45,120	49,956
	3000K Lumens	4,996	9,763	14,569	19,249	23,849	28,540	33,752	38,244	42,659	47,232
	BUG Rating	B1-U0-G1	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3

\* Nominal data for 70 CRI.



Eaton  
1121 Highway 74 South  
Peachtree City, GA 30269  
P. 770.486.4800  
www.eaton.com/lighting

Specifications and  
dimensions subject to  
change without notice

**NOMINAL POWER LUMENS (600MA)**

Number of Light Squares	1	2	3	4	5	6	7	8	9	10	
Nominal Power (Watts)	34	66	96	129	162	193	226	257	290	323	
Input Current @ 120V (A)	0.30	0.58	0.86	1.16	1.44	1.73	2.03	2.33	2.59	2.89	
Input Current @ 208V (A)	0.17	0.34	0.49	0.65	0.84	0.99	1.14	1.30	1.48	1.63	
Input Current @ 240V (A)	0.15	0.30	0.43	0.56	0.74	0.87	1.00	1.13	1.30	1.43	
Input Current @ 277V (A)	0.14	0.28	0.41	0.52	0.69	0.81	0.93	1.04	1.22	1.33	
Input Current @ 347V (A)	0.11	0.19	0.30	0.39	0.49	0.60	0.69	0.77	0.90	0.99	
Input Current @ 480V (A)	0.08	0.15	0.24	0.30	0.38	0.48	0.53	0.59	0.71	0.77	
<b>Optics</b>											
<b>T2</b>	4000K/5000K Lumens	4,121	8,055	12,019	15,881	19,678	23,547	27,847	31,552	35,196	38,967
	3000K Lumens	3,896	7,815	11,363	15,015	18,604	22,263	26,328	29,831	33,276	36,842
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G4
<b>T2R</b>	4000K/5000K Lumens	4,376	8,552	12,760	16,860	20,890	24,998	29,563	33,497	37,365	41,369
	3000K Lumens	4,138	8,085	12,064	15,941	19,751	23,635	27,951	31,670	35,328	39,113
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4
<b>T3</b>	4000K/5000K Lumens	4,201	8,210	12,251	16,187	20,055	23,989	28,383	32,159	35,873	39,718
	3000K Lumens	3,973	7,763	11,583	15,304	18,961	22,691	26,835	30,406	33,916	37,552
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5
<b>T3R</b>	4000K/5000K Lumens	4,294	8,393	12,523	16,546	20,501	24,532	29,014	32,875	36,671	40,600
	3000K Lumens	4,060	7,936	11,840	15,644	19,383	23,195	27,432	31,082	34,671	38,386
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5
<b>T4FT</b>	4000K/5000K Lumens	4,226	8,257	12,321	16,280	20,172	24,139	28,547	32,346	36,082	39,848
	3000K Lumens	3,996	7,807	11,649	15,392	19,071	22,822	26,980	30,582	34,114	37,770
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>T4W</b>	4000K/5000K Lumens	4,171	8,151	12,162	16,071	19,912	23,827	28,178	31,928	35,615	39,432
	3000K Lumens	3,943	7,706	11,498	15,194	18,825	22,527	26,642	30,187	33,673	37,281
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>SL2</b>	4000K/5000K Lumens	4,114	8,041	11,998	15,854	19,643	23,506	27,799	31,498	35,135	38,901
	3000K Lumens	3,890	7,603	11,344	14,989	18,572	22,224	26,282	29,780	33,219	36,779
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5
<b>SL3</b>	4000K/5000K Lumens	4,200	8,209	12,249	16,184	20,053	23,996	28,379	32,154	35,869	39,712
	3000K Lumens	3,972	7,762	11,580	15,302	18,980	22,688	26,831	30,400	33,913	37,546
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G3	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5
<b>SL4</b>	4000K/5000K Lumens	3,992	7,799	11,638	15,378	19,053	22,801	26,964	30,552	34,081	37,733
	3000K Lumens	3,774	7,374	11,003	14,539	18,015	21,557	25,493	28,886	32,222	35,674
	BUG Rating	B1-U0-G2	B1-U0-G2	B1-U0-G3	B1-U0-G3	B2-U0-G4	B2-U0-G4	B2-U0-G4	B2-U0-G5	B2-U0-G5	B3-U0-G5
<b>5N0</b>	4000K/5000K Lumens	4,333	8,467	12,634	16,694	20,683	24,751	29,271	33,166	36,996	40,961
	3000K Lumens	4,097	8,005	11,945	15,784	19,555	23,401	27,674	31,357	34,978	38,727
	BUG Rating	B2-U0-G1	B3-U0-G1	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G2	B5-U0-G3	B5-U0-G3
<b>5M0</b>	4000K/5000K Lumens	4,413	8,822	12,967	17,000	21,064	25,207	29,810	33,777	37,677	41,715
	3000K Lumens	4,173	8,152	12,165	16,073	19,915	23,832	28,185	31,934	35,823	39,440
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4
<b>5W0</b>	4000K/5000K Lumens	4,424	8,646	12,900	17,046	21,120	25,274	29,890	33,866	37,778	41,826
	3000K Lumens	4,182	8,175	12,197	16,117	19,968	23,896	28,260	32,018	35,717	39,545
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G4
<b>SL/SLR</b>	4000K/5000K Lumens	3,692	7,214	10,763	14,222	17,621	21,086	24,937	28,256	31,519	34,897
	3000K Lumens	3,491	6,820	10,176	13,447	16,660	19,937	23,577	26,715	29,800	32,994
	BUG Rating	B1-U0-G1	B1-U0-G2	B1-U0-G3	B2-U0-G3	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5
<b>RW</b>	4000K/5000K Lumens	4,293	8,390	12,520	16,542	20,496	24,527	29,007	32,866	36,662	40,591
	3000K Lumens	4,059	7,932	11,837	15,640	19,378	23,189	27,425	31,074	34,662	38,377
	BUG Rating	B2-U0-G1	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3
<b>AFL</b>	4000K/5000K Lumens	4,310	8,421	12,566	16,602	20,571	24,618	29,112	32,986	36,795	40,738
	3000K Lumens	4,074	7,962	11,881	15,697	19,448	23,273	27,525	31,187	34,788	38,516
	BUG Rating	B1-U0-G1	B1-U0-G1	B2-U0-G2	B2-U0-G2	B2-U0-G2	B3-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3

\* Nominal data for 70 CRI.



Eaton  
1621 Highway 24 South  
Foothree City, GA 30263  
P: 770.486.4400  
www.eaton.com/lighting

Specifications and dimensions subject to change without notice

**CONTROL OPTIONS**

**0-10V (DIM)**

This fixture is offered standard with 0-10V dimming driver(s). The DIM option provides 0-10V dimming wire leads for use with a lighting control panel or other control method.

**Photocontrol (P, R and PER7)**

Optional button-type photocontrol (P) and photocontrol receptacles (R and PER7) provide a flexible solution to enable "dusk-to-dawn" lighting by sensing light levels. Advanced control systems compatible with NEMA 7-pin standards can be utilized with the PER7 receptacle.





**After Hours Dim (AHD)**

This feature allows photocontrol-enabled luminaires to achieve additional energy savings by dimming during scheduled portions of the night. The dimming profile will automatically take effect after a "dusk-to-dawn" period has been calculated from the photocontrol input. Specify the desired dimming profile for a simple, factory-shipped dimming solution requiring no external control wiring. Reference the After Hours Dim supplemental guide for additional information.

**Dimming Occupancy Sensor (MS/DIM-LXX, MS/X-LXX and MS-LXX)**



These sensors are factory installed in the luminaire housing. When the MS/DIM-LXX sensor option is selected, the occupancy sensor is connected to a dimming driver and the entire luminaire dims when there is no activity detected. When activity is detected, the luminaire returns to full light output. The MS/DIM sensor is factory preset to dim down to approximately 50 percent power with a time delay of five minutes. The MS-LXX sensor is factory preset to turn the luminaire off after five minutes of no activity. The MS/X-LXX is also preset for five minutes and only controls the specified number of light engines to maintain steady output from the remaining light engines.

These occupancy sensors includes an integral photocell that can be activated with the FSIR-100 accessory for "dusk-to-dawn" control or daylight harvesting - the factory preset is OFF. The FSIR-100 is a wireless tool utilized for changing the dimming level, time delay, sensitivity and other parameters. A variety of sensor lens are available to optimize the coverage pattern for mounting heights from 8'-40'.

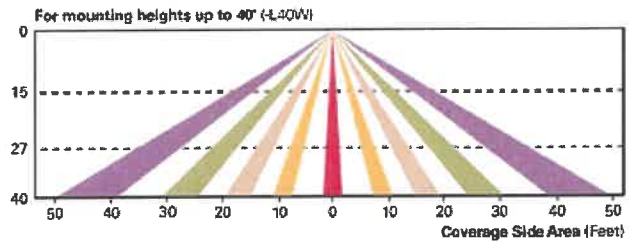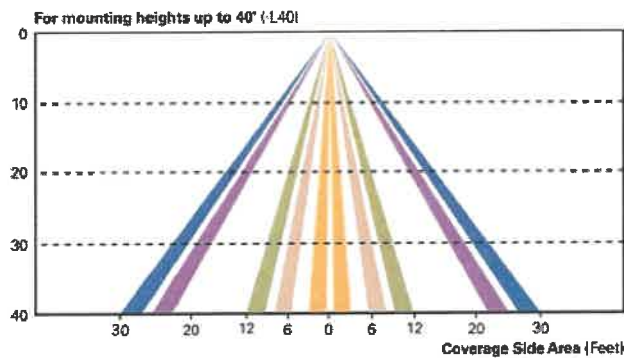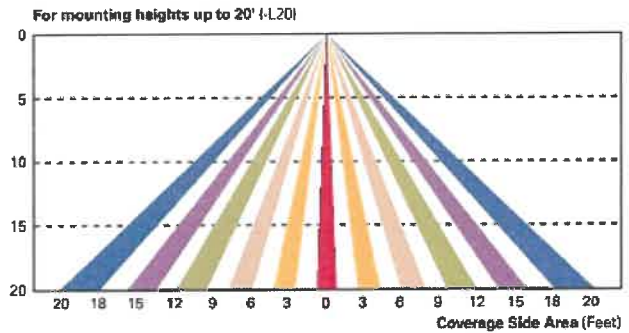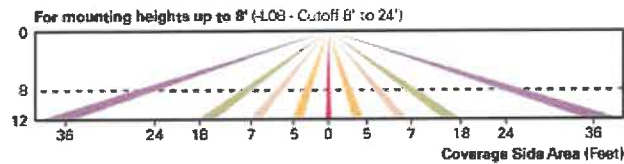

**LumaWatt Pro Wireless Control and Monitoring System (LWR-LW and LWR-LN)**

The Eaton's LumaWatt Pro powered by Enlighted is a connected lighting solution that combines a broad selection of energy-efficient LED luminaires with a powerful integrated wireless sensor system. The sensor controls the lighting system in compliance with the latest energy codes and collects valuable data about building performance and use. Software applications turn the granular data into information through energy dashboards and specialized apps that make it simple and help optimize the use of building resources, beyond lighting.

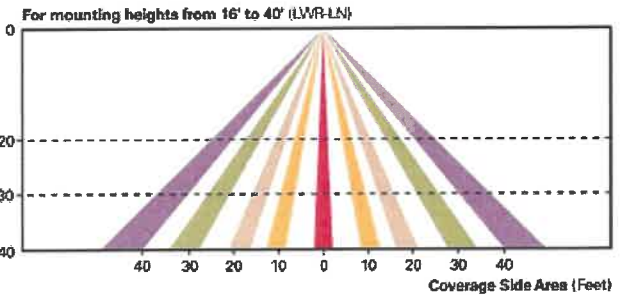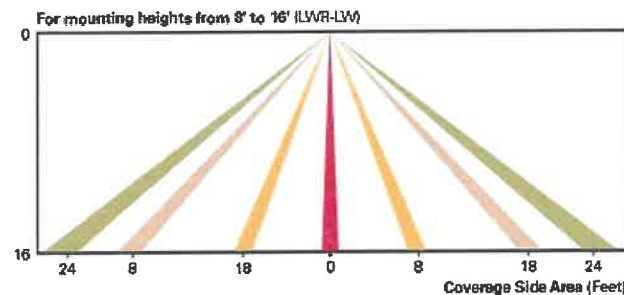

**WaveLinx Wireless Outdoor Lighting Control Module (WOLC-7P-10A)**

The 7-pin wireless outdoor lighting control module enables WaveLinx to control outdoor area, site and flood lighting. WaveLinx controls outdoor lighting using schedules to provide ON, OFF and dimming controls based on astronomic or time schedules based on a 7 day week.

**LumenSafe Integrated Network Security Camera (LD)**

Eaton brings ease of camera deployment to a whole new level. No additional wiring is needed beyond providing line power to the luminaire. A variety of networking options allows security integrators to design the optimal solution for active surveillance. As the ideal solution to meet the needs for active surveillance, the LumenSafe integrated network camera is a streamlined, outdoor-ready fixed dome that provides HDTV 1080p video. This IP camera is optimally designed for deployment in the video management system or security software platform of choice.

ORDERING INFORMATION


Sample Number: GLEON-AF-04-LED-E1-T3-GM-QM

Product Family 1,2	Light Engine	Number of Light Squares 3	Lamp Type	Voltage	Distribution	Color	Mounting		
GLEON-Galleon	AF=1A Drive Current	01=1 02=2 03=3 <b>04=4</b> 05=5 4 06=6 07=7 5 08=8 5 09=9 6 10=10 6	LED-Solid State Light Emitting Diodes	E1=120-277V 347=347V 1 480=480V 1 8	T2=Type II T2R=Type II Roadway T3=Type III T3R=Type III Roadway T4FT=Type IV Forward Throw T4W=Type IV Wide 5N2=Type V Narrow 5M2=Type V Square Medium <b>5W2=Type V Square Wide</b> SL2=Type II w/Spill Control SL3=Type III w/Spill Control SL4=Type IV w/Spill Control SLL=90° Spill Light Eliminator Left SLR=90° Spill Light Eliminator Right RW=Rectangular Wide Type I AFL=Automotive Frontline	AP=Gray <b>BZ=Bronze</b> BK=Black DP=Dark Platinum GM=Graphite Metallic WH=White	[Blank]=Arm for Round or Square Pole EA=Extended Arm 3 MA=Mount Arm Adapter 3 WM=Wall Mount QM=Quick Mount Arm (Standard Length) 3 QMEA=Quick Mount Arm (Extended Length) 3		
Options (Add as Suffix)						Accessories (Order Separately)			
7027=70 CRI 2700K 17 7030=70 CRI 3000K 17 8030=80 CRI 3000K 17 7050=70 CRI 5000K 17 7060=70 CRI 6000K 17 800=Drive Current Set to Nominal 800mA 19 800=Drive Current Set to Nominal 800mA 19 1200=Drive Current Set to Nominal 1200mA 19, 20 F=Single Fuse (120, 277 or 347V, Specify Voltage) FF=Double Fuse (208, 240 or 480V, Specify Voltage) 2L=Two Circuits 12, 20 DIM=External 0-10V Dimming Leads 16, 20 AHD14S=After Hours Dim, 5 Hours 22 AHD2HS=After Hours Dim, 6 Hours 22 AHD2HS=After Hours Dim, 7 Hours 22 AHD3HS=After Hours Dim, 8 Hours 22 HA=50°C High Ambient 23 L90=Optics Rotated 90° Left FR90=Optics Rotated 90° Right INT=Installed Mesh Top TH=Top-Less Door Hardware HSS=Installed House Side Shield 28 CE=CE Marking 29 LCF=Light Square Trim Painted to Match Housing 27						P=Button Type Photocontrol (120, 208, 240 or 277V, Must Specify Voltage) 21 PER7=NEMA 7-PIN Photocontrol Receptacle 21 R=NEMA Photocontrol Receptacle 21 MS-L20=Motion Sensor for ON/OFF Operation, 5' - 20' Mounting Height 24 MS-DIM-L20=Motion Sensor for Dimming Operation, Maximum 8' Mounting Height 24 MS/DIM-L40W=Motion Sensor for Dimming Operation, 21' - 40' Mounting Height 24 MS/DIM-L40W=Motion Sensor for Dimming Operation, 21' - 40' Mounting Height 24 MS/X-L20=B-Level Motion Sensor, Maximum 8' Mounting Height 24, 25 MS/X-L20=B-Level Motion Sensor, 5' - 20' Mounting Height 24, 25 MS/X-L40W=B-Level Motion Sensor, 21' - 40' Mounting Height 24, 25 MS-L08=Motion Sensor for ON/OFF Operation, Maximum 8' Mounting Height 24 LWR-LW=LumaWatt Pro Wireless Sensor, Wide Lens for 8' - 16' Mounting Height 26 LWR-LN=LumaWatt Pro Wireless Sensor, Narrow Lens for 15' - 40' Mounting Height 26 ZW=WaveLink-enabled 4-PIN Twistlock Receptacle 28, 29 ZW-SWPD4WH=Wavelinx Wireless Sensor, 7' - 15' Mounting Height, White 10, 28, 29 ZW-SWPD4BZ=Wavelinx Wireless Sensor, 7' - 15' Mounting Height, Bronze 10, 28, 29 ZW-SWPD5WH=Wavelinx Wireless Sensor, 15' - 40' Mounting Height, White 10, 28, 29 ZW-SWPD5BZ=Wavelinx Wireless Sensor, 15' - 40' Mounting Height, Bronze 10, 28, 29		OA/RA 1016=NEMA Photocontrol Multi-Tap - 105-295V OA/RA 1027=NEMA Photocontrol - 480V OA/RA 1201=NEMA Photocontrol - 347V OA/RA 1013=Photocontrol Shorting Cap OA/RA 1014=120V Photocontrol MA1252=10kV Surge Module Placement MA1096-XX=Single Tenon Adapter for 2-3/8" O.D. Tenon MA1037-XX=3@120° Tenon Adapter for 2-3/8" O.D. Tenon MA1188-XX=4@90° Tenon Adapter for 2-3/8" O.D. Tenon MA1189-XX=2@90° Tenon Adapter for 2-3/8" O.D. Tenon MA1190-XX=3@90° Tenon Adapter for 2-3/8" O.D. Tenon MA1191-XX=2@120° Tenon Adapter for 2-3/8" O.D. Tenon MA1038-XX=Single Tenon Adapter for 3-1/2" O.D. Tenon MA1039-XX=2@180° Tenon Adapter for 3-1/2" O.D. Tenon MA1192-XX=3@120° Tenon Adapter for 3-1/2" O.D. Tenon MA1193-XX=4@90° Tenon Adapter for 3-1/2" O.D. Tenon MA1194-XX=2@90° Tenon Adapter for 3-1/2" O.D. Tenon MA1195-XX=3@90° Tenon Adapter for 3-1/2" O.D. Tenon FSR-100=Wireless Configuration Tool for Occupancy Sensor 24 GLEON-WT1=Field Installed Mesh Top for 1-4 Light Squares GLEON-WT2=Field Installed Mesh Top for 5-6 Light Squares GLEON-WT3=Field Installed Mesh Top for 7-8 Light Squares GLEON-WT4=Field Installed Mesh Top for 9-10 Light Squares GLEON-QM=Quick Mount Arm Kit 11 GLEON-QMEA=Quick Mount Extended Arm Kit 12 LS/HSS=Field Installed House Side Shield 28, 29 WOLC-7P-10A=Wavelinx Outdoor Control Module 16, 27 SWPD4-WH=Wavelinx Wireless Sensor, 7' - 15' Mounting Height, White 10, 28, 29 SWPD4-BZ=Wavelinx Wireless Sensor, 7' - 15' Mounting Height, Bronze 10, 28, 29 SWPD5-WH=Wavelinx Wireless Sensor, 15' - 40' Mounting Height, White 10, 28, 29 SWPD5-BZ=Wavelinx Wireless Sensor, 15' - 40' Mounting Height, Bronze 10, 28, 29	

NOTES:

1 Customer is responsible for engineering analysis to confirm pole and fixture compatibility for all applications. Refer to our white paper: WPS13001EN for additional support information. 2 Design Lights Consortium Qualified. Refer to www.designlights.org Qualified Products List under Family Models for details. 3 Standard 4000K CCT and minimum 70 CRI. 4 Not compatible with MS/M-LXX or MS/I-LXX sensors. 5 Not compatible with extended quick mount arm (QMEA). 6 Not compatible with standard quick mount arm (QM) or extended quick mount arm (QMEA). 7 Requires the use of an integral step down transformer when combined with sensor options. Not available with sensor at 1200mA. Not available in combination with the HA high ambient and sensor options at 3A. 8 Only for use with 480V WYS systems. Per NEC, not for use with ungrounded systems, impedance grounded systems or corner grounded systems (commonly known as Three Phase Three Wire Delta, Three Phase High Leg Delta and Three Phase Corner Grounded Delta systems). 9 May be required when two or more luminaires are oriented on a 90° or 120° drilling pattern. Refer to arm mounting requirement table. 10 Factory installed. 11 Maximum 8 light squares. 12 Maximum 6 light squares. 13 Extended lead times apply. Use dedicated IES files for 2700K, 3000K, 5000K and 6000K when performing layouts. 14 Reserved 15 1 Amp standard. Use dedicated IES files for 800mA, 800mA and 1200mA when performing layouts. 16 Not available with HA option. 17 2L is not available with MS, MS/X or MS/DIM at 347V or 480V. 2L in AF-02 through AF-04 requires a larger housing, normally used for AF-05 or AF-06. Extended arm option may be required when mounting two or more fixtures per pole at 90° or 120°. Refer to arm mounting requirement table. 18 Not available with LumaWatt Pro wireless sensors. 19 Cannot be used with other control options. 20 Low voltage control lead brought out 18" outside fixture. 21 Not available if any "MS" sensor is selected. Motion sensor has an integral photocell. 22 Requires the use of P photocontrol or the PER7 or R photocontrol receptacle with photocontrol accessory. See After Hours Dim supplemental guide for additional information. 23 50°C lumen maintenance data applies to 600mA, 800mA and 1A drive currents. 24 The FSR-100 configuration tool is required to adjust parameters including high and low modes, sensitivity, time delay, cutoff and more. Consult your lighting representative at Eaton for more information. 25 Replace X with number of Light Squares operating in low output mode. 26 LumaWatt Pro wireless sensors are factory installed only requiring network components LWP-EM-1, LWP-GW-1 and LWP-PoE in appropriate quantities. See www.eaton.com/lighting for LumaWatt Pro application information. 27 Not available with house side shield (HSS). 28 Only for use with SL2, SL3, SL4 and AFL distributions. The Light Square trim plate is painted black when the HSS option is selected. 29 CE is not available with the LWR, MS, MS/X, MS/DIM, P, R or PER7 options. Available in 120-277V only. 30 One required for each Light Square. 31 Requires PER7. 32 Reserved. 33 WAC Gateway required to enable field-configurability. Order WAC-PoE and WPDE-120 (10V to PoE injector) power supply if needed. 34 Requires 2IV. 35 Reserved.

LumenSafe Integrated Network Security Camera Technology Options (Add as Suffix)

Product Family	Camera Type	Data Backhaul	
L=LumenSafe Technology 	D=Dome Camera, Standard H=Dome Camera, Hi-Res Z=Dome Camera, Remote PTZ	C=Cellular, Customer Installed SIM Card A=Cellular, Factory Installed AT&T SIM Card V=Cellular, Factory Installed Verizon SIM Card S=Cellular, Factory Installed Sprint SIM Card	W=Wi-Fi Networking w/ Omni-Directional Antenna E=Ethernet Networking

\*Consult LumenSafe system pages for additional details and compatibility.

## DESCRIPTION

The Galleon™ LED luminaire delivers exceptional performance in a highly scalable, low-profile design. Patented, high-efficiency AccuLED Optics™ system provides uniform and energy conscious illumination to walkways, parking lots, roadways, building areas and security lighting applications. IP66 rated and UL/cUL Listed for wet locations.

RECEIVED

OCT - 9 2019

City of Chesterfield  
Department of Public Services

Catalog #	GLEON-AF-05-LED-EI-T3	Type
Project	84 LUMBER	
Comments		Date
Prepared by		

## SPECIFICATION FEATURES

### Construction

Extruded aluminum driver enclosure thermally isolated from Light Squares for optimal thermal performance. Heavy-wall, die-cast aluminum end caps enclose housing and die-cast aluminum heat sinks. A unique, patent pending interlocking housing and heat sink provides scalability with superior structural rigidity. 3G vibration tested and rated. Optional tool-less hardware available for ease of entry into electrical chamber. Housing is IP66 rated.

### Optics

Patented, high-efficiency injection-molded AccuLED Optics technology. Optics are precisely designed to shape the distribution maximizing efficiency and application spacing. AccuLED Optics create consistent distributions with the scalability to meet customized application requirements. Offered standard in 4000K (+/- 275K) CCT 70 CRI. Optional 3000K and 6000K CCT.

### Electrical

LED drivers are mounted to removable tray assembly for ease of maintenance. 120-277V 50/60Hz, 347V 60Hz or 480V 60Hz operation. 480V is compatible for use with 480V Wye systems only. Standard with 0-10V dimming. Shipped standard with Eaton proprietary circuit module designed to withstand 10kV of transient line surge. The Galleon LED luminaire is suitable for operation in -40°C to 40°C ambient environments. For applications with ambient temperatures exceeding 40°C, specify the HA (High Ambient) option. Light Squares are IP66 rated. Greater than 90% lumen maintenance expected at 60,000 hours. Available in standard 1A drive current and optional 600mA, 800mA and 1200mA drive currents (nominal).

### Mounting

**STANDARD ARM MOUNT:** Extruded aluminum arm includes internal bolt guides allowing for easy positioning of fixture during mounting. When mounting two or more luminaires at 90° and 120° apart, the EA extended arm may be required. Refer to the

arm mounting requirement table. Round pole adapter included. For wall mounting, specify wall mount bracket option. **QUICK MOUNT ARM:** Adapter is bolted directly to the pole. Quick mount arm slide into place on the adapter and is secured via two screws, facilitating quick and easy installation. The versatile, patent pending, quick mount arm accommodates multiple drill patterns ranging from 1-1/2" to 4-7/8". Removal of the door on the quick mount arm enables wiring of the fixture without having to access the driver compartment. A knock-out enables round pole mounting.

### Finish

Housing finished in super durable TGIC polyester powder coat paint, 2.5 mil nominal thickness for superior protection against fade and wear. Heat sink is powder coated black. Standard housing colors include black, bronze, grey, white, dark platinum and graphite metallic. RAL and custom color matches available.

### Warranty

Five-year warranty.



## GLEON GALLEON LED


1-10 Light Squares  
Solid State LED

AREA/SITE LUMINAIRE



WaveLinX

## DIMENSIONS

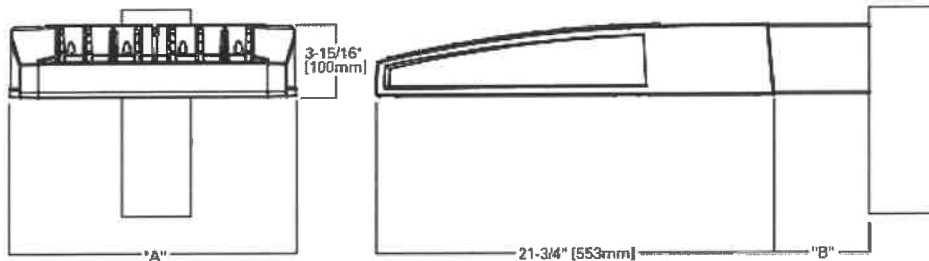

## DIMENSION DATA


Number of Light Squares	"A" Width	"B" Standard Arm Length	"B" Optional Arm Length 1	Weight with Arm (lbs.)	EPA with Arm 2 (Sq. Ft.)
1-4	15-1/2" (394mm)	7" (178mm)	10" (254mm)	33 (15.0 kgs.)	0.96
5-6	21-5/8" (549mm)	7" (178mm)	10" (254mm)	44 (20.0 kgs.)	1.00
7-8	27-5/8" (702mm)	7" (178mm)	13" (330mm)	54 (24.5 kgs.)	1.07
9-10	33-3/4" (857mm)	7" (178mm)	16" (406mm)	63 (28.6 kgs.)	1.12

NOTES: 1. Optional arm length to be used when mounting two fixtures at 90° on a single pole. 2. EPA calculated with optional arm length.



## DRILLING PATTERN

### TYPE "N"



## CERTIFICATION DATA

3G Vibration Rated  
DesignLights Consortium® Qualified\*  
IP66 Rated  
ISO 9001  
LM79 / LM80 Compliant  
UL/cUL Wet Location Listed

## ENERGY DATA


Electronic LED Driver  
>0.9 Power Factor  
<20% Total Harmonic Distortion  
120V-277V 50/60Hz  
347V, 480V 60Hz  
-40°C Min. Temperature  
40°C Max. Temperature  
50°C Max. Temperature (HA Option)



TD500020EN  
July 23, 2019 2:40 PM


**ARM MOUNTING REQUIREMENTS**

Configuration	90° Apart	120° Apart
GLEON-AF-01	7' Arm (Standard)	7' Arm (Standard)
GLEON-AF-02	7' Arm (Standard)	7' Arm (Standard)
GLEON-AF-03	7' Arm (Standard)	7' Arm (Standard)
GLEON-AF-04	7' Arm (Standard)	7' Arm (Standard)
GLEON-AF-05	10' Extended Arm (Required)	7' Arm (Standard)
GLEON-AF-06	10' Extended Arm (Required)	7' Arm (Standard)
GLEON-AF-07	13' Extended Arm (Required)	13' Extended Arm (Required)
GLEON-AF-08	13' Extended Arm (Required)	13' Extended Arm (Required)
GLEON-AF-09	16' Extended Arm (Required)	16' Extended Arm (Required)
GLEON-AF-10	16' Extended Arm (Required)	16' Extended Arm (Required)

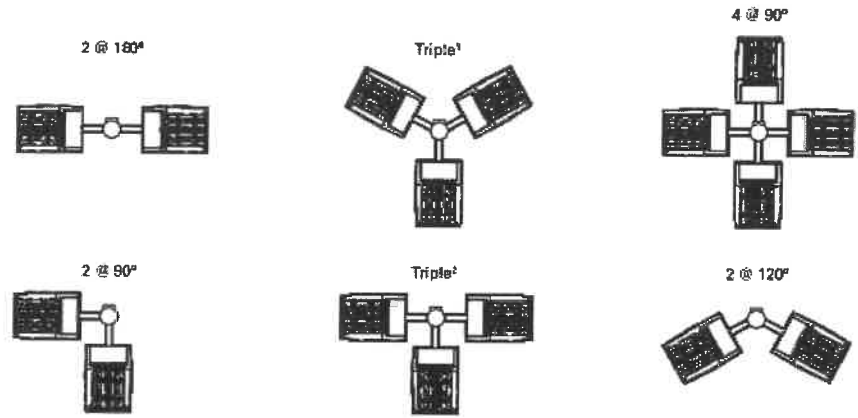


NOTES: 1 Round poles are 3 @ 120°. Square poles are 3 @ 90°. 2 Round poles are 3 @ 90°



**STANDARD WALL MOUNT**

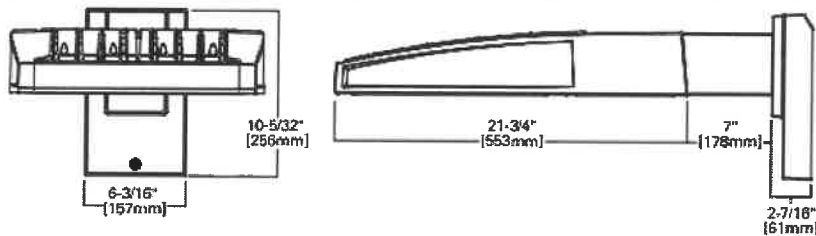

**MAST ARM MOUNT**

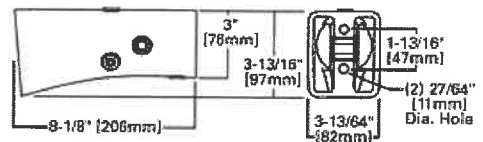

**QUICK MOUNT ARM (INCLUDES FIXTURE ADAPTER)**

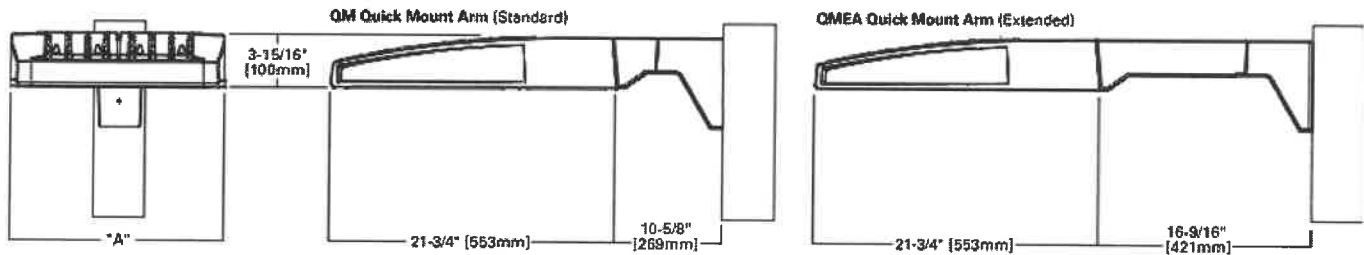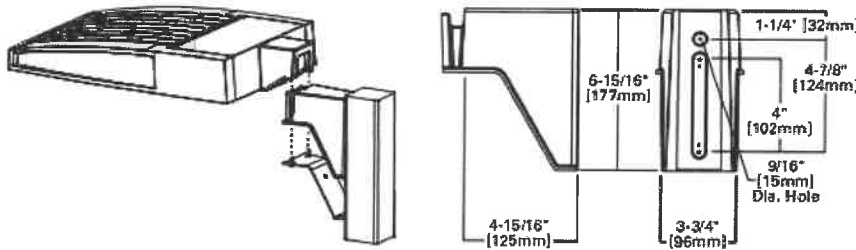


**QUICK MOUNT ARM DATA**


Number of Light Squares 1,2	"A" Width	Weight with QM Arm (lbs.)	Weight with QMEA Arm (lbs.)	EPA (Sq. Ft.)
1-4	15-1/2" (394mm)	35 (15.91 kgs.)	38 (17.27 kgs.)	1.11
5-6 <sup>3</sup>	21-5/8" (549mm)	46 (20.91 kgs.)	49 (22.27 kgs.)	
7-8	27-5/8" (702mm)	58 (25.45 kgs.)	N/A	

NOTES: 1 QM option available with 1-8 light square configurations. 2 QMEA option available with 1-6 light square configurations. 3 QMEA arm to be used when mounting two fixtures at 90° on a single pole.

**OPTIC ORIENTATION**

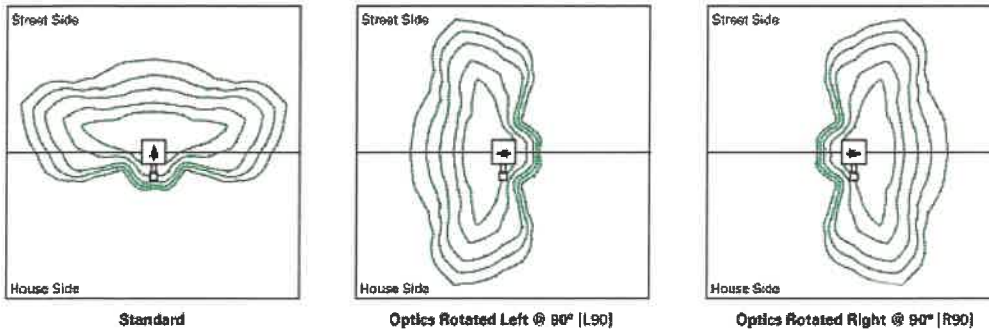

**OPTICAL DISTRIBUTIONS**

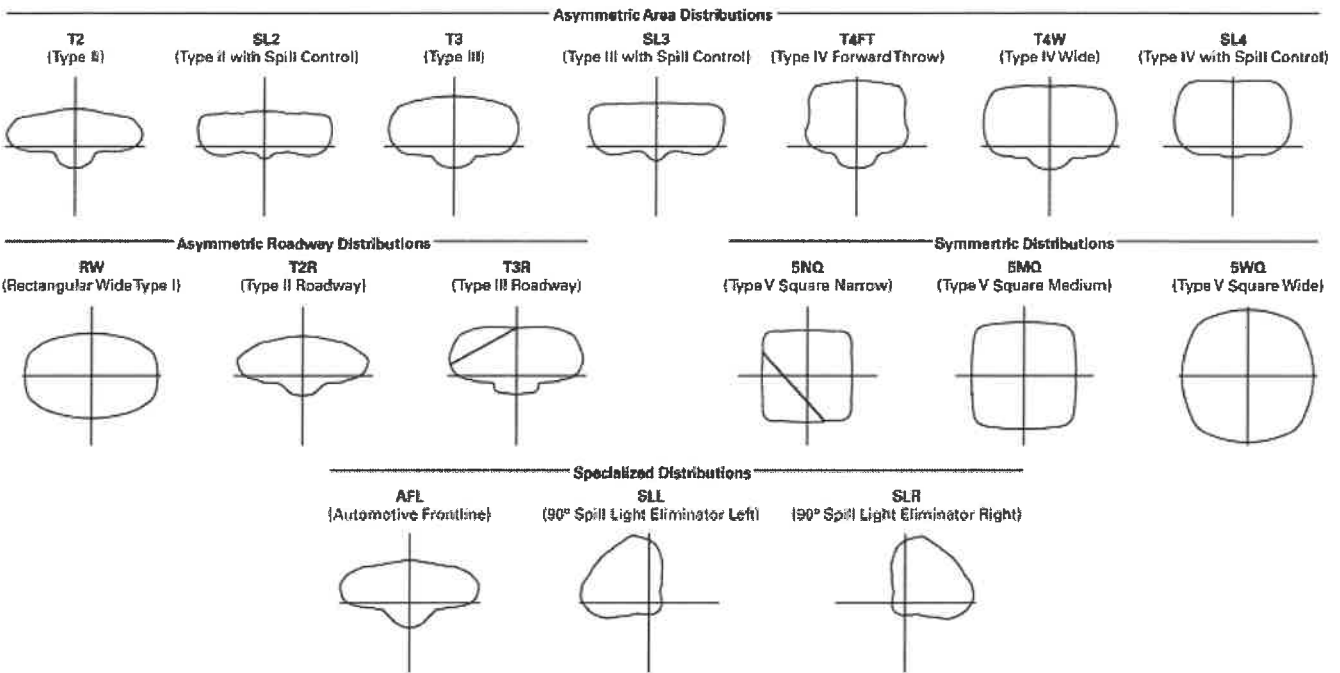


**LUMEN MAINTENANCE**

Drive Current	Ambient Temperature	TM-21 Lumen Maintenance (60,000 Hours)	Projected L70 (Hours)
Up to 1A	Up to 50°C	> 95%	416,000
1.2A	Up to 40°C	> 90%	205,000

**LUMEN MULTIPLIER**

Ambient Temperature	Lumen Multiplier
0°C	1.02
10°C	1.01
25°C	1.00
40°C	0.99
50°C	0.97

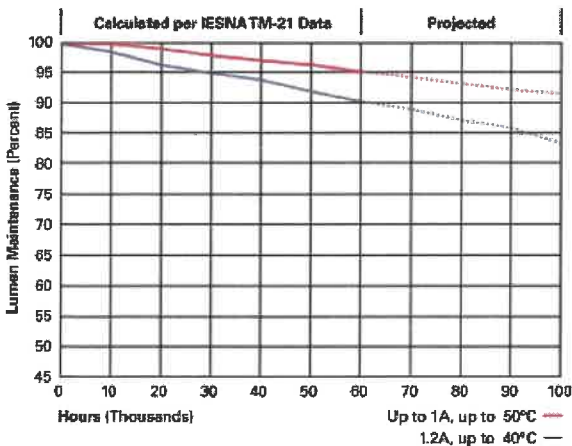



**NOMINAL POWER LUMENS (1.2A)**

Number of Light Squares	1	2	3	4	5	6	7	8	9	10	
Nominal Power (Watts)	67	129	191	258	320	382	448	511	575	640	
Input Current @ 120V (A)	0.58	1.16	1.78	2.31	2.94	3.56	4.09	4.71	5.34	5.87	
Input Current @ 208V (A)	0.33	0.63	0.93	1.27	1.57	1.87	2.22	2.52	2.8	3.14	
Input Current @ 240V (A)	0.29	0.55	0.80	1.10	1.35	1.61	1.93	2.18	2.41	2.71	
Input Current @ 277V (A)	0.25	0.48	0.70	0.96	1.18	1.39	1.69	1.90	2.09	2.36	
Input Current @ 347V (A)	0.20	0.39	0.57	0.78	0.96	1.15	1.36	1.54	1.72	1.92	
Input Current @ 480V (A)	0.15	0.30	0.43	0.60	0.73	0.85	1.03	1.16	1.28	1.45	
<b>Optics</b>											
<b>T2</b>	4000K/5000K Lumens	6,863	13,412	20,011	26,441	32,761	39,205	46,364	52,534	58,601	64,880
	3000K Lumens	6,489	12,681	18,919	25,000	30,974	37,066	43,826	49,668	55,405	61,341
	BUG Rating	B1-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
<b>T2R</b>	4000K/5000K Lumens	7,285	14,238	21,246	28,072	34,780	41,621	49,221	55,770	62,212	68,878
	3000K Lumens	6,888	13,462	20,087	26,541	32,884	39,351	46,537	52,729	58,819	65,122
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5
<b>T3</b>	4000K/5000K Lumens	6,995	13,670	20,397	26,851	33,391	39,959	47,256	53,544	59,728	66,130
	3000K Lumens	6,613	12,924	19,284	25,480	31,570	37,780	44,679	50,624	56,471	62,524
	BUG Rating	B1-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
<b>T3R</b>	4000K/5000K Lumens	7,150	13,973	20,850	27,549	34,134	40,846	48,307	54,734	61,056	67,598
	3000K Lumens	6,761	13,212	19,713	26,048	32,272	38,619	45,673	51,750	57,726	63,911
	BUG Rating	B1-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
<b>T4FT</b>	4000K/5000K Lumens	7,036	13,748	20,615	27,107	33,686	40,191	47,530	53,854	60,074	66,512
	3000K Lumens	6,652	12,999	19,397	25,629	31,754	37,999	44,938	50,917	56,797	62,885
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
<b>T4W</b>	4000K/5000K Lumens	6,945	13,571	20,249	26,756	33,152	39,671	46,917	53,160	59,298	65,653
	3000K Lumens	6,566	12,831	19,148	25,297	31,344	37,508	44,358	50,280	56,064	62,072
	BUG Rating	B1-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
<b>SL2</b>	4000K/5000K Lumens	6,851	13,388	19,977	26,396	32,704	39,137	46,283	52,444	58,498	64,788
	3000K Lumens	6,477	12,658	18,888	24,957	30,920	37,003	43,759	49,584	55,306	61,235
	BUG Rating	B1-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
<b>SL3</b>	4000K/5000K Lumens	6,994	13,668	20,394	26,947	33,388	39,953	47,249	53,537	59,720	66,119
	3000K Lumens	6,612	12,922	19,281	25,477	31,567	37,774	44,673	50,618	56,463	62,514
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
<b>SL4</b>	4000K/5000K Lumens	6,645	12,986	19,378	25,603	31,723	37,962	44,893	50,868	56,743	62,824
	3000K Lumens	6,282	12,279	18,321	24,207	29,993	35,892	42,445	48,084	53,648	59,398
	BUG Rating	B1-U0-G2	B1-U0-G3	B2-U0-G4	B2-U0-G4	B2-U0-G5	B3-U0-G6	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>5NQ</b>	4000K/5000K Lumens	7,214	14,097	21,036	27,795	34,437	41,210	48,734	55,220	61,597	68,199
	3000K Lumens	6,820	13,329	19,888	26,279	32,558	38,962	46,077	52,208	58,237	64,479
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4
<b>5MQ</b>	4000K/5000K Lumens	7,347	14,356	21,423	28,306	35,071	41,969	49,632	56,237	62,730	69,454
	3000K Lumens	6,947	13,573	20,254	26,762	33,158	39,680	46,925	53,170	59,309	65,667
	BUG Rating	B3-U0-G1	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5
<b>5WQ</b>	4000K/5000K Lumens	7,366	14,396	21,480	28,381	35,164	42,080	49,765	56,386	62,898	69,639
	3000K Lumens	6,964	13,610	20,308	26,833	33,247	39,786	47,050	53,311	59,468	65,842
	BUG Rating	B3-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5
<b>SLL/SLR</b>	4000K/5000K Lumens	6,147	12,010	17,921	23,679	29,339	35,109	41,521	47,046	52,478	58,102
	3000K Lumens	5,811	11,355	16,944	22,388	27,739	33,194	39,256	44,479	49,617	54,933
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>RW</b>	4000K/5000K Lumens	7,149	13,970	20,846	27,543	34,126	40,837	48,295	54,722	61,042	67,582
	3000K Lumens	6,760	13,208	19,709	26,041	32,264	38,610	45,661	51,738	57,713	63,897
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G4
<b>AFL</b>	4000K/5000K Lumens	7,175	14,021	20,921	27,643	34,249	40,986	48,470	54,920	61,262	67,828
	3000K Lumens	6,784	13,256	19,780	26,136	32,381	38,750	45,827	51,925	57,922	64,129
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3	B4-U0-G4	B4-U0-G4

\* Nominal data for 70 CRI.

NOMINAL POWER LUMENS (1A)

Number of Light Squares	1	2	3	4	5	6	7	8	9	10	
Nominal Power (Watts)	59	113	166	225	279	333	391	445	501	558	
Input Current @ 120V (A)	0.51	1.02	1.53	2.03	2.55	3.06	3.56	4.08	4.60	5.07	
Input Current @ 208V (A)	0.29	0.56	0.82	1.11	1.37	1.64	1.93	2.19	2.46	2.75	
Input Current @ 240V (A)	0.26	0.48	0.71	0.96	1.19	0.41	1.07	1.89	2.12	2.39	
Input Current @ 277V (A)	0.23	0.42	0.61	0.83	1.03	1.23	1.45	1.65	1.84	2.09	
Input Current @ 347V (A)	0.17	0.32	0.50	0.64	0.82	1.00	1.14	1.32	1.50	1.68	
Input Current @ 480V (A)	0.14	0.24	0.37	0.48	0.61	0.75	0.91	0.99	1.12	1.28	
Optics											
T2	4000K/5000K Lumens	6,256	12,225	18,242	24,104	29,865	35,738	42,265	47,888	53,420	59,144
	3000K Lumens	5,915	11,559	17,248	22,789	28,236	33,790	39,960	45,277	50,506	55,919
	BUG Rating	B1-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
T2R	4000K/5000K Lumens	6,842	12,979	19,366	25,589	31,705	37,941	44,870	50,840	56,711	62,789
	3000K Lumens	6,280	12,271	18,311	24,193	29,976	35,872	42,423	48,068	53,619	59,365
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5
T3	4000K/5000K Lumens	6,377	12,461	18,593	24,568	30,439	36,426	43,077	48,810	54,447	60,282
	3000K Lumens	6,029	11,781	17,580	23,229	28,781	34,441	40,731	46,150	51,480	56,997
	BUG Rating	B1-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
T3R	4000K/5000K Lumens	6,518	12,739	19,006	25,113	31,116	37,235	44,036	49,895	55,858	61,822
	3000K Lumens	6,029	11,781	17,579	23,229	28,779	34,440	40,729	46,148	51,478	56,995
	BUG Rating	B1-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
T4FT	4000K/5000K Lumens	6,414	12,533	18,702	24,710	30,616	36,537	43,328	49,093	54,763	60,631
	3000K Lumens	6,064	11,848	17,681	23,363	28,946	34,638	40,966	46,417	51,776	57,325
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
T4W	4000K/5000K Lumens	6,331	12,372	18,459	24,391	30,221	36,163	42,769	48,459	54,056	59,849
	3000K Lumens	5,988	11,697	17,452	23,061	28,572	34,192	40,436	45,817	51,108	56,585
	BUG Rating	B1-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
SL2	4000K/5000K Lumens	6,245	12,205	18,212	24,062	29,813	35,677	42,192	47,807	53,326	59,042
	3000K Lumens	5,904	11,539	17,218	22,750	28,187	33,732	39,891	45,199	50,418	55,822
	BUG Rating	B1-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5
SL3	4000K/5000K Lumens	6,376	12,460	18,591	24,564	30,436	36,421	43,072	48,803	54,439	60,273
	3000K Lumens	6,028	11,780	17,578	23,224	28,776	34,435	40,723	46,141	51,471	56,986
	BUG Rating	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
SL4	4000K/5000K Lumens	6,058	11,838	17,664	23,340	28,918	34,605	40,924	46,370	51,727	57,269
	3000K Lumens	5,727	11,193	16,701	22,057	27,341	32,718	38,692	43,841	48,908	54,146
	BUG Rating	B1-U0-G2	B1-U0-G3	B2-U0-G4	B2-U0-G4	B2-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
5NQ	4000K/5000K Lumens	6,577	12,851	19,176	25,336	31,392	37,566	44,426	50,337	56,161	62,170
	3000K Lumens	6,218	12,151	18,131	23,955	29,660	35,517	42,003	47,592	53,089	58,779
	BUG Rating	B2-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4
5MQ	4000K/5000K Lumens	6,897	13,088	19,528	25,803	31,970	38,258	45,243	51,264	57,185	63,313
	3000K Lumens	6,332	12,374	18,463	24,395	30,227	36,171	42,776	48,468	54,066	59,861
	BUG Rating	B3-U0-G1	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5
5WQ	4000K/5000K Lumens	6,715	13,122	19,580	25,871	32,055	38,350	45,365	51,401	57,337	63,482
	3000K Lumens	6,348	12,406	18,613	24,461	30,307	36,268	42,891	48,599	54,210	60,021
	BUG Rating	B3-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5
SLL/SLR	4000K/5000K Lumens	5,604	10,949	16,337	21,586	26,745	32,004	37,850	42,886	47,838	52,965
	3000K Lumens	5,298	10,351	15,446	20,409	25,287	30,258	35,786	40,547	45,229	50,077
	BUG Rating	B1-U0-G2	B1-U0-G3	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
RW	4000K/5000K Lumens	6,517	12,735	19,002	25,107	31,109	37,227	44,025	49,893	55,644	61,807
	3000K Lumens	6,162	12,040	17,965	23,738	29,413	35,197	41,623	47,163	52,609	58,247
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4
AFL	4000K/5000K Lumens	6,541	12,781	19,072	25,199	31,221	37,362	44,185	50,865	55,846	61,831
	3000K Lumens	6,184	12,084	18,032	23,825	29,519	35,325	41,775	47,334	52,801	58,459
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3	B4-U0-G4	B4-U0-G4

\* Nominal data for 70 CRI.

**NOMINAL POWER LUMENS (800MA)**

Number of Light Squares	1	2	3	4	5	6	7	8	9	10	
Nominal Power (Watts)	44	85	124	171	210	249	295	334	374	419	
Input Current @ 120V (A)	0.39	0.77	1.13	1.54	1.90	2.26	2.67	3.03	3.39	3.80	
Input Current @ 208V (A)	0.22	0.44	0.62	0.88	1.06	1.24	1.50	1.68	1.87	2.12	
Input Current @ 240V (A)	0.19	0.38	0.54	0.76	0.92	1.08	1.30	1.46	1.62	1.84	
Input Current @ 277V (A)	0.17	0.36	0.47	0.72	0.83	0.95	1.19	1.31	1.42	1.67	
Input Current @ 347V (A)	0.15	0.24	0.38	0.49	0.63	0.77	0.87	1.01	1.15	1.52	
Input Current @ 480V (A)	0.11	0.18	0.29	0.37	0.48	0.59	0.66	0.77	0.88	0.96	
<b>Optics</b>											
<b>T2</b>	4000K/5000K Lumens	5,054	9,878	14,739	19,475	24,129	28,875	34,148	38,691	43,159	47,785
	3000K Lumens	4,779	9,338	13,935	18,412	22,813	27,301	32,286	36,581	40,865	45,179
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B4-U0-G5	B4-U0-G5
<b>T2R</b>	4000K/5000K Lumens	5,366	10,486	15,647	20,675	25,616	30,654	36,252	41,076	45,819	50,730
	3000K Lumens	5,074	9,914	14,794	19,548	24,218	28,982	34,276	38,835	43,320	47,964
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5
<b>T3</b>	4000K/5000K Lumens	5,153	10,068	15,022	19,849	24,593	29,430	34,805	39,436	43,990	48,705
	3000K Lumens	4,872	9,519	14,203	18,766	23,251	27,825	32,907	37,285	41,591	46,048
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B4-U0-G5	B4-U0-G5
<b>T3R</b>	4000K/5000K Lumens	5,266	10,292	15,356	20,290	25,140	30,084	35,578	40,312	44,968	49,786
	3000K Lumens	4,979	9,731	14,518	19,184	23,769	28,443	33,638	38,114	42,516	47,071
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>T4FT</b>	4000K/5000K Lumens	5,182	10,126	15,109	19,964	24,736	29,600	35,006	39,664	44,245	48,987
	3000K Lumens	4,899	9,574	14,285	18,876	23,387	27,986	33,097	37,501	41,832	46,315
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>T4W</b>	4000K/5000K Lumens	5,115	9,995	14,914	19,706	24,417	29,218	34,554	39,152	43,674	48,354
	3000K Lumens	4,836	9,450	14,100	18,631	23,085	27,824	32,670	37,017	41,292	45,717
	BUG Rating	B1-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5
<b>SL2</b>	4000K/5000K Lumens	5,046	9,860	14,713	19,441	24,087	28,825	34,089	38,625	43,085	47,702
	3000K Lumens	4,771	9,322	13,911	18,381	22,774	27,253	32,229	36,518	40,735	45,101
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B4-U0-G5
<b>SL3</b>	4000K/5000K Lumens	5,152	10,067	15,020	19,846	24,591	29,426	34,800	39,431	43,984	48,698
	3000K Lumens	4,871	9,518	14,200	18,764	23,249	27,822	32,902	37,280	41,585	46,042
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>SL4</b>	4000K/5000K Lumens	4,894	9,565	14,271	18,857	23,364	27,959	33,065	37,465	41,792	46,270
	3000K Lumens	4,627	9,043	13,492	17,829	22,090	26,434	31,261	35,422	39,513	43,746
	BUG Rating	B1-U0-G2	B1-U0-G3	B1-U0-G3	B2-U0-G4	B2-U0-G4	B2-U0-G4	B2-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>5WQ</b>	4000K/5000K Lumens	5,313	10,383	15,493	20,470	25,363	30,351	35,893	40,669	45,367	50,229
	3000K Lumens	5,024	9,817	14,647	19,354	23,980	28,696	33,936	38,452	42,893	47,490
	BUG Rating	B2-U0-G1	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3	B5-U0-G3
<b>5MQ</b>	4000K/5000K Lumens	5,411	10,574	15,778	20,848	25,830	30,911	36,554	41,418	46,202	51,154
	3000K Lumens	5,117	9,997	14,917	19,710	24,421	29,225	34,561	39,160	43,682	48,384
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G4
<b>5WQ</b>	4000K/5000K Lumens	5,426	10,603	15,820	20,903	25,899	30,992	36,652	41,529	46,325	51,290
	3000K Lumens	5,130	10,025	14,958	19,763	24,486	29,302	34,654	39,263	43,799	48,493
	BUG Rating	B3-U0-G1	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5
<b>SLL/SLR</b>	4000K/5000K Lumens	4,528	8,846	13,199	17,440	21,609	25,858	30,580	34,649	38,651	42,792
	3000K Lumens	4,261	8,364	12,480	16,489	20,430	24,448	28,912	32,759	36,543	40,459
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>RW</b>	4000K/5000K Lumens	5,265	10,289	15,353	20,285	25,134	30,077	35,569	40,303	44,958	49,775
	3000K Lumens	4,978	9,727	14,516	19,179	23,763	28,437	33,629	38,105	42,506	47,080
	BUG Rating	B2-U0-G1	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3	B5-U0-G4
<b>AFL</b>	4000K/5000K Lumens	5,285	10,327	15,409	20,360	25,225	30,186	35,699	40,450	45,120	49,956
	3000K Lumens	4,996	9,783	14,569	19,249	23,849	28,540	33,752	38,244	42,659	47,232
	BUG Rating	B1-U0-G1	B1-U0-G1	B2-U0-G2	B2-U0-G2	B3-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3

\* Nominal data for 70 CRI.

**NOMINAL POWER LUMENS (600MA)**

Number of Light Squares	1	2	3	4	5	6	7	8	9	10	
Nominal Power (Watts)	34	68	96	129	162	193	226	257	290	323	
Input Current @ 120V (A)	0.30	0.58	0.86	1.16	1.44	1.73	2.03	2.33	2.59	2.89	
Input Current @ 208V (A)	0.17	0.34	0.49	0.65	0.84	0.99	1.14	1.30	1.48	1.63	
Input Current @ 240V (A)	0.15	0.30	0.43	0.56	0.74	0.87	1.00	1.13	1.30	1.43	
Input Current @ 277V (A)	0.14	0.28	0.41	0.52	0.69	0.81	0.93	1.04	1.22	1.33	
Input Current @ 347V (A)	0.11	0.19	0.30	0.39	0.49	0.60	0.69	0.77	0.90	0.99	
Input Current @ 480V (A)	0.08	0.15	0.24	0.30	0.38	0.48	0.53	0.59	0.71	0.77	
<b>Optics</b>											
<b>T2</b>	4000K/5000K Lumens	4,121	8,055	12,019	15,881	19,676	23,547	27,847	31,552	35,196	38,967
	3000K Lumens	3,896	7,815	11,363	15,015	18,604	22,263	26,328	29,831	33,276	36,842
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G4
<b>T2R</b>	4000K/5000K Lumens	4,376	8,552	12,760	16,860	20,890	24,998	29,563	33,497	37,365	41,369
	3000K Lumens	4,138	8,085	12,064	15,941	19,751	23,635	27,951	31,670	35,328	39,113
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4
<b>T3</b>	4000K/5000K Lumens	4,201	8,210	12,251	16,187	20,055	23,999	28,383	32,159	35,873	39,718
	3000K Lumens	3,973	7,763	11,593	15,304	18,961	22,691	26,835	30,406	33,916	37,552
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5
<b>T3R</b>	4000K/5000K Lumens	4,294	8,393	12,523	16,546	20,501	24,532	29,014	32,975	36,571	40,600
	3000K Lumens	4,060	7,936	11,840	15,644	19,383	23,195	27,432	31,082	34,671	38,386
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5
<b>T4FT</b>	4000K/5000K Lumens	4,226	8,257	12,321	16,280	20,172	24,139	28,547	32,346	36,082	39,848
	3000K Lumens	3,986	7,807	11,649	15,392	19,071	22,822	26,990	30,582	34,114	37,770
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G2	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>T4W</b>	4000K/5000K Lumens	4,171	8,151	12,182	16,071	19,912	23,827	28,178	31,928	35,615	39,432
	3000K Lumens	3,943	7,706	11,498	15,194	18,825	22,527	26,642	30,187	33,673	37,281
	BUG Rating	B1-U0-G1	B2-U0-G2	B2-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5
<b>SL2</b>	4000K/5000K Lumens	4,114	8,041	11,998	15,854	19,643	23,506	27,799	31,498	35,135	38,901
	3000K Lumens	3,890	7,603	11,344	14,989	18,572	22,224	26,282	29,780	33,219	36,779
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G3	B2-U0-G3	B3-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5
<b>SL3</b>	4000K/5000K Lumens	4,200	8,209	12,249	16,184	20,053	23,996	28,379	32,154	35,869	39,712
	3000K Lumens	3,972	7,762	11,580	15,302	18,960	22,888	26,831	30,400	33,913	37,546
	BUG Rating	B1-U0-G1	B1-U0-G2	B2-U0-G3	B2-U0-G3	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5
<b>SL4</b>	4000K/5000K Lumens	3,992	7,799	11,638	15,378	19,053	22,801	26,964	30,562	34,081	37,733
	3000K Lumens	3,774	7,374	11,003	14,539	18,015	21,657	25,493	28,886	32,222	35,674
	BUG Rating	B1-U0-G2	B1-U0-G2	B1-U0-G3	B1-U0-G3	B2-U0-G4	B2-U0-G4	B2-U0-G4	B2-U0-G5	B2-U0-G5	B3-U0-G5
<b>5NQ</b>	4000K/5000K Lumens	4,333	8,467	12,634	16,694	20,683	24,751	29,271	33,166	36,996	40,961
	3000K Lumens	4,097	8,005	11,945	15,784	19,555	23,401	27,674	31,357	34,978	38,727
	BUG Rating	B2-U0-G1	B3-U0-G1	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G2	B5-U0-G3	B5-U0-G3
<b>5MQ</b>	4000K/5000K Lumens	4,413	8,822	12,987	17,000	21,064	25,207	29,810	33,777	37,677	41,715
	3000K Lumens	4,173	8,152	12,165	16,073	19,915	23,832	28,185	31,934	35,823	39,440
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4
<b>5WQ</b>	4000K/5000K Lumens	4,424	8,646	12,900	17,046	21,120	25,274	29,890	33,866	37,778	41,826
	3000K Lumens	4,182	8,175	12,197	16,117	19,968	23,896	28,260	32,018	35,717	39,545
	BUG Rating	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G4	B5-U0-G4	B5-U0-G4	B5-U0-G4
<b>SLL/SLR</b>	4000K/5000K Lumens	3,892	7,214	10,763	14,222	17,621	21,086	24,937	28,256	31,519	34,897
	3000K Lumens	3,491	6,820	10,176	13,447	16,660	19,937	23,577	26,715	29,800	32,994
	BUG Rating	B1-U0-G1	B1-U0-G2	B1-U0-G3	B2-U0-G3	B2-U0-G3	B2-U0-G4	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5
<b>RW</b>	4000K/5000K Lumens	4,293	8,390	12,520	16,542	20,498	24,527	29,007	32,866	36,662	40,591
	3000K Lumens	4,059	7,932	11,837	15,640	19,378	23,189	27,425	31,074	34,662	38,377
	BUG Rating	B2-U0-G1	B3-U0-G1	B3-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B4-U0-G2	B5-U0-G3	B5-U0-G3	B5-U0-G3
<b>AFL</b>	4000K/5000K Lumens	4,310	8,421	12,586	16,602	20,571	24,618	29,112	32,986	36,795	40,738
	3000K Lumens	4,074	7,962	11,881	15,697	19,448	23,273	27,525	31,187	34,788	38,516
	BUG Rating	B1-U0-G1	B1-U0-G1	B2-U0-G2	B2-U0-G2	B2-U0-G2	B3-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G3

\* Nominal data for 70 CRI.

**CONTROL OPTIONS**

**0-10V (DIM)**

This fixture is offered standard with 0-10V dimming driver(s). The DIM option provides 0-10V dimming wire leads for use with a lighting control panel or other control method.

**Photocontrol (P, R and PER7)**

Optional button-type photocontrol (P) and photocontrol receptacles (R and PER7) provide a flexible solution to enable "dusk-to-dawn" lighting by sensing light levels. Advanced control systems compatible with NEMA 7-pin standards can be utilized with the PER7 receptacle.





**After Hours Dim (AHD)**

This feature allows photocontrol-enabled luminaires to achieve additional energy savings by dimming during scheduled portions of the night. The dimming profile will automatically take effect after a "dusk-to-dawn" period has been calculated from the photocontrol input. Specify the desired dimming profile for a simple, factory-shipped dimming solution requiring no external control wiring. Reference the After Hours Dim supplemental guide for additional information.

**Dimming Occupancy Sensor (MS/DIM-LXX, MS/X-LXX and MS-LXX)**



These sensors are factory installed in the luminaire housing. When the MS/DIM-LXX sensor option is selected, the occupancy sensor is connected to a dimming driver and the entire luminaire dims when there is no activity detected. When activity is detected, the luminaire returns to full light output. The MS/DIM sensor is factory preset to dim down to approximately 50 percent power with a time delay of five minutes. The MS-LXX sensor is factory preset to turn the luminaire off after five minutes of no activity. The MS/X-LXX is also preset for five minutes and only controls the specified number of light engines to maintain steady output from the remaining light engines.

These occupancy sensors includes an integral photocell that can be activated with the FSIR-100 accessory for "dusk-to-dawn" control or daylight harvesting - the factory preset is OFF. The FSIR-100 is a wireless tool utilized for changing the dimming level, time delay, sensitivity and other parameters. A variety of sensor lens are available to optimize the coverage. pattern for mounting heights from 8'-40'.

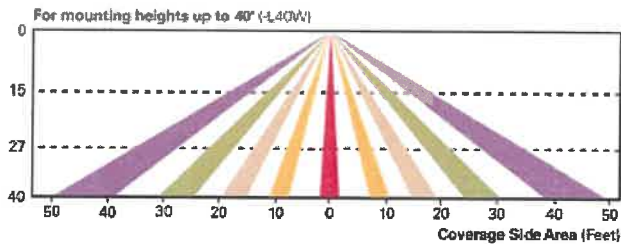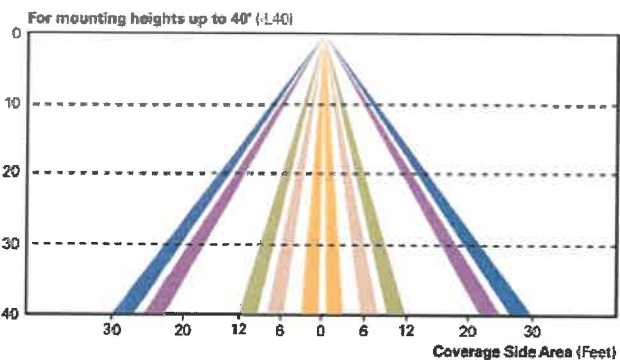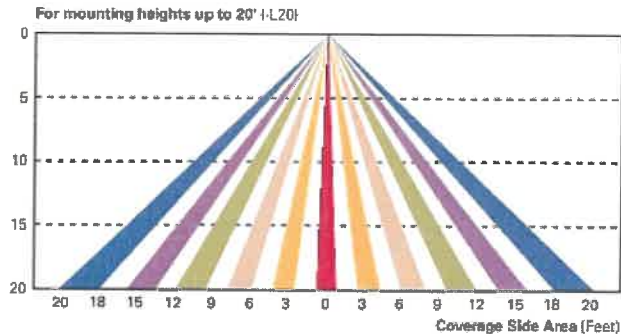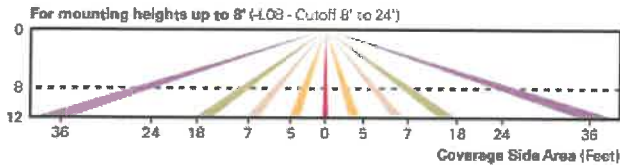

**LumaWatt Pro Wireless Control and Monitoring System (LWR-LW and LWR-LN)**

The Eaton's LumaWatt Pro powered by Enlighted is a connected lighting solution that combines a broad selection of energy-efficient LED luminaires with a powerful integrated wireless sensor system. The sensor controls the lighting system in compliance with the latest energy codes and collects valuable data about building performance and use. Software applications turn the granular data into information through energy dashboards and specialized apps that make it simple and help optimize the use of building resources, beyond lighting.

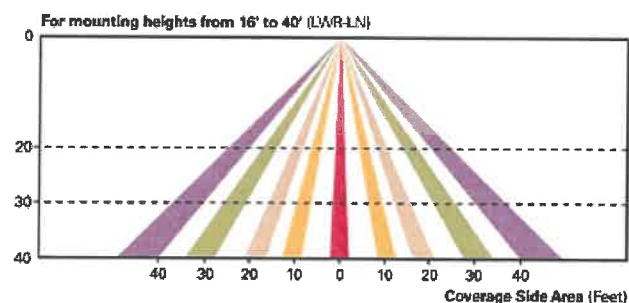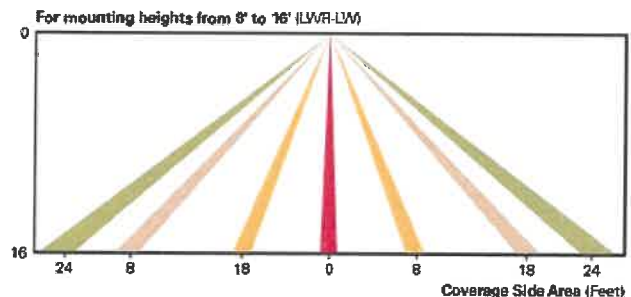

**WaveLinX Wireless Outdoor Lighting Control Module (WOLC-7P-10A)**

The 7-pin wireless outdoor lighting control module enables WaveLinX to control outdoor area, site and flood lighting. WaveLinX controls outdoor lighting using schedules to provide ON, OFF and dimming controls based on astronomic or time schedules based on a 7 day week.

**LumenSafe Integrated Network Security Camera (LD)**

Eaton brings ease of camera deployment to a whole new level. No additional wiring is needed beyond providing line power to the luminaires. A variety of networking options allows security integrators to design the optimal solution for active surveillance. As the ideal solution to meet the needs for active surveillance, the LumenSafe integrated network camera is a streamlined, outdoor-ready fixed dome that provides HDTV 1080p video. This IP camera is optimally designed for deployment in the video management system or security software platform of choice.

ORDERING INFORMATION

Sample Number: GLEON-AF-04-LED-E1-T3-GM-QM

Product Family 1,2	Light Engine	Number of Light Squares 3	Lamp Type	Voltage	Distribution	Color	Mounting
GLEON=Catcon	AF=1A Drive Current	01=1 02=2 03=3 04=4 05=5 4 06=6 07=7 5 08=8 5 09=9 4 10=10 4	LED=Soled State Light Emitting Diodes	E1=120-277V 347=347V 7 480=480V 13	T2=Type II T2R=Type II Roadway T3=Type III T3R=Type III Roadway T4FI=Type IV Forward Throw T4W=Type IV Wide 5N0=Type V Narrow 5M0=Type V Square Medium 5W0=Type V Square Wide SL2=Type II w/Spill Control SL3=Type III w/Spill Control SL4=Type IV w/Spill Control SLL=90° Spill Light Eliminator Left SLR=90° Spill Light Eliminator Right FW=Rectangular Wide Type I APL=Automotive Frontline	AP=Gray BZ=Bronze BK=Black DP=Dark Platinum GM=Graphite Metallic WH=White	[Blank]=Arm for Round or Square Pole EA=Extended Arm 7 MA=Master Arm Adapter 10 WM=Wall Mount QM=Quick Mount Arm (Standard Length) 11 QMEA=Quick Mount Arm (Extended Length) 12
Options (Add as Suffix)						Accessories (Order Separately)	
7027=70 CRI 2700K 17 7030=70 CRI 3000K 17 8030=80 CRI 3000K 17 7050=70 CRI 5000K 17 7080=70 CRI 6000K 17 600=Drive Current Set to Nominal 600mA 25 800=Drive Current Set to Nominal 800mA 25 1200=Drive Current Set to Nominal 1200mA 25, 26 F=Single Fuse (120, 277 or 347V, Specify Voltage) FF=Double Fuse (120, 240 or 480V, Specify Voltage) 2L=Two Circuits 14, 18 DIM=External 0-10V Dimming Leads 18, 20 AHD145=After Hours Dim, 5 Hours 22 AHD245=After Hours Dim, 6 Hours 22 AHD355=After Hours Dim, 7 Hours 22 AHD555=After Hours Dim, 8 Hours 22 HA=50°C High Ambient 23 L90=Optics Rotated 90° Left R90=Optics Rotated 90° Right MIT=Installed Mesh Top TH=Tool-less Door Hardware HSS=Installed House Side Shield 28 CE=CE Marking 29 LCF=Light Square Trim Painted to Match Housing 27						CA/RA 1016=NEMA Photocontrol Multi-Tap - 105-285V CA/RA 1027=NEMA Photocontrol - 480V CA/RA 1201=NEMA Photocontrol - 347V CA/RA 1013=Photocontrol Shorting Cap CA/RA 1014=120V Photocontrol MA1252=10kV Surge Module Replacement MA1036-X0=Single Tenon Adapter for 3-1/2" O.D. Tenon MA1037-X0=2@180° Tenon Adapter for 2-3/8" O.D. Tenon MA1197-X0=3@120° Tenon Adapter for 2-3/8" O.D. Tenon MA1188-X0=4@90° Tenon Adapter for 2-3/8" O.D. Tenon MA1189-X0=2@90° Tenon Adapter for 2-3/8" O.D. Tenon MA1190-X0=3@90° Tenon Adapter for 2-3/8" O.D. Tenon MA1191-X0=2@120° Tenon Adapter for 2-3/8" O.D. Tenon MA1038-X0=Single Tenon Adapter for 3-1/2" O.D. Tenon MA1039-X0=2@180° Tenon Adapter for 3-1/2" O.D. Tenon MA1192-X0=3@120° Tenon Adapter for 3-1/2" O.D. Tenon MA1193-X0=4@90° Tenon Adapter for 3-1/2" O.D. Tenon MA1194-X0=2@90° Tenon Adapter for 3-1/2" O.D. Tenon MA1195-X0=3@90° Tenon Adapter for 3-1/2" O.D. Tenon FSIR-100=Wireless Configuration Tool for Occupancy Sensor 24 GLEON-MT1=Field Installed Mesh Top for 1-4 Light Squares GLEON-MT2=Field Installed Mesh Top for 5-6 Light Squares GLEON-MT3=Field Installed Mesh Top for 7-8 Light Squares GLEON-MT4=Field Installed Mesh Top for 9-10 Light Squares GLEON-QM=Quick Mount Arm Kit 7 GLEON-QMEA=Quick Mount Extended Arm Kit 12 LS/HSS=Field Installed House Side Shield 28, 29 WOLC-7P-10A=Wavelinx Outdoor Control Module 19, 31 SWPD4-WH=Wavelinx Wireless Sensor, 7 - 15' Mounting Height, White 19, 33, 34 SWPD4-BZ=Wavelinx Wireless Sensor, 7 - 15' Mounting Height, Bronze 19, 33, 34 SWPD5-WH=Wavelinx Wireless Sensor, 15 - 40' Mounting Height, White 19, 33, 34 SWPD5-BZ=Wavelinx Wireless Sensor, 15 - 40' Mounting Height, Bronze 19, 33, 34	

NOTES:

1 Customer is responsible for engineering analysis to confirm pole and fixture compatibility for all applications. Refer to our white paper WP513001EN for additional support information. 2 Design Lights Consortium Qualified. Refer to [www.designlights.org](http://www.designlights.org) Qualified Products List under Family Models for details. 3 Standard 4800K CCT and minimum 70 CRI. 4 Not compatible with MS14-LXX or MS21-LXX sensors. 5 Not compatible with extended quick mount arm (QMEA). 6 Not compatible with standard quick mount arm (QM) or extended quick mount arm (QMEA). 7 Requires the use of an integral step down transformer when combined with sensor options. Not available with sensor at 1200mA. 8 Not available in combination with the HA high ambient and sensor options at 14. 9 Only for use with 480V Wye systems. Par NEC, not for use with ungrounded systems, impedance grounded systems or corner grounded systems (commonly known as Three Phase Three Wire Delta, Three Phase High Leg Delta and Three Phase Corner Grounded Delta systems). 9 May be required when two or more luminaires are oriented on a 90° or 120° drilling pattern. Refer to arm mounting requirement table. 10 Factory installed. 11 Maximum 8 light squares. 12 Maximum 6 light squares. 13 Extended lead times apply. Use dedicated IES files for 2700K, 3000K, 5000K and 6000K when performing layouts. 14 Reserved 15 1 Amp standard. Use dedicated IES files for 600mA, 800mA and 1200mA when performing layouts. 16 Not available with HA option. 17 2L is not available with MS, MS/X or MS/DIM at 347V or 480V. 2L in AF-02 through AF-04 requires a larger housing, normally used for AF-05 or AF-06. Extended arm option may be required when mounting two or more fixtures per pole at 80° or 120°. Refer to arm mounting requirement table. 18 Not available with LumaWatt Pro wireless sensors. 19 Cannot be used with other control options. 20 Low voltage control lead brought out 18" outside fixture. 21 Not available if any "MS" sensor is selected. Motion sensor has an integral photocell. 22 Requires the use of P photocontrol or the PER7 or R photocontrol receptacle with photocontrol accessory. See After Hours Dim supplemental guide for additional information. 23 50°C lumen maintenance data applies to 600mA, 800mA and 1A drive currents. 24 The FSIR-100 configuration tool is required to adjust parameters including high and low modes, sensitivity, time delay, and more. Consult your lighting representative at Eaton for more information. 25 Replaces X with number of Light Squares operating in low output mode. 26 LumaWatt Pro wireless sensors are factory installed only requiring network components LWP-EM-1, LWP-GW-1 and LWP-PoE in appropriate quantities. See [www.eaton.com/lighting](http://www.eaton.com/lighting) for LumaWatt Pro application information. 27 Not available with house side shield (HSS). 28 Only for use with SL2, SL3, SL4 and AFL distributions. The Light Square trim plate is painted black when the HSS option is selected. 29 CE is not available with the LWR, MS, MS/X, MS/DIM, P, R or PER7 options. Available in 120-277V only. 30 One required for each Light Square. 31 Requires PER7. 32 Reserved. 33 WAC Gateway required to enable field-configurability. Order WAC-PoE and WPOE-120 (10V to PoE injector) power supply if needed. 34 Requires ZW. 35 Reserved.

LumenSafe Integrated Network Security Camera Technology Options (Add as Suffix)

Product Family	Camera Type	Data Backup	
L=LumenSafe Technology*	D=Dome Camera, Standard H=Dome Camera, Hi-Res Z=Dome Camera, Remote PTZ	C=Cellular, Customer Installed SIM Card A=Cellular, Factory Installed AT&T SIM Card V=Cellular, Factory Installed Verizon SIM Card S=Cellular, Factory Installed Sprint SIM Card	W=Wi-Fi Networking w/ Omni-Directional Antenna E=Ethernet Networking

\*Consult LumenSafe system pages for additional details and compatibility.