



**III. C.**

---

690 Chesterfield Pkwy W • Chesterfield MO 63017-0760  
Phone: 636-537-4000 • Fax 636-537-4798 • www.chesterfield.mo.us

---

## Architectural Review Board Staff Report

**Project Type:** Site Development Section Plan

**Meeting Date:** May 12, 2016

**From:** Jessica Henry  
Project Planner

**Cc:** Aimee Nassif, Planning & Development Services Director

**Location:** 11 Arnage Road

**Applicant:** Thouvenot, Wade, & Moerchen, Inc. on behalf of PGB Investments

**Description:** **River Crossings, Lot 4 (Holiday Inn Express)**: A Site Development Section Plan, Landscape Plan, Lighting Plan, Architectural Elevations and Architect's Statement of Design for a 3.17 acre tract of land zoned "PC" Planned Commercial District located east of Arnage Rd., north of Chesterfield Airport Road.

---

### **PROPOSAL SUMMARY**

The request is for a four story, 91 room hotel located within the Chesterfield Commons Six development. The proposed hotel is 52,278 square feet in size and will be located on Lot 4, which is 3.17 acres in size. The River Crossings development is zoned "PC" Planned Commercial District and is governed under the terms and conditions of City of Chesterfield Ordinance 2556. The exterior building materials will be comprised of EIFS, stone, brick, and a blue painted metal canopy. The roof of the structure will be a flat roof with a parapet wall to screen roof-mounted mechanical units.

The request was presented for review by the Architectural Review Board (ARB) at the February 11, 2016 and April 14, 2016 meetings. A number of concerns were raised by Staff and ARB members and a recommendation for denial was passed at each meeting. Following these meetings, Staff prepared a letter detailing these concerns. As the applicant/project representative was not present at the April 14, 2016 ARB meeting, the applicant subsequently met with Staff and made revisions to the submittal and has requested to reappear before the ARB.



*Aerial Image of Subject Site and River Crossings Development*

A summary of the concerns raised by the Architectural Review Board and discussed at length during the meeting along with Staff input follows.

- 1. While the primary building material is supposed to be brick in two colors, the architectural elevations and renderings portrays the building colors differently in each of the three different versions.**

The applicant has submitted revised architectural drawings for the ARB's consideration.

- 2. The rooftop units are shown as screened but questions arose as to whether the entire units are adequately screened. Consistency in depicted height of equipment between the elevations and the sight line study is needed.**

The parapets have been raised and the applicant has confirmed that the sight line study is accurate.

- 3. Clarification of details such as color and material for various minor building elements is necessary.**

The material schedule has been revised.

- 4. Adequate information regarding the window and fence colors and materials was not provided.**

The applicant will be bringing a material sample of the proposed glass and fence.

- 5. A more neutral tone should be considered for the EIFs elements and the joints shown.**

The EIFs color has been revised to a neutral beige color and the joints are now shown.

6. ***While the integration of additional brick patterns for variation should be considered, the vertical stripes of red brick on the façade detract from the simplistic form of the building.***

Brick soldier courses have been added above the windows of all four elevations and the red brick stripes have been removed from the façade.

Below is a comparison of the previously reviewed and currently proposed Architectural Elevations.



***Architectural Elevation presented at 02/11/16 ARB Meeting***



***Architectural Elevation presented at 04/14/16 ARB Meeting***



***Currently proposed Architectural Elevation***

### **SUMMARY OF INFORMATION PROVIDED IN 02/11/16 ARB MEETING REPORT**

The subject site is located within the River Crossings development which contains eight separate lots and six buildings to date. The applicant is proposing a four story building of nearly forty-eight feet in height and 52,278 square feet in size. Although this is the tallest building in the development, Ordinance 2566 specifically limits the building on the subject site to four stories and forty-eight feet in height, exclusive of parapets and roof screening, whereas a maximum of three stories and forty-five feet is prescribed for the other lots within the development.

Ordinance 2566 includes specific design guidelines for the River Crossings development. Below is a listing of the applicable guidelines (in italics) for the proposed Holiday Inn Express along with Staff input (in bold).

1. *A minimum of seventy-five (75%) of the exterior walls of all buildings will be constructed of brick masonry units.* **The building is constructed primarily of brick in two colors.**
2. *Building facades should be articulated using color, arrangement, or change in materials to emphasize the façade elements. The planes of the exterior walls may be varied in height, depth, or direction. Extremely long facades shall be designed with sufficient building articulations and landscaping to avoid a monotonous or overpowering appearance.* **As discussed above, the applicant has introduced greater articulation into the building design and has altered the material patterns and arrangement.**
3. *All rooftop equipment will be screened from normal mid-range view lines by building parapets and/or roof screens constructed of metal.* **The applicant is proposing roof parapets that will fully screen the rooftop equipment, as shown by the sight-line study included in the submittal packets.**
4. *Service areas and trash enclosures will also be constructed of brick masonry units. Gates will be made of unpainted wood boards.* **The trash enclosure is constructed of the same brick as the primary building. Cedar wood gates are proposed.**

The lighting plan proposes the typical fully shielded, full cut-off pole mounted parking lot light fixtures and building entry wall mounted light fixtures. Additionally, canopy light fixtures are proposed at the entry. Each of these fixtures meets City code requirements.

Finally, no changes are proposed to the previously presented Landscape Plan.

### **DEPARTMENTAL INPUT**

Staff is requesting recommendations from the ARB on the Site Development Section Plan, Landscape Plan, Lighting Plan, Architectural Elevations and Architect's Statement of Design. Be advised, this project is still going through development review by City Staff and will not proceed to the Planning Commission until all outstanding items have been addressed. All recommendations made by the ARB will be included in Staff's report to the Planning Commission.

**MOTION**

The following options are provided to the Architectural Review Board for consideration relative to this application:

- 1) "I move to forward the Site Development Section Plan, Landscape Plan, Lighting Plan, Architectural Elevations and Architect's Statement of Design for River Crossings, Lot 4 (Holiday Inn Express), as presented, with a recommendation for approval (or denial) to the Planning Commission."
- 2) "I move to forward the Site Development Section Plan, Landscape Plan, Lighting Plan, Architectural Elevations and Architect's Statement of Design for River Crossings, Lot 4 (Holiday Inn Express), to the Planning Commission with a recommendation for approval with the following conditions..."

Attachments

1. Architectural Review Packet Submittal



ARCHITECTURAL REVIEW BOARD  
Project Statistics and Checklist



Date of First Comment Letter Received from the City of Chesterfield 6-18-2015

Project Title: HOLIDAY INN EXPRESS Location: RIVER CROSSINGS - LOT 4

Developer: PGB INVESTMENTS Architect: ENVIRONS ARCHITECTS Engineer: TWM, INC.

PROJECT STATISTICS:

Size of site (in acres): 3.17 AC Total Square Footage: 52,278<sup>SF</sup> Building Height: 47'-10 1/2"

Proposed Usage: HOTEL

Exterior Building Materials: BRICK + STONE MASONRY W/ EIFS ACCENT

Roof Material & Design: FLAT ROOF - TPO MEMBRANE

Screening Material & Design: BUILDING PARAPET

Description of art or architecturally significant features (if any): CONTEMPORARY STRUCTURE WITH VARIETY OF COLOR + TEXTURE

ADDITIONAL PROJECT INFORMATION:

Checklist: Items to be provided in an 11" x 17" format

- Color Site Plan with contours, site location map, and identification of adjacent uses.
- Color elevations for all building faces.
- Color rendering or model reflecting proposed topography.
- Photos reflecting all views of adjacent uses and sites.
- Details of screening, retaining walls, etc.
- Section plans highlighting any building off-sets, etc. (as applicable)
- Architect's Statement of Design which clearly identifies how each section in the Standards has been addressed and the intent of the project.
- Landscape Plan.
- Lighting cut sheets for any proposed building lighting fixtures. (as applicable)
- Large exterior material samples. (to be brought to the ARB meeting)
- Any other exhibits which would aid understanding of the design proposal. (as applicable)
- Pdf files of each document required.

## Architects Statement of Design

The Holiday Inn Express + Suites is to provide for the long term satisfaction of the guests as well as minimizing undesirable impacts on the surrounding neighbors. This building is located within the setback requirements and easements. The site has been designed in keeping with the open space requirements and compliments the neighborhood. The automobile parking surrounds the building on all sides and are landscaped in order to provide pleasing views from the adjacent roads and properties.

Site lighting is limited to the parking areas and safety lighting around the hotel and will not illuminate off the site. Care has been taken to minimize spillage of light from the site in consideration of the surrounding property owners.

The building is set back from the roadway to allow for good visibility for vehicular traffic, pedestrians and bicyclers. The parking proposed provides the most direct and safe access to the building. There are proposed access points are located on Arnage Road to the south and Arnage Blvd. to the north. Pedestrian access points to the site are provided from the north and from the south. The trash enclosure will be screened by a minimum 6' tall enclosure constructed of materials similar to the proposed building.

This building has been designed to franchise standards with many upgrades. The entirety of the building is made up of brick complimented by and EIFS band at the top and stone trim accenting the brick masonry elevations and providing a high quality visual appearance for all users within contact of the building. The brick has been selected from a residential collection with a warm earth tone feelings. The exterior of the hotel has been designed using an up-to-date style in an appropriate human scale with multiple offsets and material / color changes. A diversity of high quality materials have been used to provide a pleasing and harmonious appearance. The roof parapets have been designed to screen the rooftop fresh air HVAC equipment, elevator projection and linen chute caps.

This building is designed with efficient systems that allow control over unoccupied rooms adjusting heating and cooling on systems to lower levels when unoccupied. Utility locations and connections to the building have been coordinated so that all utilities are underground and screened from view or landscaped in order to minimize the visual impact on public streets.

A handwritten signature in black ink, appearing to read "Michael F. Sapp". The signature is stylized and cursive, with the first name "Michael" being the most prominent part.

Michael F. Sapp  
Environs Architects-Planners









TYPES A, B + C



**Cooper Lighting**

by **FAT•N**

Innovation you can rely on™



## Area and Site Lighting Redefined

### A New Benchmark in Performance and Features

The Galleon LED luminaire delivers a new level of performance and versatility for commercial area, site and roadway applications. Incorporating industry-leading, patented optics, the Galleon LED luminaire offers a choice of 16 specialized optical distributions that deliver superior control and maximize light levels. With a choice of 30 lumen packages, the Galleon LED luminaire allows scalability from 3,000 to over 53,000 delivered lumens. The 4000K/70 CRI is standard, with 6000K/70 CRI and 3000K/70 CRI options available.

### Long Life with Low Maintenance Costs

In addition to delivering superior performance, the Galleon LED Luminaire is designed for low maintenance, long life and low cost of ownership. These are key benefits that provide compelling justification to retrofit traditional HID solutions, or allow end users to capitalize on these advantages in new construction applications. The Galleon LED luminaire can be tailored to meet your most important needs without compromising on specification features. The LED components and fixture housing are IP66 rated, which provides years of reliable operation with minimal service requirements.



## Engineered for Reliability

At Eaton's Cooper Lighting business we believe credibility is the key to our success. We are committed to providing LED solutions that meet the highest standards of reliability and performance. Our deep-rooted understanding of outdoor product markets and application needs have been resulted through decades of supplying quality products, service and support.

# Galleon LED Design Excellence

## Stepping Up to the Challenge

The Galleon LED luminaire delivers exceptional performance in a highly scalable, low-profile design. The patented, high-efficiency AccuLED Optics™ system provides uniform and energy-conscious illumination to walkways, parking lots, roadways, building areas and security lighting applications. With HID equivalents ranging from 100W up to 1000W, the Galleon LED luminaire is designed to meet the toughest lighting challenges.

## Construction

- Extruded aluminum driver enclosure
- Heavy-wall die-cast aluminum end caps
- 3G vibration rated
- IP66-rated housing and LED Light Squares
- Optional tool-less entry

## Electrical


- Operates in -40°C to 40°C ambient with optional high ambient 50°C ambient configuration
- Proprietary circuit module designed to withstand 10kV of transient line surge
- >L90 60,000 hours at 40°C, compliant with IESNA TM-21
- 120V-277V 50/60Hz, 347V 60Hz or 480V 60Hz operation

## Controls

- Standard with 0-10V dimming driver(s)
- Optional occupancy sensor
- Optional wireless control and monitoring system

## Finish

- Five-stage, super durable TGIC paint resists extreme weather conditions while providing optimal color and gloss retention. It's available in standard grey or optional bronze, black, dark platinum, graphite metallic or white.

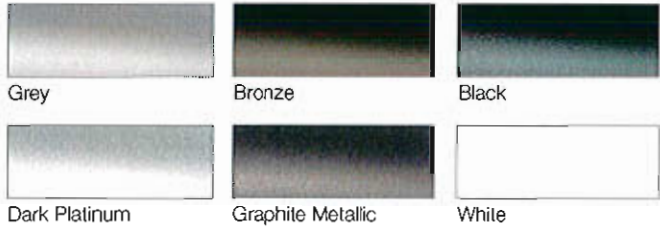

## Warranty

- Five-year warranty



## Surge Protection

A 10kV common surge (line-to-ground) and differential surge (line-to-line) mode protection is standard.



## NEMA Twistlock Photocontrol Receptacle

An optional gasketed receptacle allows for mounting the standard NEMA photocontrol (order separately).



## Light Square Trim Plate Finish

An optional finish to match LED trim plates to the housings exterior allows luminaire to blend seamlessly in any site lighting application.

... Die-cast Aluminum Heat Sinks



Scalable Lumen Packages  
from 3,000 to 53,000 Lumens ...

IP66-Rated Housing  
and LED Light Squares. ...


### Mounting Options



**Occupancy Sensor**  
The optional motion sensor reduces energy use for site lighting applications.



**Mast Arm Adapter**  
An optional cast aluminum mast arm adapter secures fixture head to nominal 2" (2-3/8" O.D. pipe size) horizontal steel tenon arm.

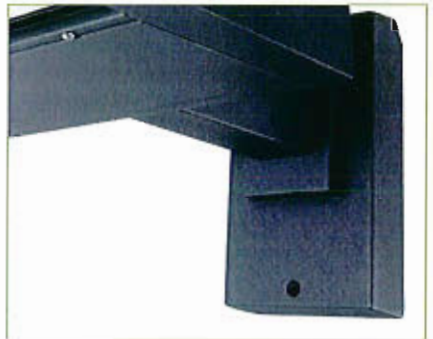

**Wall Mount Bracket**  
An optional wall-mount plate is secured to wall by four lag bolts (supplied by others).

# Scalable Illumination with LED Light Squares

## Energy Savings and Environmental Stewardship

The simplest and most effective way to reduce a lighting fixture's impact on the environment is to minimize its energy consumption. By incorporating Light Squares from Eaton's Cooper Lighting business, the Galleon LED luminaire provides energy savings up to 75 percent compared to standard HID solutions.

## Long Life

With a 60,000+ hour rated life (at greater than 90 percent lumen maintenance), the Galleon LED Luminaire operates six times longer than traditional metal halide fixtures.

## Low Maintenance


With simple quick disconnects, the Light Squares are easily removed in the field for replacement or for the rotation of the optics.



NOTE: Compliant with IESNA TM-21

## Warm White Color

Lighting designers, architects and specifying engineers have long preferred light sources that provide a balanced spectral power distribution and warm white light. Many LED solutions standardize on a cold blue 6000-6500K correlated color temperature (CCT) to maximize lumen output. The Galleon LED luminaire provides warm white light at a standard 4000K CCT with no sacrifice in lumen output.

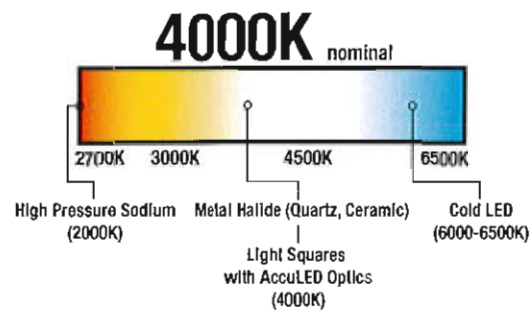

## Superior Efficiency and Control

With efficiencies as high as 95 percent, the patented AccuLED Optics™ system is up to 30 percent more efficient than traditional HID optical systems. Available in 16 optional distributions, this system provides the flexibility and performance required for outdoor applications.



## House Side Shield

For stringent light trespass requirements and the ultimate level of backlight control, a house side shield accessory is available for factory or field installation. Designed to seamlessly integrate with the SL2, SL3, SL4 and AFL distributions, the house side shield virtually eliminates backlight and also enhances visual comfort.





# Optical Performance Redefined


## Performance and Scalability

The Galleon LED luminaire is designed around superior optical performance and scalability. With a choice of 30 lumen packages and 16 optical distributions, the optimal configuration can be used to maximize light levels while minimizing operating costs.

Power Consumption (Watts)

Number of Light Squares	Drive Current		
	530mA	700mA	1A
1	30	38	56
2	54	72	107
3	80	105	157
4	105	138	213
5	130	176	264
6	159	210	315
7	184	243	370
8	209	276	421
9	234	314	475
10	259	348	528

Efficacy (lm/W)

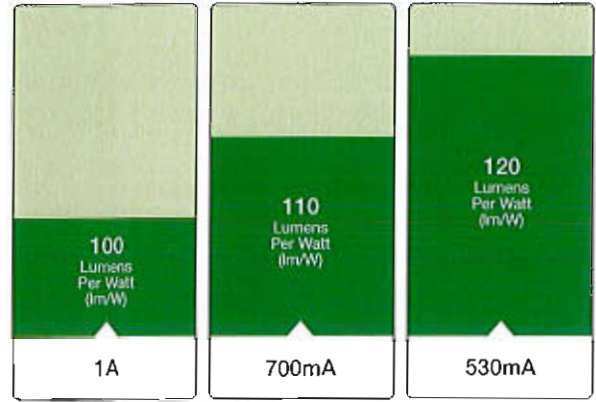

Lower Initial Cost

Lower Operating Cost


NOTE: Nominal efficacy at 4000K CCT




## Optical Distributions

The Galleon luminaire has a choice of seven asymmetric area, three asymmetric roadway, three symmetric and three specialized distributions.


### Asymmetric Area Distributions

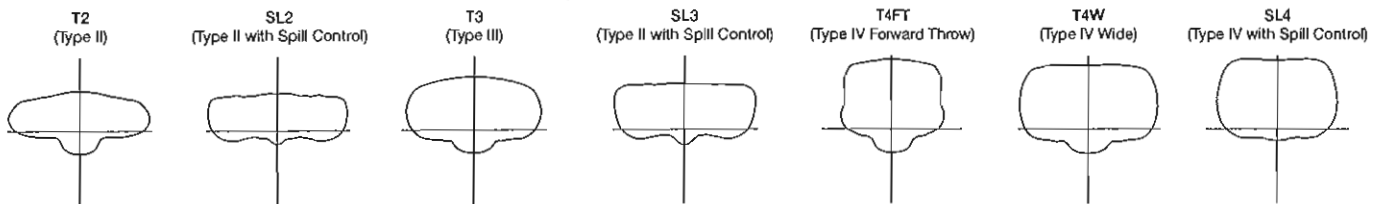


### Asymmetric Roadway Distributions

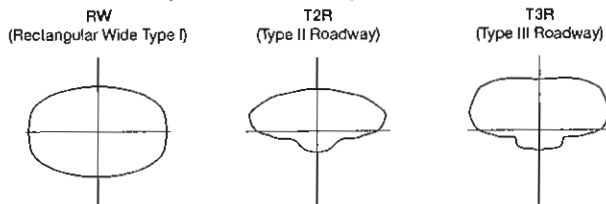

### Symmetric Distributions

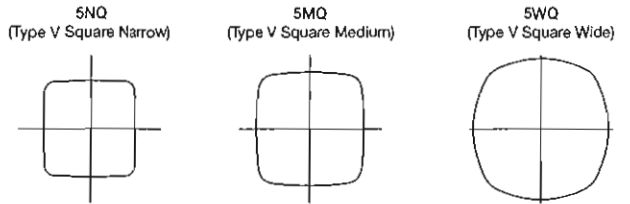

### Specialized Distributions

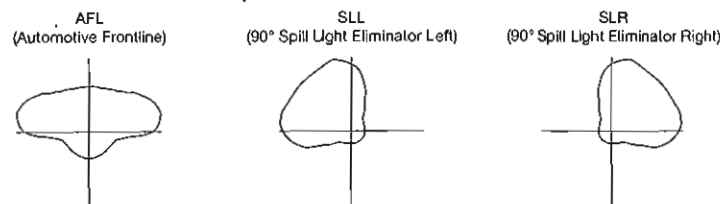

# Occupancy Sensing

## Accelerate Payback on your Investment

To further enhance energy savings, the Galleon luminaire offers an optional occupancy sensor that is integral to each individual luminaire. When the area surrounding the luminaire is unoccupied, the sensor has the ability to reduce light levels and power consumption. In addition to financial benefits, all the control options for the Galleon luminaire are designed to be simple and cost-effective ASHRAE and Title 24 compliant solutions.




## Dimming Occupancy Sensor (DOS)

When the DOS option is selected, the occupancy sensor is connected to a dimming driver and the entire luminaire dims when there is no activity detected. When activity is detected, the luminaire returns to full light output. The sensor is factory preset to dim down to approximately 50 percent lumen output with a time delay of five minutes. To change these settings, a FSIR-100 accessory can be purchased. The FSIR-100 is a wireless configuration tool that allows the dimming level, time delay, sensitivity and other parameters to be changed. Consult a representative from Eaton's Cooper Lighting business for additional details.







## LumaWatt Wireless Control and Monitoring System (DIMRF-LW and DIMRF-LN)

The LumaWatt system is best described as a peer-to-peer wireless network of luminaire-integral sensors that operate in accordance with programmable profiles. The end user can create and manage sensor profiles with browser-based management software and broadcast to the sensors as necessary via wireless gateways. Each sensor is capable of motion and photo sensing, metering power consumption and wireless communication. For additional details, refer to [www.cooperlighting.com](http://www.cooperlighting.com).

## Dimming Occupancy Sensor (DOS)

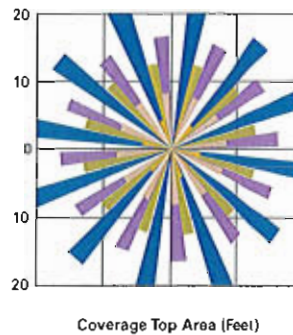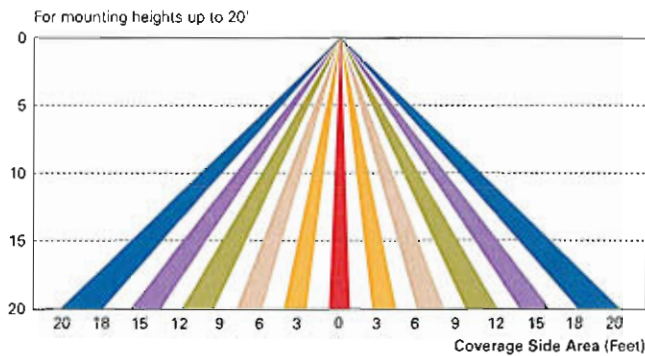

## LumaWatt (DIMRF-LW and DIMRF-LN)

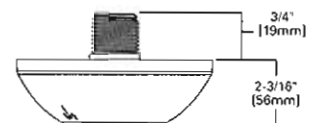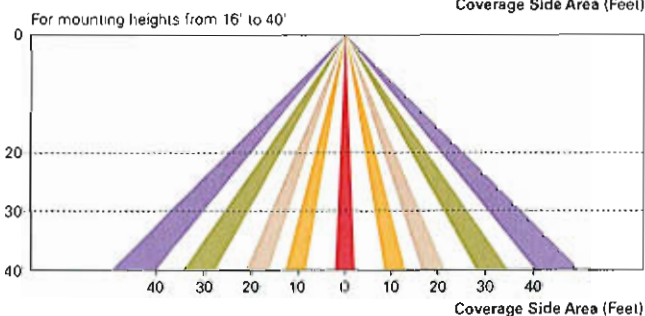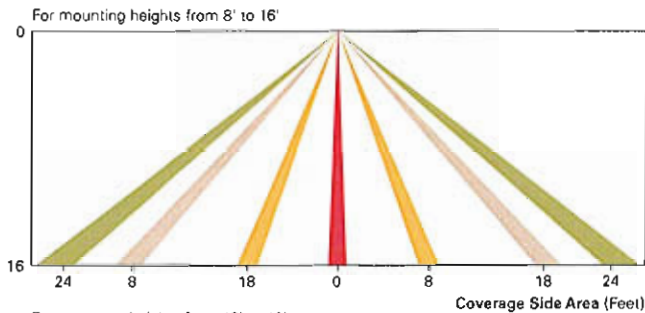

# Scheduled Dimming and Occupancy Detection




For outdoor parking area applications, lighting should be dimmed or turned off within one hour of business closing. Scheduled dimming and occupancy detection can be combined to reduce maximum lighting levels outside business hours. Egress and security lighting is available on occupancy detection.

## Sides of Drive Fixture Location

Fixture Spacing = 160' x 120' on center

20 fixtures per 60' wide drive lane; 40 fixtures total for 420' x 120' parking deck

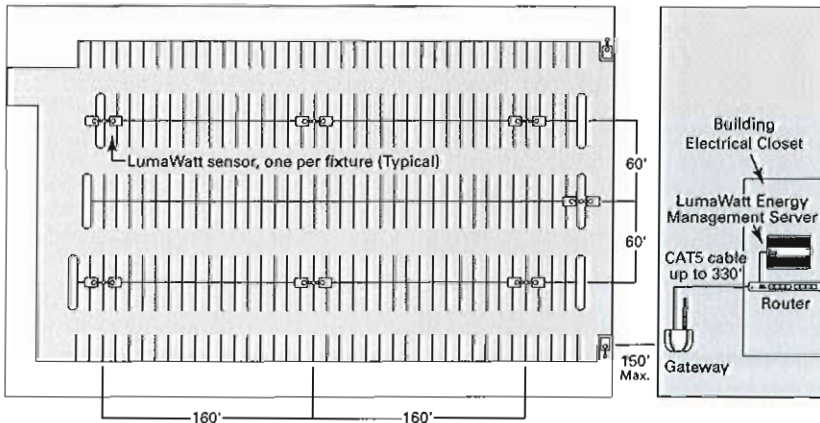


## IESNA Lighting Handbook 10th Edition Illuminance Values for Area and Site Applications

### Parking Lot Design Guide

Illuminance	Minimum Horizontal Illuminance <sup>1</sup>	Uniformity Ratio Max. / Min.	Minimum Vertical Illuminance <sup>2</sup>
Basic	2.0 / 0.2	20:1	1.0 / 0.1
Basic Enhanced Security	5.0 / 0.5	15:1	2.5 / 0.25
Security	10.0 / 1.0	15:1	5.8-8.0 / 0.5-0.5
High Security	30.0-60.0 / 3.0-6.0	4:1	12-60 / 1.2-6.0

#### NOTES:

- 1 Measured on parking surface without shadowing from any object
- 2 For facial recognition measured at 5' above the parking surface at the point of lowest horizontal illuminance

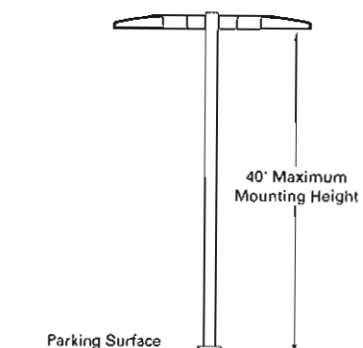

## Energy Savings Calculations

Configuration	Daily Hours of Operation	Control Event	Annual Load (kWh)
<b>14 Sensor Integrated Luminaires 35" on Mounting Height, Centered at 120' x 160'</b>			
<b>Bill-of-Material (BOM)</b>			
(1) RF-EM1, (1) RF-ROUT1, (1) RF-GW1 (14) GAN-AE10-LED-E1-T2-BZ-DIMRF-LN (515W)	11	100% On	28,948
<b>Control Schedule</b>			
7:30 PM-11:30 AM	4	100% On	10,526
11:30 PM-6:30 AM	7	40% On, On Occupancy 70%	7,268
<b>Total Controlled Load</b>	<b>11</b>	<b>2 Events</b>	<b>17,895</b>
<b>Energy Saving</b>			<b>38%</b>


# Configuration Flexibility

## A New Level of Scalable Solutions


The Galleon LED luminaire is available in one to 10 Light Squares. As the number of Light Squares increases, the luminaire width increases proportionally.



1 - 4 Light Squares

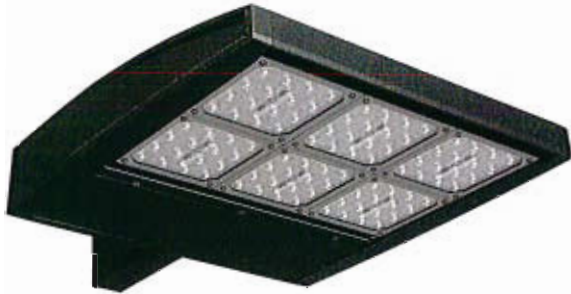

5 - 6 Light Squares

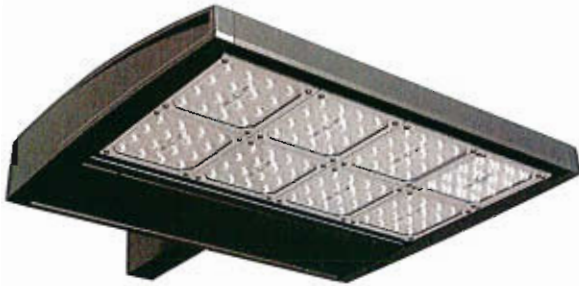

7 - 8 Light Squares




9 - 10 Light Squares

## Pole Mounting Configurations

The standard Galleon LED luminaire configuration is designed to mount to a round or square pole. When mounting two or more fixtures at 90° or 120° apart, a longer Extended Arm (EA) may be required. Please reference the table below to determine when the Extended Arm is required and designate "EA" in the catalog logic.

Arm Mounting Requirements

Configuration	90° Apart	120° Apart
GAN-AE-01	7" Arm (Standard)	7" Arm (Standard)
GAN-AE-02	7" Arm (Standard)	7" Arm (Standard)
GAN-AE-03	7" Arm (Standard)	7" Arm (Standard)
GAN-AE-04	7" Arm (Standard)	7" Arm (Standard)
GAN-AE-05	10" Extended Arm (Required)	7" Arm (Standard)
GAN-AE-06	10" Extended Arm (Required)	7" Arm (Standard)
GAN-AE-07	13" Extended Arm (Required)	13" Extended Arm (Required)
GAN-AE-08	13" Extended Arm (Required)	13" Extended Arm (Required)
GAN-AE-09	16" Extended Arm (Required)	16" Extended Arm (Required)
GAN-AE-10	16" Extended Arm (Required)	16" Extended Arm (Required)

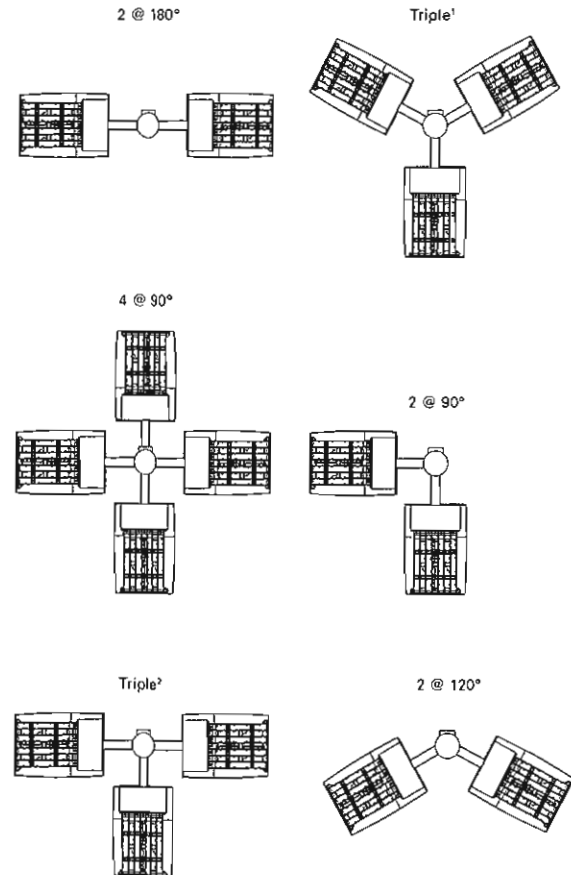

NOTES: 1. Round poles are 3 @ 120°. Square poles are 3 @ 90°. 2. Round poles are 3 @ 90°.

# Ordering Information

Sample Number: GAN-AE-04-LED-U-T3A-AP

Product Family	Light Engine	Number of Light Squares <sup>1</sup>	Lamp Type	Voltage	Distribution	Color	Mounting	
GAN=Galleon	AE=1A Drive Current	01=1 02=2 03=3 04=4 05=5 06=6 07=7 08=8 09=9 10=10	LED=Solid State Light Emitting Diodes	U=Universal (120-277V) 9=347V <sup>2</sup> 8=480V <sup>2</sup>	T2=Type II T2R=Type II Roadway T3=Type III T3R=Type III Roadway T4FT=Type IV Forward Throw T4W=Type IV Wide 5NQ=Type V Square Narrow 5MQ=Type V Square Medium 5WQ=Type V Square Wide	SL2=Type II w/Spill Control SL3=Type III w/Spill Control SL4=Type IV w/Spill Control SLL=90° Spill Light Eliminator Left SLR=90° Spill Light Eliminator Right RW=Rectangular Wide Type I AFL=Automotive Frontline	AP=Grey BZ=Bronze BK=Black DP=Dark Platinum GM=Graphite Metallic WH=White	[BLANK]=Arm for Round or Square Pole EA=Extended Arm <sup>3</sup> MA=Mast Arm Adapter <sup>4</sup> WM=Wall Mount


Options (Add as Suffix)		
2L=Two Circuits <sup>5</sup> 7030=70 CRI 3000K <sup>7</sup> 7060=70 CRI 6000K <sup>7</sup> 530=Drive Current Factory Set to 530mA <sup>8</sup> 700=Drive Current Factory Set to 700mA <sup>8</sup> 3=Three-Position Terminal Block P=Button Type Photocontrol (120, 208, 240 or 277V) 4=NEMA Twistlock Photocontrol Receptacle	HA=50°C High Ambient <sup>6</sup> MS/DIM-L08=Motion Sensor for Dimming Operation, Maximum 8' Mounting Height <sup>9,10,11,12</sup> MS/DIM-L20=Motion Sensor for Dimming Operation, 9' - 20' Mounting Height <sup>9,10,11,12</sup> MS/DIM-L40=Motion Sensor for Dimming Operation, 21' - 40' Mounting Height <sup>9,10,11,12</sup> MS/X-L08=Bi-Level Motion Sensor, Maximum 8' Mounting Height <sup>11,12,13,14</sup> MS/X-L20=Bi-Level Motion Sensor, 9' - 20' Mounting Height <sup>11,12,14</sup> MS/X-L40=Bi-Level Motion Sensor, 21' - 40' Mounting Height <sup>11,12,14</sup> DIMRF-LW=LumaWall Wireless Sensor, Wide Lens for 8' - 16' Mounting Height <sup>15</sup> DIMRF-LN=LumaWall Wireless Sensor, Narrow Lens for 16' - 40' Mounting Height <sup>15</sup>	L90=Optics Rotated 90° Left R90=Optics Rotated 90° Right MT=Factory Installed Mesh Top TH=Tool-Less Door Hardware LGF=Light Square Trim Plate Painted to Match Housing HSS=Factory Installed House Side Shield <sup>16</sup>

Accessories (Order Separately)		
OA/RA1016=NEMA Photocontrol Multi-Tap - 105-285V OA/RA1027=NEMA Photocontrol - 480V OA/RA1201=NEMA Photocontrol - 347V OA/RA1013=Photocontrol Shorting Cap OA/RA1014=120V Photocontrol SA1252=10kV Surge Module Replacement SA1036-XX=Single Tenon Adapter for 2-3/8" O.D. Tenon SA1037-XX=2 @ 180° Tenon Adapter for 2-3/8" O.D. Tenon SA1197-XX=3 @ 120° Tenon Adapter for 2-3/8" O.D. Tenon	SA1197-XX=3 @ 120° Tenon Adapter for 2-3/8" O.D. Tenon SA1188-XX=4 @ 90° Tenon Adapter for 2-3/8" O.D. Tenon SA1189-XX=2 @ 90° Tenon Adapter for 2-3/8" O.D. Tenon SA1190-XX=3 @ 90° Tenon Adapter for 2-3/8" O.D. Tenon SA1191-XX=2 @ 120° Tenon Adapter for 2-3/8" O.D. Tenon SA1038-XX=Single Tenon Adapter for 3-1/2" O.D. Tenon SA1039-XX=2 @ 180° Tenon Adapter for 3-1/2" O.D. Tenon SA1192-XX=3 @ 120° Tenon Adapter for 3-1/2" O.D. Tenon SA1193-XX=4 @ 90° Tenon Adapter for 3-1/2" O.D. Tenon	SA1194-XX=2 @ 90° Tenon Adapter for 3-1/2" O.D. Tenon SA1195-XX=3 @ 90° Tenon Adapter for 3-1/2" O.D. Tenon FSIR-100=Wireless Configuration Tool for Occupancy Sensor <sup>16</sup> GAN-MT1=Field Installed Mesh Top for 1-4 Light Squares GAN-MT2=Field Installed Mesh Top for 5-6 Light Squares GAN-MT3=Field Installed Mesh Top for 7-8 Light Squares GAN-MT4=Field Installed Mesh Top for 9-10 Light Squares LS/HSS=Field Installed House Side Shield <sup>16,17</sup>


NOTES: 1 Standard 4000K CCT and minimum 70 CRI. 2 LumaWall Wireless Sensors not currently available for 347V or 480V applications. 3 May be required when two or more luminaires are oriented on a 90° or 120° drilling pattern. Refer to arm mounting requirement table. 4 Factory installed. 5 Only available in 5-10 Light Squares. 6 Not available with LumaWall wireless sensors. 7 Use dedicated IES files for 3000K and 6000K when performing layouts. These files are published on the Galleon luminaire product page on the website. 8 1 Amp standard. Use dedicated IES files when performing layouts. These files are published on the Galleon luminaire product page on the website. 9 Must specify dimming driver. Consult factory for more information. 10 120V or 277V 60Hz and 230V 50Hz only. Replace E1 with specific voltage. Consult factory for availability in 347V and 480V. 11 The FSIR-100 accessory is required to adjust parameters. 12 Not available with HA option. 13 LumaWall wireless sensors are factory installed only requiring network components RF-EM1, RF-GW1 and RF-ROUT1 in appropriate quantities. See www.cdsplighting.com for LumaWall application information. 14 Sensor mounted externally. Available in 2, 3, 4 or 6 Light Square configurations. Replace "X" with number of Light Squares in low output mode. For ON/OFF operation, replace "X" with "0". Maximum two Light Squares in low output mode. Not available with dimming driver. No terminal block with bi-level operation. 15 Only for use with SL2, SL3, SL4 and AFL distributions. The Light Square trim plate is painted black when the HSS option is selected. 16 This tool enables adjustment of parameters including high and low modes, sensitivity, time delay, cutoff and more. Consult your Eaton's Cooper Lighting business representative for additional details. 17 One required for each Light Square.

## Dimensions

### Pole Mount



### Wall Mount

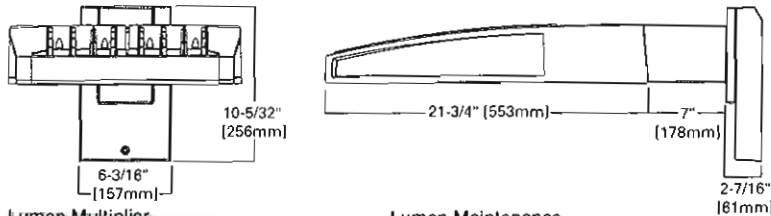

### Lumen Multiplier

Ambient Temperature	Lumen Multiplier
0°C	1.02
10°C	1.01
25°C	1.00
40°C	0.99
50°C	0.97

### Lumen Maintenance

Ambient Temperature	TM-21 Lumen Maintenance (60,000 Hours)	Theoretical L70 (Hours)
25°C	> 94%	> 350,000
40°C	> 93%	> 250,000
50°C	> 90%	> 170,000


## Dimensional Data

Number of Light Squares	"A" Width	"B" Standard Arm Length	"B" Optional Arm Length <sup>1</sup>
1-4	15-1/2" (394mm)	7" (178mm)	10" (254mm)
5-6	21-5/8" (549mm)	7" (178mm)	10" (254mm)
7-8	27-5/8" (702mm)	7" (178mm)	13" (330mm)
9-10	33-3/4" (857mm)	7" (178mm)	16" (406mm)

NOTES: 1 Optional arm length to be used when mounting two fixtures at 90° on a single pole  
2 EPA calculated with optional arm length.

## Drilling Pattern

### TYPE "N"



## Additional Information

Compliances	Technical Data (Electronic LED Driver)	Approximate Weight	EPA (Effective Projected Area - Square Feet)
UL and cUL Wet Location Listed IP66 Light Squares 3G Vibration Rated ARRA Compliant ISO 9001	+40°C (104°F) Ambient Temperature Rating -40°C (-40°F) Ambient Temperature Rating Optional 50°F (HA) Ambient Temperature Rating >0.9 Power Factor <20% Total Harmonic Distortion 120V-277V/50 and 60 Hz 347V/60 Hz, 480V/60 Hz	1-4 Light Squares 33 lbs. (15.0 kgs.) 5-6 Light Squares 44 lbs. (20.0 kgs.) 7-8 Light Squares 54 lbs. (24.5 kgs.) 9-10 Light Squares 63 lbs. (28.6 kgs.)	1-4 Light Squares 0.96 5-6 Light Squares 1.00 7-8 Light Squares 1.07 9-10 Light Squares 1.12

NOTE: Specifications and dimensions subject to change without notice.



IP66 Rated

**Eaton's Cooper Lighting Business**

Headquarters  
1121 Highway 74 South  
Peachtree City, GA 30269  
P: 770-486-4800  
www.cooperlighting.com

**Canada Sales**

5925 McLaughlin Road  
Mississauga, Ontario L5R 1B8  
P: 905-501-3000  
F: 905-501-3172

**Our Lighting Product Brands**


Halo  
Halo Commercial  
Portfolio  
IRiS  
RSA  
Metalux  
Corelite  
Neo-Ray  
Fail-Safe  
MWS  
Ametrix  
Shaper  
io  
Lumark  
McGraw-Edison  
Invue  
Lumière  
Streetworks  
AtLite  
Sure-Lites

**Our Controls Product Brands**

Greengate  
iLumin  
Zero 88  
Fifth Light Technology  
iLight (International Only)

# WST LED

## Architectural Wall Sconce

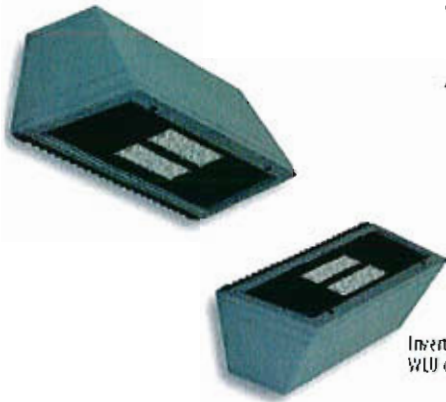

Inverted available with WLU option only.



Catalog Number

Notes

EXTERIOR EMERGENCY LT

Type

D

### Specifications Luminaire

**Height:** 7-1/4"  
(18.4 cm)

**Width:** 16-1/4"  
(41.3 cm)

**Depth:** 9-1/8"  
(23.2 cm)


**Weight:** 17 lbs  
(7.7 kg)

### Optional Back Box (BBW)

**Height:** 4"  
(10.2 cm)

**Width:** 5-1/2"  
(14.0 cm)

**Depth:** 1-1/2"  
(3.8 cm)

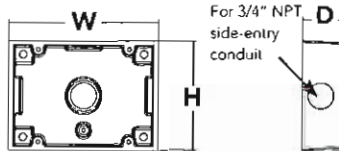

### Introduction

The classic Architectural Wall Sconce is now available with the latest in LED technology. The result is a long-life, maintenance-free product with typical energy savings of 75% compared to metal halide versions. The integral battery backup option provides emergency egress lighting, without the use of a back-box or remote gear, so installations maintain their aesthetic integrity.

The WST LED is ideal for replacing existing 50 – 175W metal halide wall-mounted products. The expected service life is 20+ years of nighttime use.

### Ordering Information

**EXAMPLE:** WST LED 2 10A700/40K SR3 MVOLT DDBTXD

#### WST LED

Series	Light Engines	Performance Package	Distribution	Voltage	Mounting	Options <sup>1</sup>	Finish (required)
WST LED	1 One engine (10 LEDs)	700 mA options: 10A700/30K 3000K	SR2 Type II	MVOLT <sup>1</sup>	Shipped included	Shipped installed	DDBXD Dark bronze
	2 Two engines (20 LEDs)	10A700/40K 4000K 10A700/50K 5000K	SR3 Type III SR4 Type IV	120 <sup>1</sup> 208 <sup>1</sup> 240 <sup>1</sup> 277 <sup>1</sup> 347 480	(blank) Surface mount Shipped separately <sup>2</sup> BBW Surface-mounted back box UT5 Uptilt 5 degrees	PE Photoelectric cell, button type <sup>1,5</sup> SF Single fuse (120, 277, 347V) <sup>4</sup> DF Double fuse (208, 240, 480V) <sup>4</sup> DMG 0-10V dimming driver (no controls) ELCW Emergency battery backup <sup>6</sup> WLU Wet location door for up orientation <sup>7</sup> PIR Motion/ambient light sensor <sup>8</sup> DS Dual switching <sup>9</sup> Shipped separately VG Vandal guard WG Wire guard	DBLXD Black DNAXD Natural aluminum DWHXD White DSSXD Sandstone DDBTXD Textured dark bronze DBLBXD Textured black DNATXD Textured natural aluminum DWHGXD Textured white DSSTXD Textured sandstone


### Emergency Battery Operation

The emergency battery backup (ELCW option) is integral to the luminaire - no external housing required! This design provides reliable emergency operation while maintaining the aesthetics of the product.

All ELCW configurations include an independent secondary driver with an integral relay to immediately detect AC power loss. Dual light engines are wired in parallel so both engines operate in emergency mode and provide additional component redundancy. These design features meet various interpretations of NFPA 70/NEC 2008 - 700.16.

The emergency battery will power the luminaire for a minimum duration of 90 minutes (maximum duration of three hours) from the time supply power is lost, per International Building Code Section 1006 and NFPA 101 Life Safety Code Section 7.9, provided luminaires are mounted at an appropriate height and illuminate an open space with no major obstructions.

The examples below show illuminance of 1 fc average and 0.1 fc minimum of the single-engine Type IV product in emergency mode.

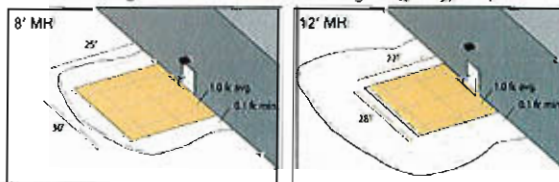

WST LED 1 10A700/40K SR4  
MVOLT ELCW  
10' x 10' Gridlines  
8' and 12' Mounting Height

#### NOTES

- MVOLT driver operates on any line voltage from 120-277V (50/60 Hz). Specify 120, 208, 240 or 277 options only when ordering with photocell (PE), fusing (SF, DF), or dual switching (DS).
- May also be ordered separately as an accessory. Ex: WSBBW DDBXD U. Must specify finish.
- Must be ordered with fixture; cannot be field installed.
- Not available with MVOLT option. Button photocell (PE) can be ordered with a dedicated voltage option. Single fuse (SF) requires 120, 277 or 347 voltage option. Double fuse (DF) requires 208, 240 or 480 voltage option.
- Not available with 480V option. Not available with motion/ambient light sensor (PIR).
- Integral battery pack is rated for -20° to 60°C operating temperature. ELCW warranty is 3-year period. Not available with 347V or 480V. Not available with WLU.
- WLU not available with PIR or ELCW.
- Specifies the SensorSwitch SFOD-7-ODP control (photocell included); see Motion Sensor Guide for details. Includes ambient light sensor. Not available with "PE" option (button type photocell). Dimming driver standard. Not available with WLU, VG or WG.
- Provides 50/50 luminaire operation via two independent drivers and light engines on two separate circuits. Not available with one engine, MVOLT, ELCW, WLU, SF, or DF. Must specify voltage; voltage must be the same for both drivers. When ordered with photocell (PE) or motion sensor (PIR), only the primary power source leads will be controlled.



## Performance Data

### Lumen Output

Lumen values are from photometric tests performed in accordance with IESNA LM-79-08. Data is considered to be representative of the configurations shown, within the tolerances allowed by Lighting Facts.

Light Engines	Drive Current (mA)	Performance Package	System Watts (MVOLT <sup>1</sup> )	Dist. Type	40K (4000K, 70 CRI)				
					Nominal Lumens	B	U	G	LPW
1 (10 LEDs)	700	10A700/-K	24W	SR2	2,005	1	0	1	84
				SR3	2,029	1	0	1	84
				SR4	1,959	1	0	1	82
2 (20 LEDs)	700	10A700/-K	47W	SR2	3,944	1	0	1	84
				SR3	4,028	1	0	1	86
				SR4	3,851	1	0	1	82

1 See electrical load chart for 347/480V system watts.

### Lumen Ambient Temperature (LAT) Multipliers

Use these factors to determine relative lumen output for average ambient temperatures from 0-40°C (32-104°F).

Ambient	Lumen Multiplier
0°C	1.10
10°C	1.06
20°C	1.02
25°C	1.00
30°C	0.98
40°C	0.92

### Projected LED Lumen Maintenance

Data references the extrapolated performance projections for the WST LED 2 10A700 platform in a 25°C ambient, based on 10,000 hours of LED testing (tested per IESNA LM-80-08 and projected per IESNA TM-21-11).

To calculate Lf, use the lumen maintenance factor that corresponds to the desired number of operating hours below. For other lumen maintenance values, contact factory.

Operating Hours	0	25,000	50,000	100,000
Lumen Maintenance Factor	1.0	0.94	0.88	0.77

### Electrical Load


Light Engines	Drive Current (mA)	System Watts	Current (A)					
			120	208	240	277	347	480
1	700	24W	0.24	0.14	0.12	0.1	-	-
		29W <sup>1</sup>	-	-	-	-	0.09	0.07
2	700	47W	0.44	0.27	0.23	0.20	-	-
		53W <sup>1</sup>	-	-	-	-	0.17	0.12

1 Higher wattage is due to electrical losses from step-down transformer.


## Photometric Diagrams

To see complete photometric reports or download .ies files for this product, visit Lithonia Lighting's WST LED homepage.

Isofootcandle plots for the WST LED 2 10A700/40K SR2, SR3, and SR4. Distances are in units of mounting height (12').

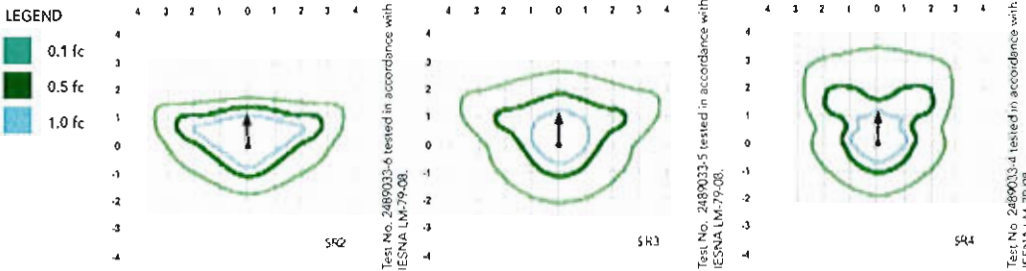

Distribution overlay comparison to 175W metal halide.

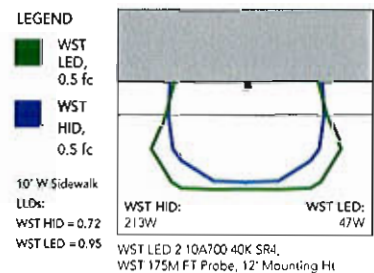

## FEATURES & SPECIFICATIONS

### INTENDED USE

The classic architectural shape of the WST LED was designed for applications such as hospitals, schools, malls, restaurants, and commercial buildings. The long life LEDs and driver make this luminaire nearly maintenance-free.

### CONSTRUCTION

The single-piece die-cast aluminum housing integrates secondary heat sinks to optimize thermal transfer from the internal light engine heat sinks and promote long life. The driver is mounted in direct contact with the casting for a low operating temperature and long life. The die-cast door frame is fully gasketed with a one-piece solid silicone gasket to keep out moisture and dust, providing an IP65 rating for the luminaire.

### FINISH

Exterior parts are protected by a zinc-inflused Super Durable TGIC thermoset powder coat finish that provides superior resistance to corrosion and weathering. A tightly controlled multi-stage process ensures a minimum 3 mils thickness for a finish that can withstand extreme climate changes without cracking or peeling. Standard Super Durable colors include dark bronze, black, natural aluminum, sandstone and white. Available in textured and non-textured finishes.

### OPTICS

Precision-molded acrylic lenses are engineered for superior distribution, uniformity, and spacing in wall-mount applications. Light engines are 4000K (70 CRI). The WST LED has zero uplight and qualifies as a Nighttime Friendly™ product, meaning it is consistent with the LEED® and Green Globes™ criteria for eliminating wasteful uplight.

### ELECTRICAL

Light engine(s) consist of 10 high-efficiency LEDs mounted to a metal core circuit board and integral aluminum heat sinks to maximize heat dissipation and promote long life (100,000 hrs at 25°C, L77). Class 2 electronic driver has a power factor >90%, THD <20%. Easily-serviceable surge protection device meets a minimum Category B (per ANSI/IEEE C62.41.2).

### INSTALLATION

A universal mounting plate with integral mounting support arms allows the fixture to hinge down for easy access while making wiring connections.

### LISTINGS

CSA certified to U.S. and Canadian standards. Light engines are IP66 rated; luminaire is IP65 rated and suitable for wet locations when mounted with the lenses down. WLU option offers wet location listing in "up" orientation. Rated for -30°C minimum ambient.

DesignLights Consortium® (DLC) qualified product. Not all versions of this product may be DLC qualified. Please check the DLC Qualified Products List at [www.designlights.org](http://www.designlights.org) to confirm which versions are qualified.



### WARRANTY

Five year limited warranty. Full warranty terms located at [www.acuitybrands.com/CustomerResources/faq\\_wst\\_and\\_conditions.aspx](http://www.acuitybrands.com/CustomerResources/faq_wst_and_conditions.aspx).

**Note:** Actual performance may differ as a result of end-user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C. Specifications subject to change without notice.





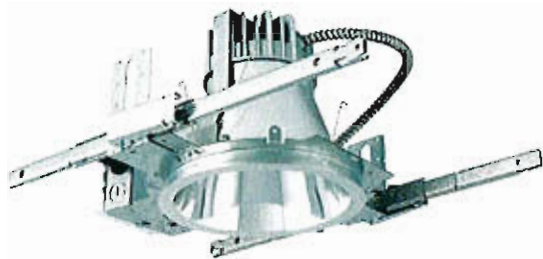

Gotham Architectural Downlighting  
LED Downlights

8" Evo®  
Downlight

Solid-State Lighting



**OPTICAL SYSTEM**

- Self-flanged semi-specular, matte-diffuse or specular finishing trim
- Patented Bounding Ray™ optical design (U.S. Patent No. 5,800,050)
- 45° cutoff to source and source image
- Top-down flash characteristic
- Polycarbonate lens integral to light engine

**MECHANICAL SYSTEM**

- 16-gauge galvanized steel construction; maximum 1-1/2" ceiling thickness
- Telescopic mounting bars maximum of 32" and minimum of 15", preinstalled, 4" vertical adjustment
- Toolless adjustments post installation
- Junction box capacity: 8 (4 in, 4 out ) 12AWG rated for 90°C
- Light engine and driver accessible through aperture

**ELECTRICAL SYSTEM**

- Fully serviceable and upgradeable lensed LED light engine
- 70% lumen maintenance at 60,000 hours
- Tested according to LM-79 and LM-80 standards
- Overload and short circuit protected
- 2.5 SDCM; 85 CRI typical, 90+ CRI optional

**LISTINGS**

- Fixtures are CSA certified to meet US and Canadian standards; wet location, covered ceiling

**WARRANTY**

- 5-year limited warranty. Complete warranty terms located at: [www.acuitybrands.com/CustomerResources/Terms\\_and\\_conditions.aspx](http://www.acuitybrands.com/CustomerResources/Terms_and_conditions.aspx)



Note: Actual performance may differ as a result of end user environment and application. All values are design or typical values, measured under laboratory conditions at 25 °C.

EXAMPLE: EVO 35/25 8AR MWD LSS 120 EZ1

Series	Color temperature	Nominal lumen values	Aperture/Trim color	Distribution	Finish	Voltage
EVO	27/ 2700 K	20 2000 lumens	8AR Clear	VND Very narrow (0.5 s/mh)	LSS Semi-specular	120
	30/ 3000 K	25 2500 lumens	8PR Pewter	ND Narrow (0.7 s/mh)	LD Matte-diffuse	277
	35/ 3500 K	30 3000 lumens	8WTR Wheat	MD Medium (0.9 s/mh)	LS Specular	347 <sup>2</sup>
	40/ 4000 K		8GR Gold 8WR <sup>1</sup> White 8BR <sup>1</sup> Black 8WRAMF <sup>1</sup> White anti-microbial	MWO Medium wide (1.0 s/mh) WD Wide (1.2 s/mh)		



Driver <sup>3</sup>	Options
EZ1 eldoLED ECOdrive 0-10V dimming driver. Minimum dimming range level 1%	SF Single fuse. Specify 120V or 277V. BGTD Bodine generator transfer device. Specify 120V or 277V.
EZB eldoLED SOLOdrive 0-10V dimming driver. Minimum dimming level <1%.	TRW <sup>4</sup> White painted flange CRI90 High CRI (90+)
EOAB eldoLED SOLOdrive DALI dimming driver. Minimum dimming level <1%. Minimum lumen 1500/Maximum lumen 3000.	TRBL <sup>5</sup> Black painted flange CP <sup>9</sup> Chicago plenum. Specify 120V or 277V.
EOXB eldoLED POWERdrive OMX with RDM (remote device management). Minimum dimming level <1%. Includes termination resistor. Minimum lumen 1500/Maximum lumen 3000.	EL <sup>8</sup> Emergency battery pack with integral test switch RRL__ RELOC®-ready luminaire connectors enable a simple and consistent factory installed option across all ABL luminaire brands. Refer to <a href="#">RRL</a> for complete nomenclature.
EXA1 XPoint Wireless, eldoLED ECOdrive 1% dimming, 0-10V. Refer to XPoint tech sheet.	ELR <sup>6</sup> Emergency battery pack with remote test switch
EXAB XPoint Wireless, eldoLED SOLOdrive <1% dimming, 0-10V. Refer to XPoint tech sheet.	NPS8DEZ <sup>7</sup> nLight® dimming pack controls 0-10V eldoLED drivers. NPS8OEZER <sup>7,8</sup> nLight® dimming pack controls 0-10V eldoLED drivers. ER controls fixtures on emergency circuit.

All dimensions are inches (centimeters) unless otherwise noted.

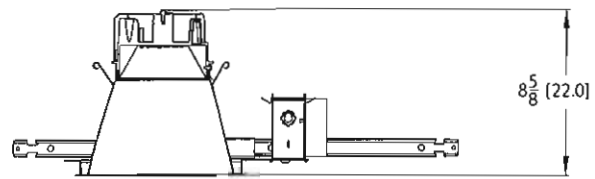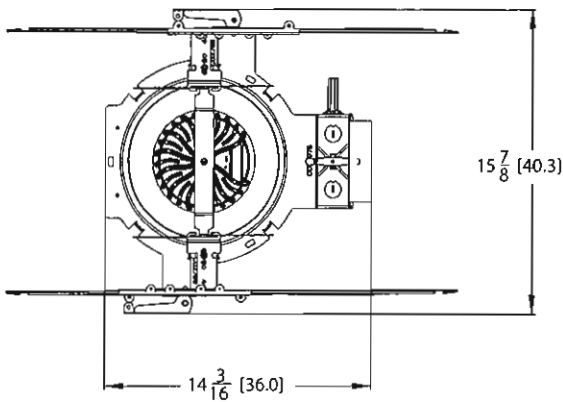

Aperture: 8-5/8 (21.9)  
Ceiling Opening: 8-3/4 (22.2)  
Overlap Trim: 9-1/4 (23.5)

DIMENSIONS FOR CHICAGO PLENUM

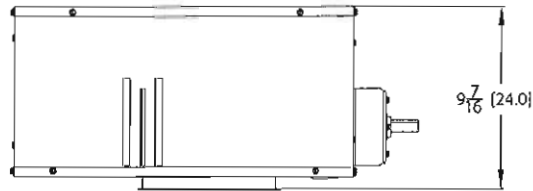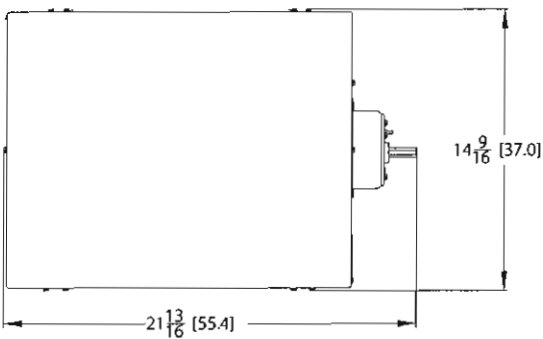

WATTAGE CONSUMPTION MATRIX			
LUMENS	LM ACTUAL	WATTAGE	LUMENS per WATT
2000	2,287	31.6	72.5
2500	2,964	41.1	72.0
3000	3,398	47.1	72.2

EMERGENCY LUMEN OUTPUT		
LUMENS	WATTAGE	INITIAL OUTPUT
2000	8.4	630
2500	7.2	540
3000	8.4	630

ACCESSORIES order as separate catalog numbers (shipped separately)

<b>SCA8</b>	Sloped ceiling adapter. Degree of slope must be specified (5D, 10D, 15D, 20D, 25D, 30D). Ex: SCA8 10D. Refer to <a href="#">TECH-190</a> .
<b>CTA4-8 YK</b>	Ceiling thickness adapter (extends mounting frame to accommodate ceiling thickness up to 5"). Adds 1" to fixture height.
<b>GVRT</b>	Vandal-resistant trim accessory. Refer to <a href="#">TECH-200</a> .
<b>ISO BC</b>	0-10V wallbox dimmer. Refer to <a href="#">ISD-BC</a> .

ORDERING NOTES

- Not available with finishes.
- Not available with EL or ELR options.
- Refer to [TECH-240](#) for compatible dimmers.
- Not available with white reflector.
- Not available with black reflector.
- For dimensional changes, refer to [TECH-140](#). Not available with 347V.
- Specify voltage.
- For use with generator supply EM power. Will require an emergency hot feed and normal hot feed.
- ELR not available.

Distribution Curve    Distribution Data    Output Data    Coefficient of Utilization    Illuminance: Single Luminaire 30" Above Floor

**CONSULT FACTORY FOR PHOTOMETRY**

LUMEN OUTPUT MULTIPLIER - CRI	
CRI	FACTOR
80 CRI	1
90 CRI	0.79

LUMEN OUTPUT MULTIPLIER - CCT	
CRI	FACTOR
4000 K	1.035
3500 K	1
3000 K	0.973
2700 K	0.938

LUMEN OUTPUT MULTIPLIER - TRIM FINISH						
FINISH	CLEAR (AF)	PEWTER (PF)	WHEAT (WF)	GOLD (GF)	WHITE (WFWPWF)	BLACK (BF)
Specular (LS)	1.00	0.88	0.83	0.95	N/A	N/A
Semi-specular (LSS)	0.95	0.84	0.79	0.90	N/A	N/A
Matte-diffuse (LD)	0.85	0.73	0.69	0.80	N/A	N/A
Paint	N/A	N/A	N/A	N/A	0.87	0.73

**PHOTOMETRY NOTES**

- Tested in accordance with IESNA LM-79-08.
- Tested to current IES and NEMA standards under stabilized laboratory conditions.
- CRI: 85 typical.


Choose Wall Controls.  
nLIGHT offers multiple styles of wall controls – each with varying features and user experience.



Push-Button WallPod  
Traditional tactile buttons  
and LED user feedback



Graphic WallPod  
Full color touch screen  
provides a sophisticated  
look and feel

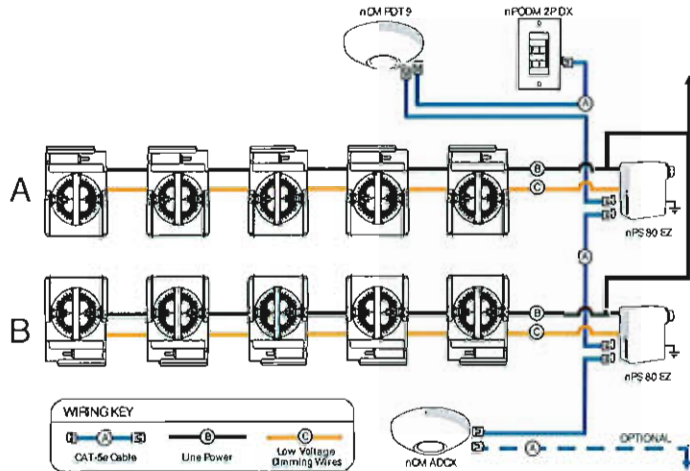


EXAMPLE  
Group Fixture Control\*

\*Application diagram applies for fixtures with dldLED drivers only.

- nPS 80 EZ Dimming/Control Pack (qty 2 required)
- nPODM 2PDX Dual On/Off/Dim Push-Button WallPod
- nCM ADCX Daylight Sensor with Automatic Dimming Control
- nCM PDT 9 Dual Technology Occupancy Sensor


Description: This design provides a dual on/off/dim wall station that enables manual control of the fixtures in Row A and Row B separately. Additionally, a daylight harvesting sensor is provided so the lights in row B can be configured to dim automatically when daylight is available. An occupancy sensor turns off all lights when the space is vacant.

nLight® Control Accessories: Order as separate catalog number. Visit <a href="http://www.sensorswitch.com/nLight">www.sensorswitch.com/nLight</a> for complete listing of nLight controls.			
<b>WallPod stations</b>	<b>Model number</b>	<b>Occupancy sensors</b>	<b>Model number</b>
On/Off	nPODM (color)	Small motion 360°, ceiling (PIR / dual tech)	nCM 9 / nCM PDT 9
On/Off & Raise/Lower	nPODM DX (color)	Large motion 360°, ceiling (PIR / dual tech)	nCM 10 / nCM PDT 10
Graphic Touchscreen	nPOD GFX (color)	Wide view (PIR / dual tech)	nWV 16 / nWV PDT 16
<b>Photocell controls</b>	<b>Model number</b>	Wall Switch w/ Raise/Lower (PIR / dual tech)	nWSX LV DX / nWSX POT LV DX
Dimming	nCM ADCX	<b>Cat-5 cables (plenum rated)</b>	<b>Model number</b>
		10', CAT5 10FT	CAT5 10FT J1
		15', CAT5 15FT	CAT5 15FT J1

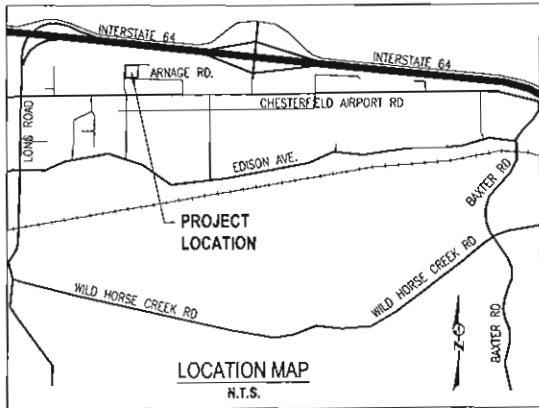

TRACT 6  
1.173 ACRES  
BENTLEY HOLDINGS LLC  
(LAMBORGHINI OF ST. LOUIS)

TRACT 7  
1.173 ACRES  
BENTLEY HOLDINGS LLC  
(LAMBORGHINI OF ST. LOUIS)



THOUVENOT,  
WADE &  
MOERCHEN, INC.  
ENGINEERS ♦ SURVEYORS ♦ PLANNERS



- ☒ CORPORATE OFFICE  
4940 OLD COLLINSVILLE RD.  
SWANSEA, ILLINOIS 62226  
TEL (618) 624-4488  
FAX (618) 624-6688
- ☐ WATERLOO OFFICE  
113 SOUTH MAIN STREET  
WATERLOO, ILLINOIS 62298  
TEL (618) 939-5050  
FAX (618) 939-3938
- ☐ EDWARDSVILLE OFFICE  
600 COUNTRY CLUB VIEW, SUITE 1  
EDWARDSVILLE, ILLINOIS 62025  
TEL (618) 656-4040  
FAX (618) 656-4343
- ☐ ST. LOUIS OFFICE  
720 OLIVE ST., SUITE 200A  
ST. LOUIS, MISSOURI 63101  
TEL (314) 241-6300  
FAX (314) 241-2591
- ☐ ST. CHARLES OFFICE  
400 N. 5TH STREET, SUITE 101  
ST. CHARLES, MISSOURI 63301  
TEL (636) 724-8300  
FAX (636) 724-8304

TRACT C  
RIVER CROSSINGS

COLOR SITE PLAN  
HOLIDAY INN EXPRESS  
CHESTERFIELD, MO

TRACT - D  
2.461 ACRES  
ARNAGE LLC  
(SHOP AT RIVER CROSSINGS)

ARNAGE BLVD.

ARNAGE ROAD

PATIO AREA

PROPOSED HOLIDAY  
INN EXPRESS  
ELEV. = 458.10  
TRACT - C  
1.173 ACRES  
PUB. INVESTMENTS

LOT 1  
2.461 ACRES  
JCP PROPERTIES LLC  
(VILLA PARROTTO)









- KBY**
- BUILDING FOOTPRINT
  - GREEN SPACE
  - ASPHALT PAVEMENT
  - POROUS ASPHALT PAVEMENT
  - CONCRETE







FRONT ELEVATION  
SCALE: 1/8"=1'-0"

- LEGEND**
-  BRICK - COLOR 2  
BELDEN - TUMBLENEED VELOUR
  -  BRICK - COLOR 1  
BELDEN - RIVER RED VELOUR
  -  STONE  
BORAL PRO-FIT LEDGESTONE  
FLIN CREEK
  -  EIFS  
SYNERGY - 3100 BRISLIT
  -  SHEET METAL FLASHING  
@EIFS - ROLLEX - CORNSILK
  -  STONE TRIM - AT BRICK
  -  WINDOWS / STOREFRONT /  
GRILLES / ENTRY SYSTEMS  
CLEAR ANODIZED ALUMINUM COLOR
  -  ENTRY CANOPY  
BLUE GRIP SYSTEM

NOTE:  
ROOFTOP EQUIPMENT SHOWN  
DOTTED IS SHIELDED FROM PUBLIC  
VIEW BY THE BUILDING PARAPETS.



REAR ELEVATION  
SCALE: 1/8"=1'-0"



**Environics**  
 (618) 344-8699  
 FAX (618) 344-9120  
 Protects-Planners  
 6201 W. Main  
 Suite 150  
 Meryville, IL 62062  
 www.environics.com

JOB NO.  
14024

DATE:  
APRIL 29, 2016  
REVISIONS:




A NEW HOLIDAY INN EXPRESS & SUITES FOR  
**ROBERT L. PLUMMER**  
 CHESTERFIELD, MISSOURI  
 EXTERIOR ELEVATIONS

SHEET  
**A2.00**  
 OF X






FRONT CANOPY ELEVATION  
SCALE: 1/8" = 1'-0"

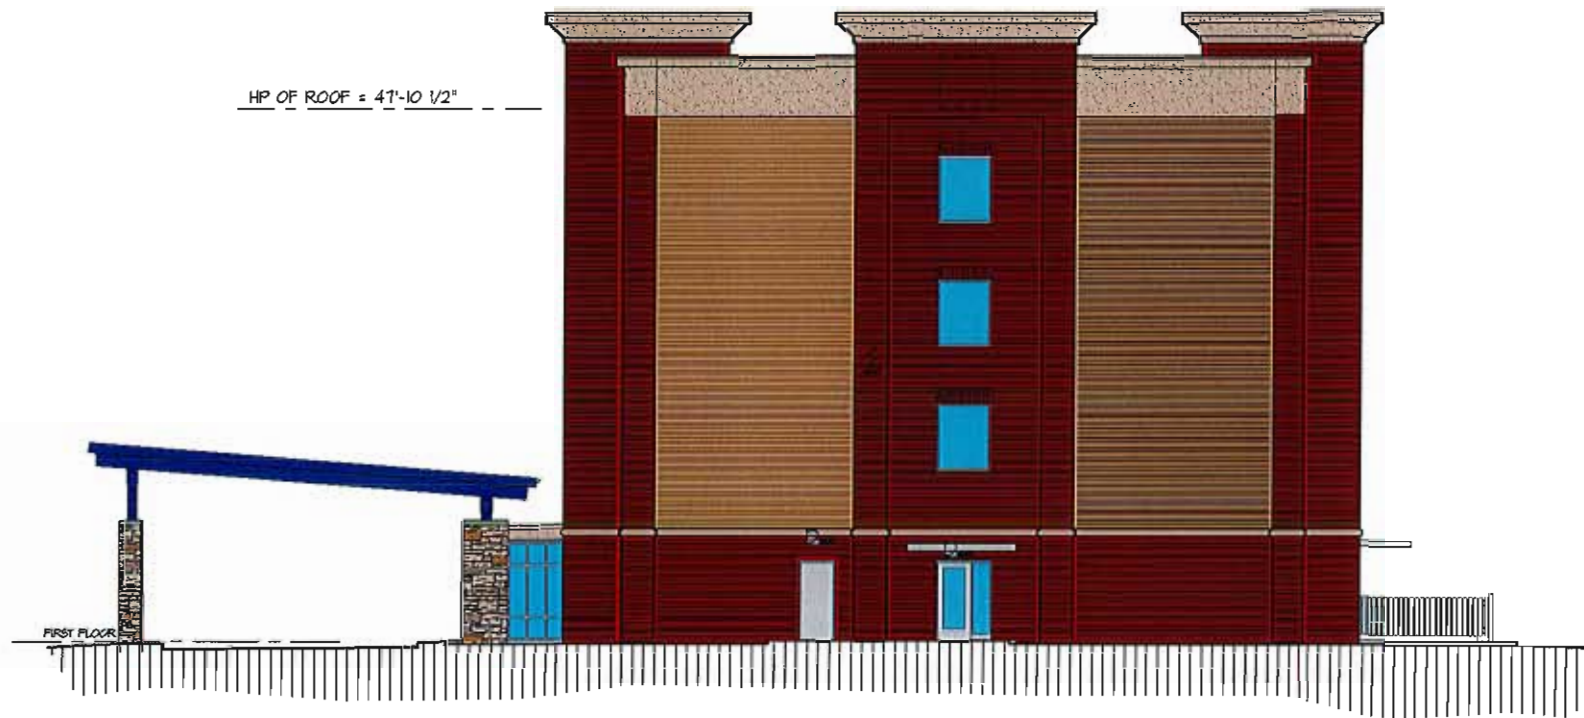

SIDE ELEVATION  
SCALE: 1/8" = 1'-0"

NOTE:  
ROOFTOP EQUIPMENT SHOWN  
DOTTED IS SHIELDED FROM PUBLIC  
VIEW BY THE BUILDING PARAPETS.

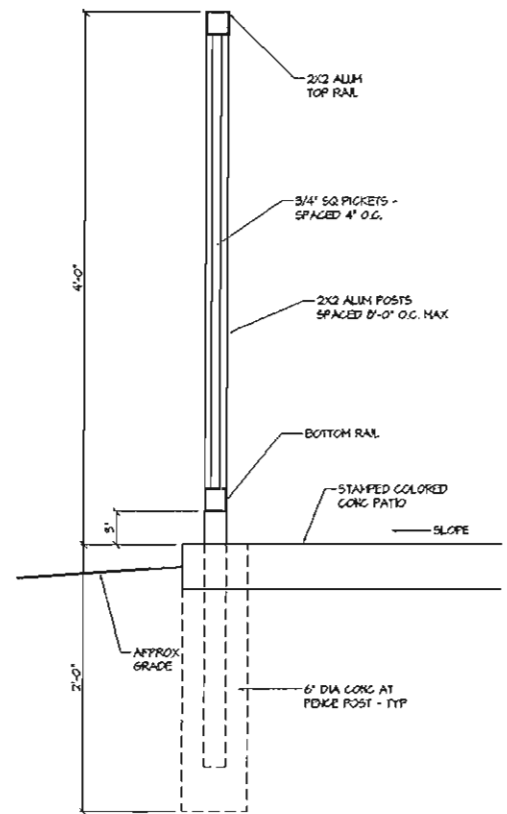


1  
A2.01 FENCE AT PATIO  
SCALE: 1/2" = 1'-0"



SIDE ELEVATION  
SCALE: 1/8" = 1'-0"

LEGEND

- BRICK - COLOR 2  
BELDEN - TUMBLEWEED VELOUR
- BRICK - COLOR 1  
BELDEN - RIVER RED VELOUR
- STONE  
BORAL PRO-FIT LEDGESTONE  
PLUM CREEK
- EPS  
SENERGY - BICO BISCUIT
- SHEET METAL FLASHING  
#8F5 - ROLLEX - CORNBLK
- STONE TRIM - AT BRICK
- WINDOWS / STOREFRONT /  
GRILLES / ENTRY SYSTEMS  
CLEAR ANODIZED ALUMINUM COLOR
- ENTRY CANOPY  
BLUE GRIP EMBASE



(618) 344-8899  
FAX (618) 344-8120  
**Environ**  
Architects-Planners  
220 S. W. 150  
Mesa, IL 62422  
www.environpa.com





JOB NO.  
14024

DATE:  
APRIL 29, 2016  
REVISIONS:



A NEW HOLIDAY INN EXPRESS & SUITES FOR  
**ROBERT L. PLUMMER**  
CHESTERFIELD, MISSOURI  
EXTERIOR ELEVATIONS

SHEET  
**A2.01**  
OF X

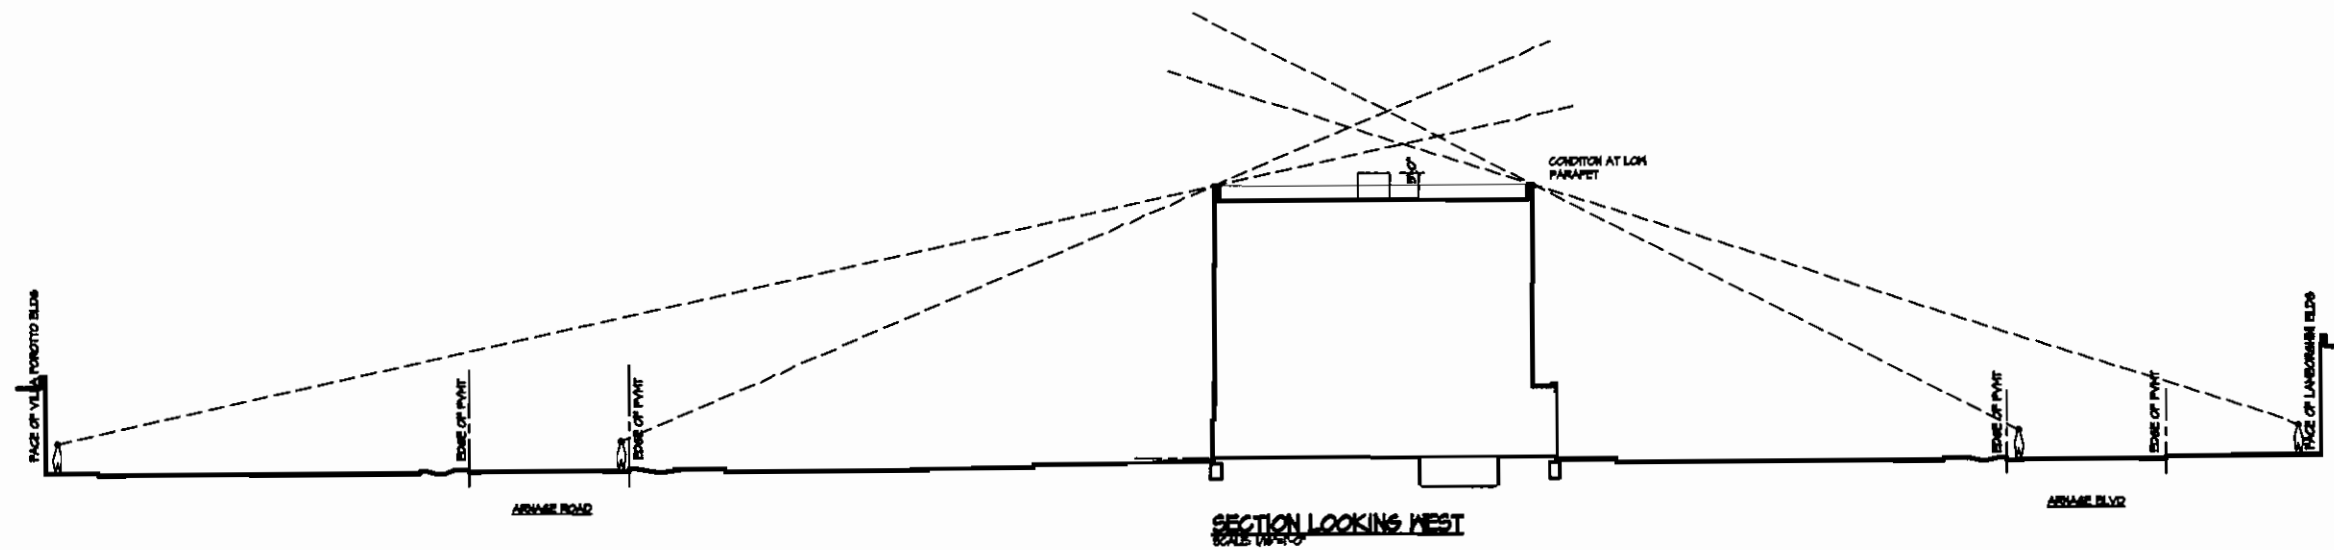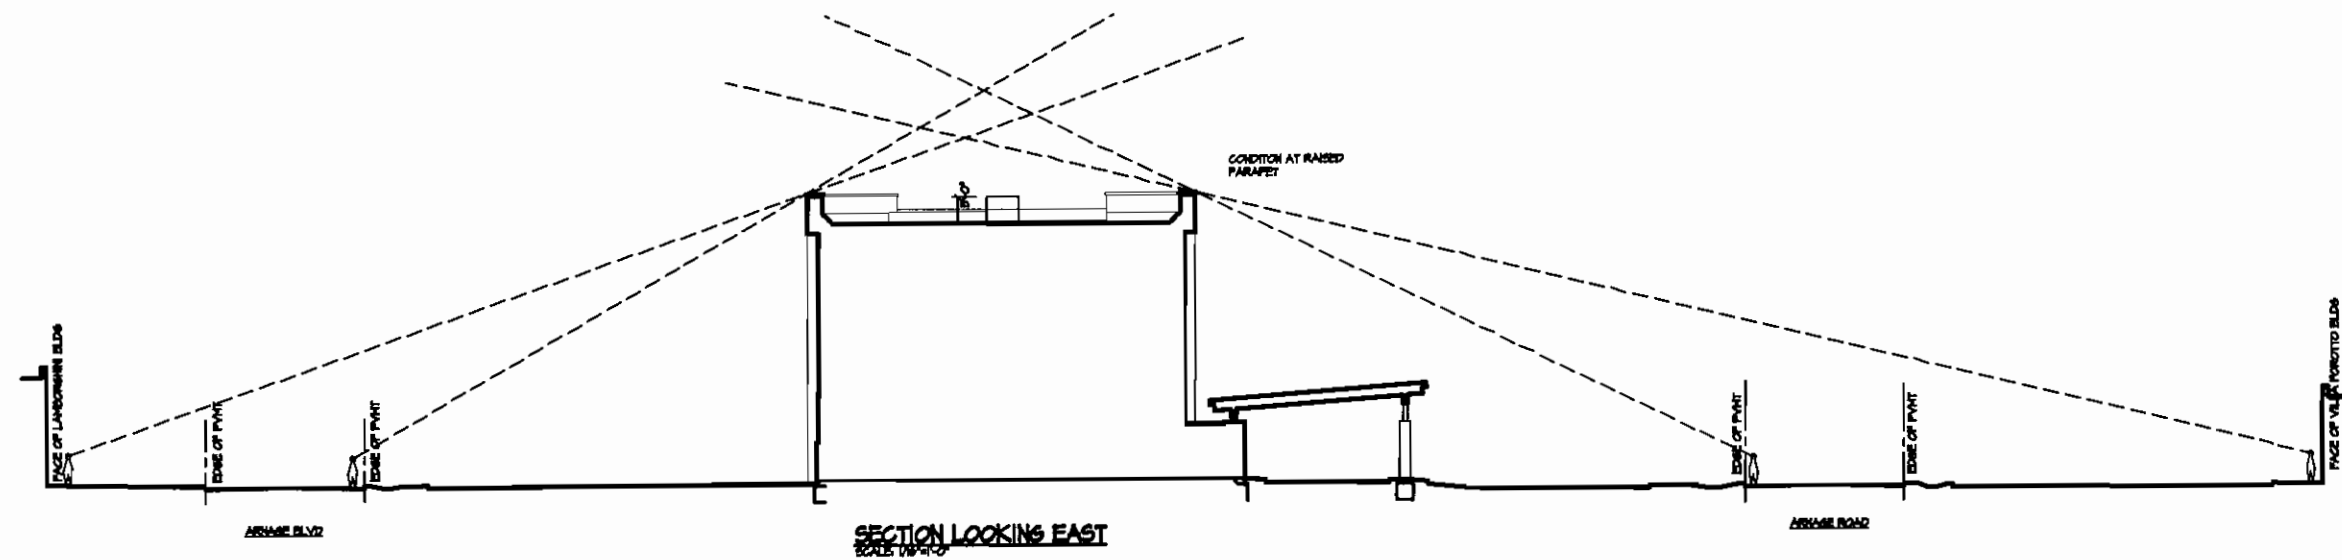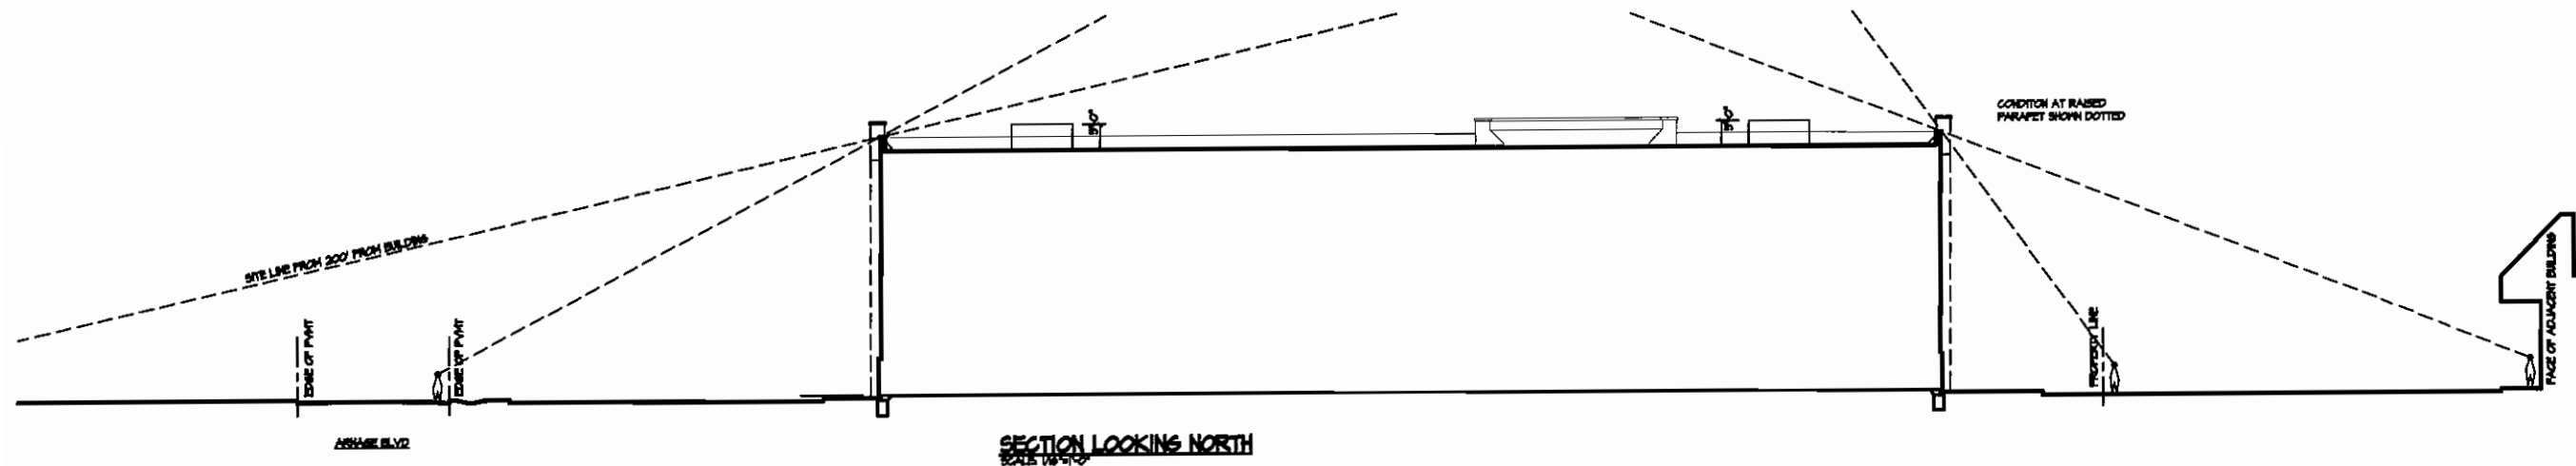

**Strotons**  
 (616) 344-8888  
 FAX (616) 344-8100  
 Architects-Planners  
 6207 W. Main  
 Suite 100  
 Marysville, E. 02002  
 info@strotons.com

JOB NO.  
14024

DATE  
APRIL 24, 2016  
REVISIONS




A NEW HOLIDAY INN EXPRESS & SUITES FOR  
**ROBERT L. PLUMMER**  
 CHESTERFIELD, MISSOURI

SHEET  
**A2.02**  
 OF X

© 2016 STROTONS ARCHITECTS - PLANNERS

SITE LINE STUDY

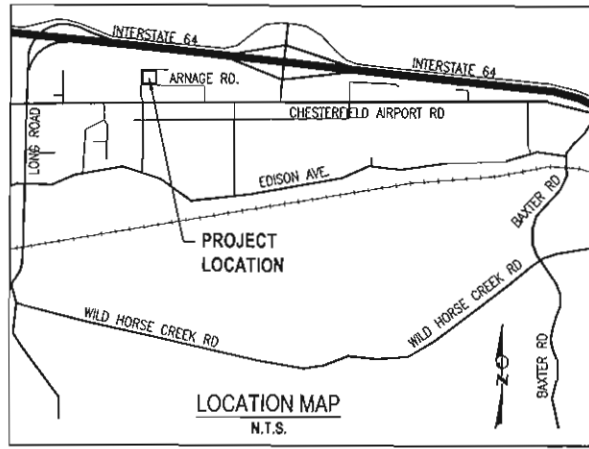

# SITE DEVELOPMENT SECTION PLAN

## LOT C OF RIVER CROSSINGS

### #11 ARNAGE BOULEVARD

### ZONED PC-PLANNED COMMERCIAL

### CITY OF CHESTERFIELD, ST. LOUIS COUNTY, MISSOURI

**PERTINENT DATA**

ZONED	=	PC-PLANNED COMMERCIAL
DRAINAGE	=	2556
WATER SERVICE	=	MISSOURI AMERICAN WATER COMPANY
SEWER DISTRICT	=	M.S.O.
GAS SERVICE	=	LALEDE GAS COMPANY
ELECTRIC SERVICE	=	AMEREN UE ELECTRIC COMPANY
FIRE DISTRICT	=	MONARCH FIRE PROTECTION DISTRICT
CABLE	=	CHARTER COMMUNICATIONS
PHONE SERVICE	=	SBC
SCHOOL DISTRICT	=	ROCKWOOD SCHOOL DISTRICT
FLOOD MAP PANEL	=	2918900165K

**THOUVENOT, WADE & MOERCHEN, INC.**  
ENGINEERS • SURVEYORS • PLANNERS



- CORPORATE OFFICE**  
4940 OLD COLLINSVILLE RD.  
SWANSEA, ILLINOIS 62226  
TEL (618) 624-4488  
FAX (618) 624-6688
- WATERLOO OFFICE**  
113 SOUTH MAIN STREET  
WATERLOO, ILLINOIS 62298  
TEL (618) 939-5050  
FAX (618) 939-3938
- EDWARDSVILLE OFFICE**  
600 COUNTRY CLUB VIEW, SUITE 1  
EDWARDSVILLE, ILLINOIS 62025  
TEL (618) 656-4040  
FAX (618) 656-4343
- ST. LOUIS OFFICE**  
720 OLIVE ST., SUITE 200A  
ST. LOUIS, MISSOURI 63101  
TEL (314) 241-6300  
FAX (314) 241-2391
- ST. CHARLES OFFICE**  
400 N. 5TH STREET, SUITE 101  
ST. CHARLES, MISSOURI 63301  
TEL (836) 724-8300  
FAX (836) 724-8304

**MSD BENCHMARK**  
12-171 ELEV. 460.06  
"STANDARD ALUMINUM DISK" STAMPED SL-38, 1990 AT THE N.W. CORNER OF CHESTERFIELD AIRPORT RD. & CAPRICE DR.

**SITE BENCHMARK**  
ELEV. 459.90  
CUT SQUARE ON NORTH SIDE OF LIGHT POLE ON SOUTH SIDE OF LOT C NORTH OF ARNAGE ROAD


**LEGAL DESCRIPTION**  
TRACT C OF RIVER CROSSINGS, A SUBDIVISION OF A TRACT OF LAND BEING PART OF SHARES 1, 2 AND 3, OF THE SUBDIVISION OF THE ESTATE OF PETER STEFFAN IN U.S. SURVEY 125 AND 126 TOWNSHIP 45 NORTH, RANGE 4 EAST OF THE 5TH PRINCIPAL MERIDIAN, CITY OF CHESTERFIELD, ST. LOUIS COUNTY, MISSOURI, AS PER THE PLAT THEREOF RECORDED IN PLAT BOOK 350 PAGE 205 OF THE ST. LOUIS COUNTY RECORDS.

**GEOTECHNICAL STATEMENT**  
QUALITY TESTING AND ENGINEERING, INC. AT THE REQUEST OF PGB INVESTMENTS, INC. HAS PROVIDED GEOTECHNICAL SERVICES FOR TRACT C AS PROPOSED HEREON. A GEOTECHNICAL INVESTIGATION WAS CONDUCTED DURING SEPTEMBER 2015 FOR THE DEVELOPMENT OF TRACT C HEREON. OUR FINDINGS INDICATE THAT THE EARTH-RELATED ASPECTS ARE SUITABLE FOR THE DEVELOPMENT PROPOSED PURSUANT TO THE GEOTECHNICAL RECOMMENDATIONS SET FORTH.

**SURVEYOR'S CERTIFICATION**  
THIS IS TO CERTIFY THAT THOUVENOT, WADE & MOERCHEN, INC. HAS PREPARED THIS SITE DEVELOPMENT SECTION PLAN FROM A FIELD SURVEY AND RECORD INFORMATION AND DOES NOT REPRESENT A PROPERTY BOUNDARY SURVEY. THIS SITE DEVELOPMENT SECTION PLAN IS A CORRECT REPRESENTATION OF ALL EXISTING AND PROPOSED LAND DIVISIONS.

BY: EDGAR M. BARNAI, MO P.L.S. 2003000961  
EXPIRATION: 12/31/2015  
DATE:

**UTILITY NOTE**  
UNDERGROUND FACILITIES, STRUCTURES, AND UTILITIES HAVE BEEN PLOTTED FROM AVAILABLE SURVEY RECORDS AND INFORMATION, AND THEREFORE DO NOT NECESSARILY REFLECT THE ACTUAL EXISTENCE, NON-EXISTENCE, SIZE, TYPE, NUMBER, OR LOCATION OF THESE FACILITIES, STRUCTURES, AND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ACTUAL LOCATION OF ALL UNDERGROUND FACILITIES, STRUCTURES, AND UTILITIES. THESE PROVISIONS SHALL IN NO WAY ABSOLVE ANY PARTY FROM COMPLYING WITH THE UNDERGROUND FACILITY SAFETY AND DAMAGE PREVENTION ACT, CHAPTER 319 RSMO.



STL M.S.D. REF. NO: P-0026923-01  
M.S.D. BASE MAP: 17U  
PROJECT ZIP CODE: 63005

PREPARED FOR:  
PGB INVESTMENTS, INC.  
514 EAST VANADIA STREET  
EDWARDSVILLE, IL 62025  
ROB SCHWARTZ  
RPS@PGBDEVELOPMENT.COM  
(618) 655-7979

PGB INVESTMENTS, INC., THE OWNERS OF THE PROPERTY SHOWN ON THIS PLAN FOR AND IN CONSIDERATION OF BEING GRANTED APPROVAL OF SAID PLAN TO DEVELOP PROPERTY UNDER THE PROVISIONS OF SECTION 03.04, PLANNED COMMERCIAL OF THE CITY OF CHESTERFIELD UNIFIED DEVELOPMENT CODE, DO HEREBY AGREE AND DECLARE THAT SAID PROPERTY FROM THE DATE OF RECORDING THIS PLAN SHALL BE DEVELOPED ONLY AS SHOWN THEREON, UNLESS SAID PLAN IS AMENDED BY THE CITY OF CHESTERFIELD, OR VOIDED OR VACATED BY ORDER OF ORDINANCE OF THE CITY OF CHESTERFIELD COUNCIL.

(SIGNATURE): \_\_\_\_\_  
(NAME TYPED): ROBERT L. PLUMMER

STATE OF ILLINOIS }  
COUNTY OF MADISON } SS.

ON THIS \_\_\_\_ DAY OF \_\_\_\_\_, A.D. 20\_\_\_\_, BEFORE ME PERSONALLY APPEARED ROBERT L. PLUMMER, TO ME KNOWN, WHO, BEING SWORN IN, DID SAY THAT HE/SHE IS PRESIDENT OF PGB INVESTMENTS, INC., A CORPORATION IN THE STATE OF ILLINOIS,


AND THAT THE SEAL AFFIXED TO THE FOREGOING INSTRUMENTS IS THE CORPORATE SEAL OF SAID CORPORATION, AND THAT SAID INSTRUMENT WAS SIGNED ON BEHALF OF SAID CORPORATION BY AUTHORITY OF ITS BOARD OF DIRECTORS, AND THE SAID PRESIDENT

ACKNOWLEDGED SAID INSTRUMENT TO BE THE FREE ACT AND DEED OF SAID CORPORATION.

THIS SITE DEVELOPMENT PLAN WAS APPROVED BY THE CITY OF CHESTERFIELD PLANNING COMMISSION AND DULY VERIFIED ON THE DAY OF \_\_\_\_\_, 20\_\_\_\_, BY THE CHAIRPERSON OF SAID COMMISSION, AUTHORIZING THE RECORDING OF THIS SITE DEVELOPMENT SECTION PLAN PURSUANT TO CHESTERFIELD ORDINANCE NUMBER 200, AS ATTESTED TO BY THE PLANNING AND DEVELOPMENT SERVICES DIRECTOR AND THE CITY CLERK.


AMEE MASSIF, AICP  
PLANNING AND DEVELOPMENT SERVICES DIRECTOR  
CITY OF CHESTERFIELD, MO

VICKIE MASS, CITY CLERK  
CITY OF CHESTERFIELD, MO

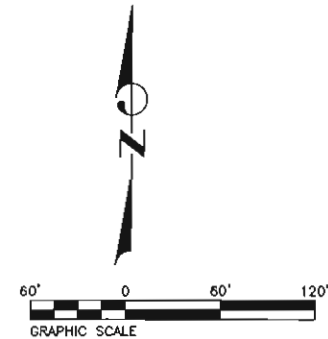

#### GENERAL NOTES

- BOUNDARY AND TOPOGRAPHIC SURVEY FOR TRACT C BY THOUVENOT, WADE & MOERCHEN, INC. LOTS 1-3 AND TRACTS A, B, & D BY RECORD INFORMATION.
- ALL UTILITIES SHOWN HAVE BEEN LOCATED BY THE ENGINEER FROM AVAILABLE RECORDS. THEIR LOCATION SHOULD BE CONSIDERED APPROXIMATE. THE CONTRACTOR HAS THE RESPONSIBILITY TO NOTIFY ALL UTILITY COMPANIES, PRIOR TO CONSTRUCTION, TO HAVE EXISTING UTILITIES FIELD LOCATED. SHOULD ANY CONFLICTS BE EVIDENT, THE CONTRACTOR SHALL NOTIFY THE OFFICE OF THE ENGINEER IMMEDIATELY.
- NO GRADE SHALL EXCEED 3:1 SLOPE.
- SUBJECT PROPERTY LIES WITHIN FLOOD ZONE "X" - AN AREA OF 500-YEAR FLOOD, 100-YEAR FLOOD WITH AVERAGE DEPTHS OF LESS THAN 1 FOOT OR DRAINAGE AREAS LESS THAN 1 SQUARE MILE, AND AREAS PROTECTED FROM THE 100-YEAR FLOOD BY LEVEES - AS IDENTIFIED ON MAP 2918900165K AS REVISED TO REFLECT THE LOWR DATED FEBRUARY 4, 2015.
- PARKING TO MEET CITY CODE.
- MAXIMUM HEIGHTS OF ALL BUILDINGS, EXCLUSIVE OF ROOF SCREENING AND PARAPET WALLS, SHALL NOT EXCEED FOUR STORIES OR 48 FEET (AS MEASURED FROM EXISTING GRADE), WHICHEVER IS LESS
- ALL PROPOSED IMPROVEMENTS SHALL BE CONSTRUCTED TO CITY OF CHESTERFIELD STANDARDS
- ON-SITE STORM WATER DRAINAGE REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE CHESTERFIELD VALLEY MASTER STORM WATER DRAINAGE PLAN.
- GRADING AND STORM WATER PER M.S.D., CITY OF CHESTERFIELD, AND THE MONARCH LEVEE DISTRICT.
- STORM WATER SHALL BE DISCHARGED AT AN ADEQUATE NATURAL DISCHARGE POINT. SINKHOLES ARE NOT ADEQUATE DISCHARGE POINTS.
- NO STEP ALLOWED AT ACCESSIBLE ENTRANCE DOORS.
- APPROVAL OF THIS PLAN DOES NOT CONSTITUTE APPROVAL OF SIGNAGE. SIGN APPROVAL IS A SEPARATE PROCESS.
- ALL UTILITIES SHALL BE INSTALLED UNDERGROUND. UTILITIES AND EASEMENTS THAT CROSS OVER CHESTERFIELD VALLEY MASTER STORMWATER EASEMENTS SHALL BE SUBORDINATE TO THE CHESTERFIELD VALLEY STORMWATER EASEMENTS.
- A CERTIFICATE OF THE ACTUAL ELEVATION OF THE CONSTRUCTED FLOOR WILL BE REQUIRED PRIOR TO OCCUPANCY OF EACH BUILDING, FOR WHICH A FLOODPLAIN DEVELOPMENT PERMIT IS ISSUED.

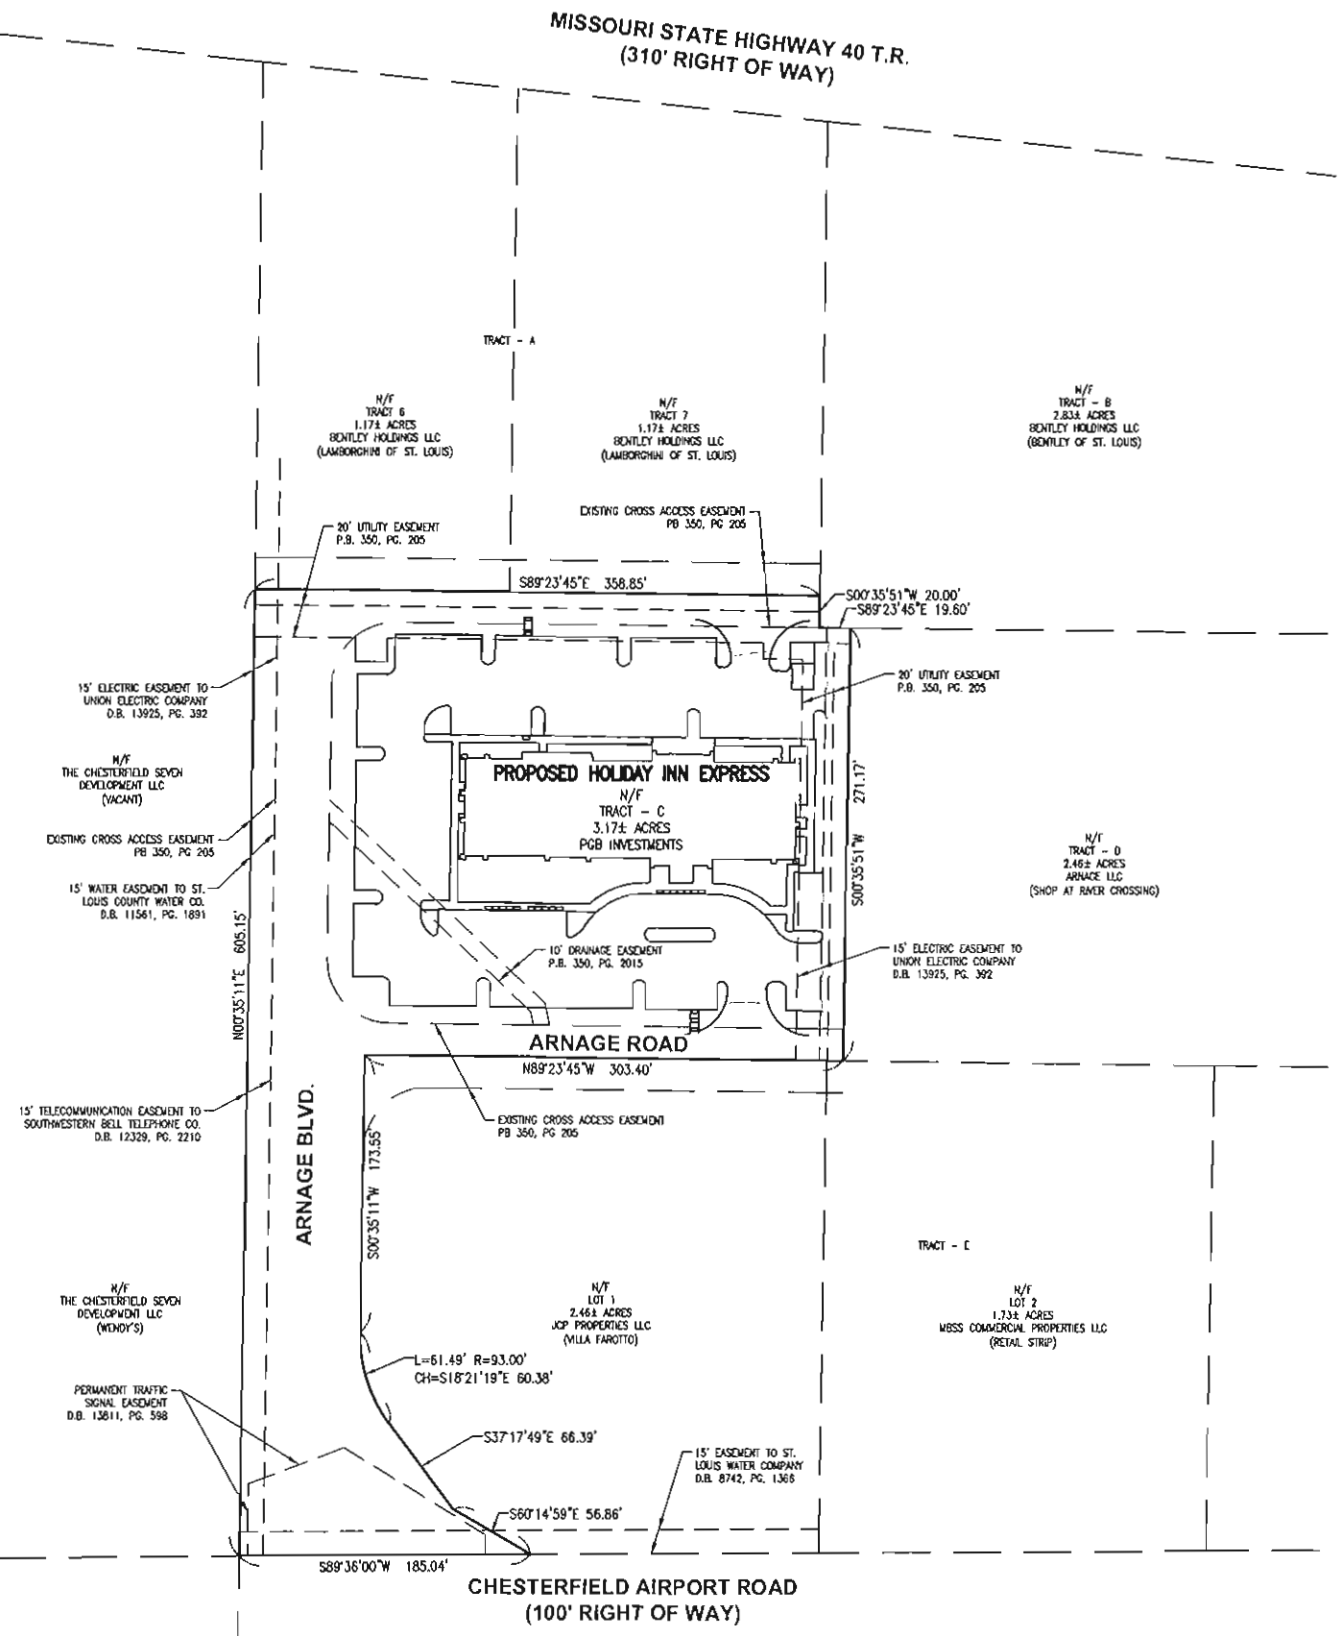

COVER SHEET  
AND GENERAL NOTES  
SITE DEVELOPMENT SECTION PLAN

PROJECT:  
HOLIDAY INN EXPRESS  
CITY OF CHESTERFIELD  
ST. LOUIS COUNTY, MISSOURI

REV	DATE	DESCRIPTION

DRAWN BY: CDK	SHEET
DESIGNED BY: CDK	<b>S1</b>
CHECKED BY: M/JM	OF 3 SHEETS
APPROVED BY: M/JM	COVER
PROJECT NUMBER: D01140294	DATE: MAY 2, 2016
<input checked="" type="checkbox"/> ISSUED FOR REVIEW	<input type="checkbox"/> ISSUED FOR BIDDING
<input type="checkbox"/> ISSUED FOR CONST.	<input type="checkbox"/> RECORD DRAWING

PARKING SPACE DIMENSION REDUCTION TO 9'x18'  
ADEQUATE ROOM AVAILABLE  
REDUCTION NOT IN GREENSPACE  
LANDSCAPE SHALL NOT BE AFFECTED BY VEHICLE OVERHANGS

RIVER CROSSINGS DEVELOPMENT  
PERMITTED SQUARE FOOTAGE = 189,000 SF  
EXISTING STRUCTURES SQUARE FOOTAGE = 96,029 SF  
PROPOSED HOLIDAY INN SQUARE FOOTAGE = 52,603 SF  
TOTAL SQUARE FOOTAGE = 161,980 SF  
REMAINING RIVER CROSSINGS SQUARE FOOTAGE = 27,020 SF

TOTAL NUMBER OF ROOMS = 91  
TOTAL PARKING SPACES REQUIRED = 109  
(120% x NUMBER OF ROOMS)  
PARKING SPACES PROVIDED = 109  
ACCESSIBLE SPACES = 4

THERE SHALL BE NO CONFERENCE ROOMS,  
RESTAURANTS, OR BANQUET FACILITIES IN  
CONJUNCTION WITH THIS HOTEL.

TRACT - C  
(PER PRELIMINARY DEVELOPMENT PLAN)  
TOTAL AREA = 3.17 ACRES  
OPEN SPACE = 0.579 ACRES  
PERCENT OPEN SPACE = 18%

TRACT - C  
(AS PROVIDED)  
TOTAL AREA = 3.17 ACRES  
OPEN SPACE = 0.75 ACRES  
PERCENT OPEN SPACE = 23.7%

REQUIRED BUILDING SETBACKS  
-120 FEET FROM WESTERN BOUNDARY  
-60 FEET FROM SOUTHERN INTERIOR ROAD  
-60 FEET FROM NORTHERN INTERIOR ROAD



PROVIDED BUILDING SETBACKS  
-136 FEET FROM WESTERN BOUNDARY  
-111 FEET FROM SOUTHERN INTERIOR ROAD  
-104 FEET FROM NORTHERN INTERIOR ROAD

FLOOR AREA RATIOS  
FIRST FLOOR = 13,543 SF  
SECOND FLOOR = 13,020 SF  
THIRD FLOOR = 13,020 SF  
FOURTH FLOOR = 13,020 SF  
TOTAL SQUARE FOOTAGE = 52,603 SF



ALL UTILITIES SHALL BE INSTALLED UNDERGROUND.  
SIGNAGE APPROVAL IS A SEPARATE PROCESS.

LEGEND

- RIGHT OF WAY
- PROPERTY LINE
- - - EX. EASEMENT
- - - PROP. EASEMENT
- 499 --- EXISTING CONTOURS MINOR
- 500 --- EXISTING CONTOURS MAJOR
- 499 --- PROPOSED CONTOURS MAJOR
- 500 --- PROPOSED CONTOURS MINOR
- - - W --- EX. WATER MAIN
- - - W --- PROP. WATER MAIN
- - - FW --- PROP. FIRE MAIN
- - - SAN --- EX. SANITARY SEWER MAIN
- - - SAN --- PROP. SANITARY SEWER MAIN
- - - STM --- EX. STORM SEWER
- - - STM --- PROP. STORM SEWER

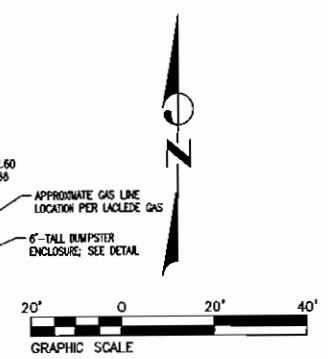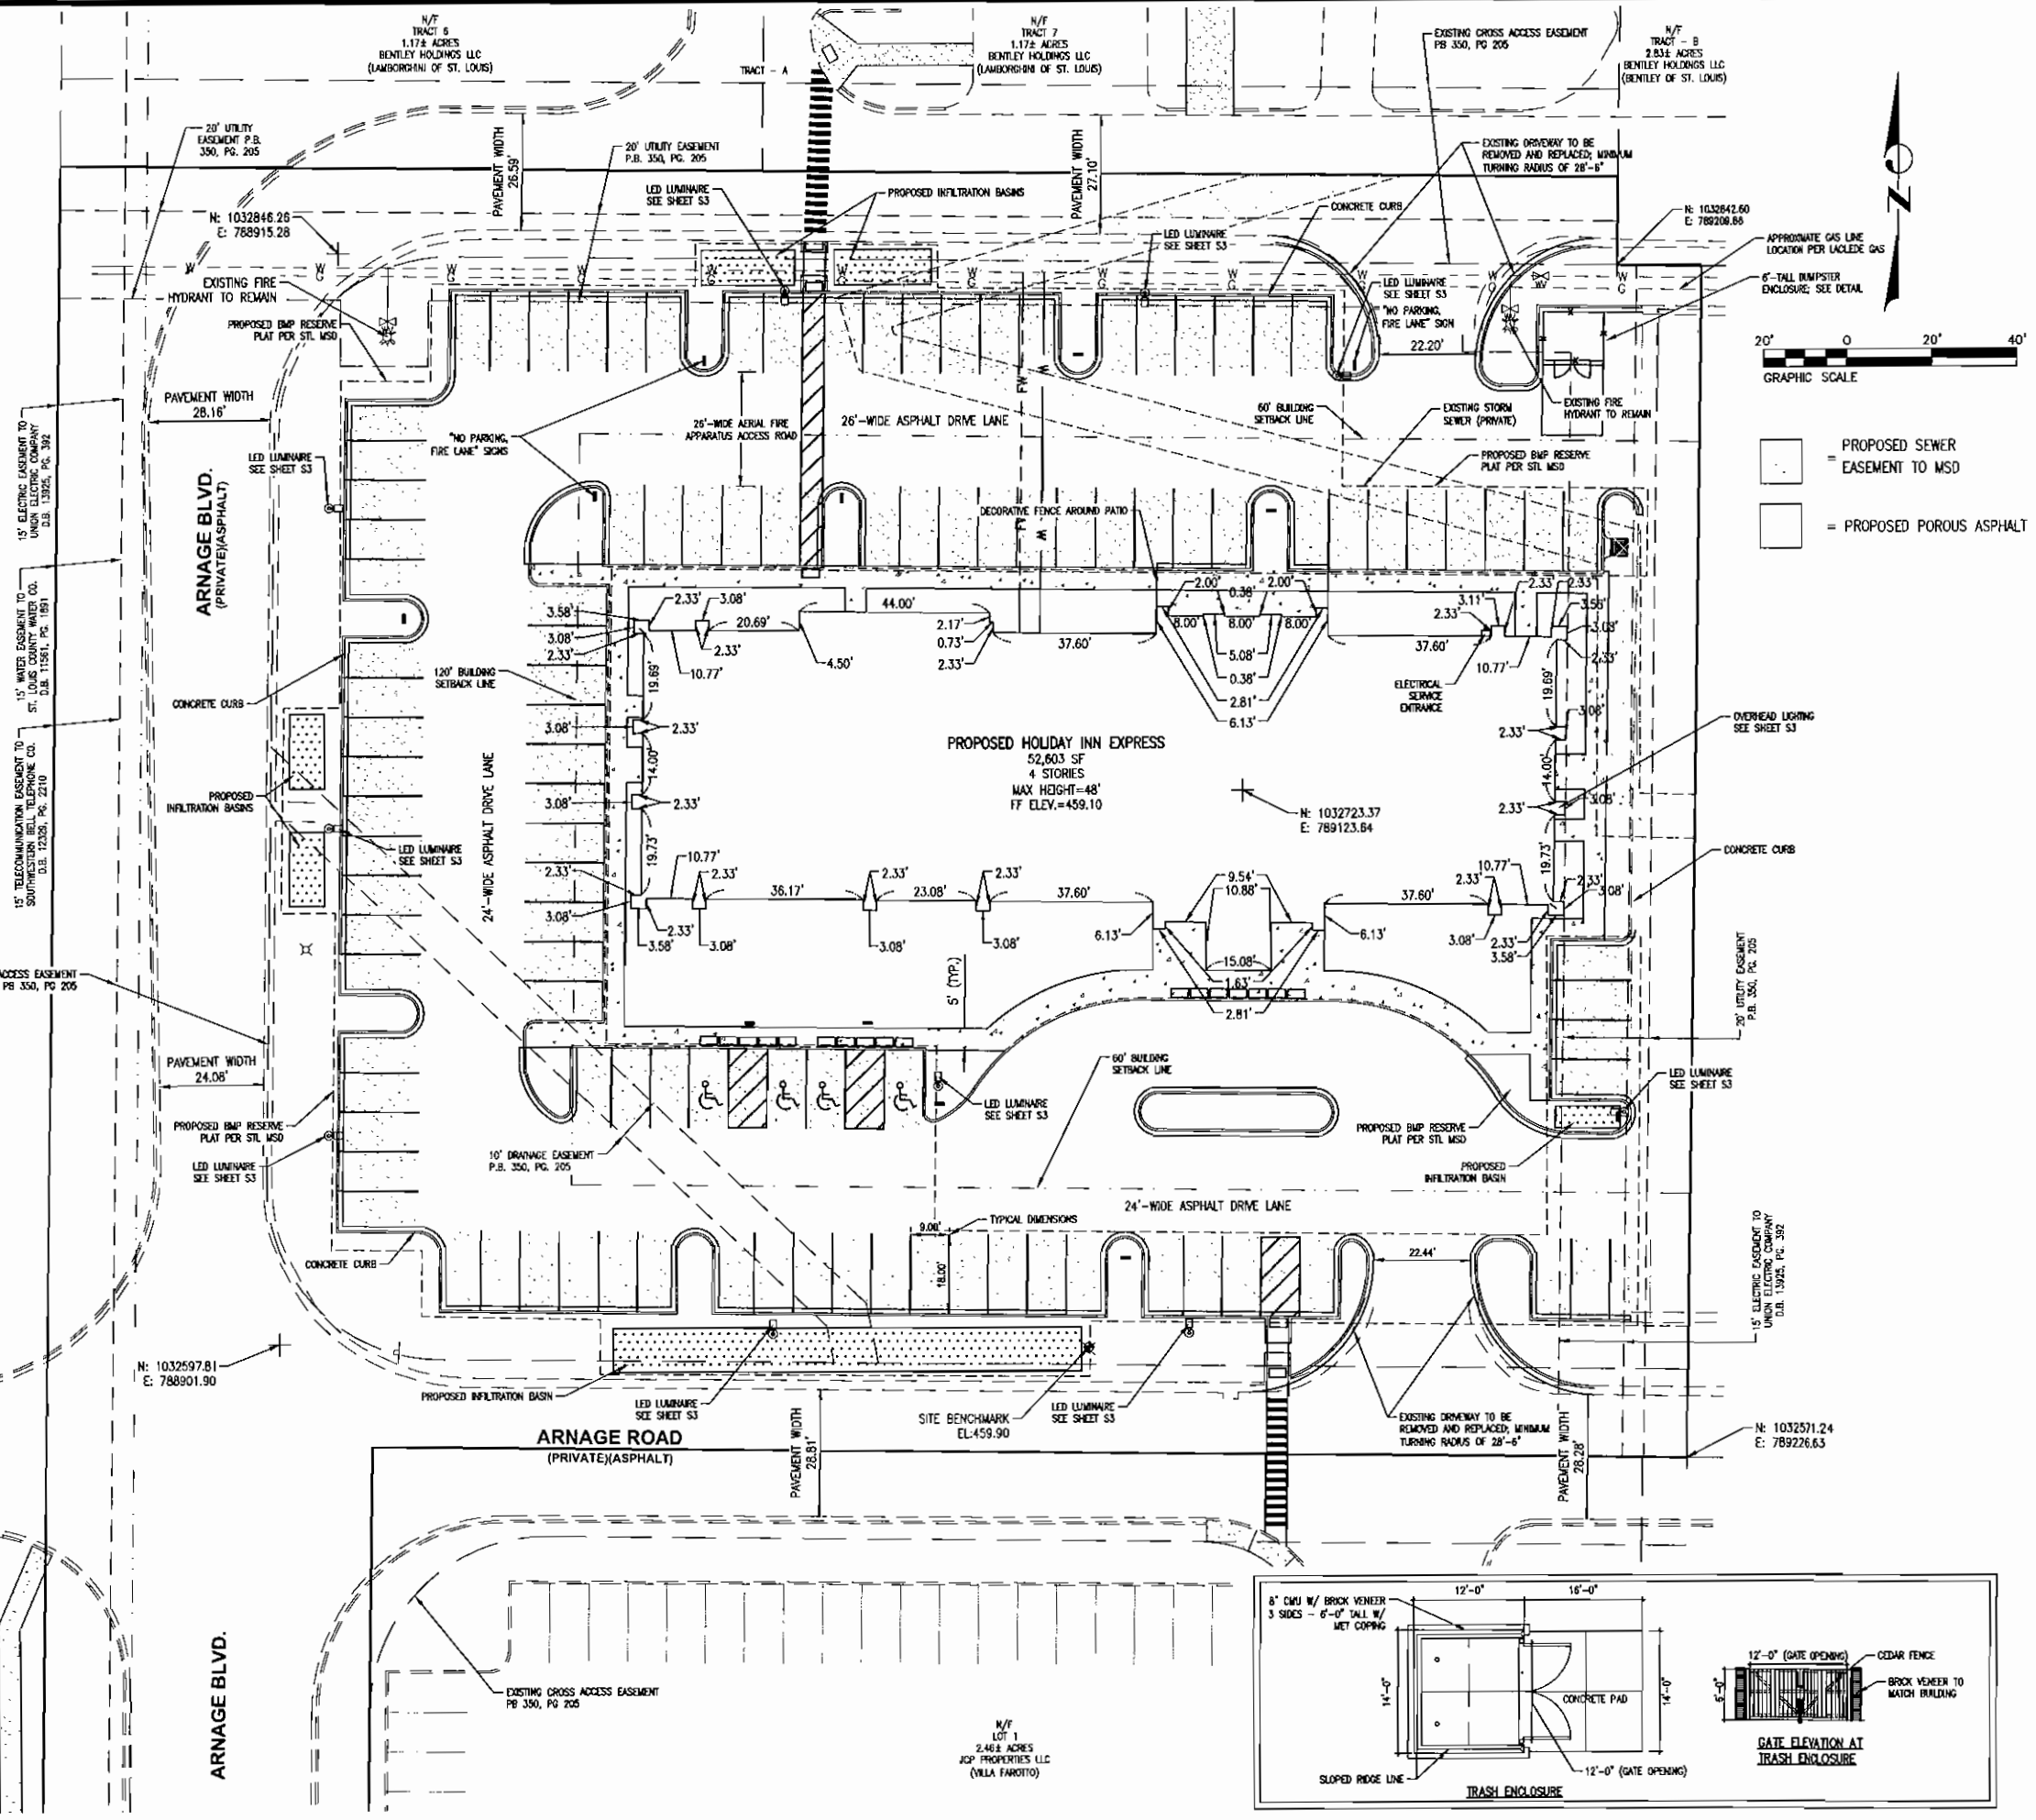

PROPOSED SEWER  
= EASEMENT TO MSD  
= PROPOSED POROUS ASPHALT

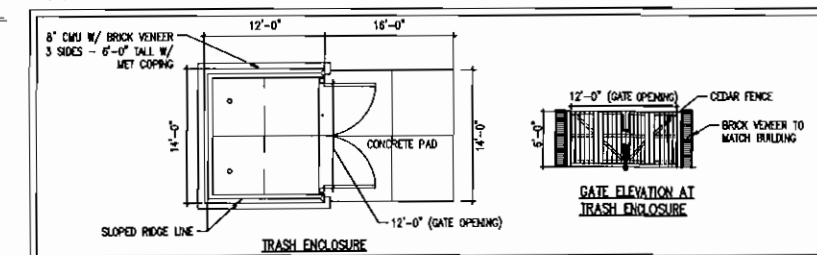

THOUVENOT,  
WADE &  
MOERCHEN, INC.  
ENGINEERS • SURVEYORS • PLANNERS



- ☑ CORPORATE OFFICE  
4940 OLD COLLINSVILLE RD.  
SWANSEA, ILLINOIS 62226  
TEL (618) 624-4488  
FAX (618) 624-6688
- ☐ WATERLOO OFFICE  
113 SOUTH MAIN STREET  
WATERLOO, ILLINOIS 62298  
TEL (618) 939-5050  
FAX (618) 939-3938
- ☐ EDWARDSVILLE OFFICE  
600 COUNTRY CLUB VIEW, SUITE 1  
EDWARDSVILLE, ILLINOIS 62025  
TEL (618) 656-4040  
FAX (618) 656-4343
- ☐ ST. LOUIS OFFICE  
720 OLIVE ST., SUITE 200A  
ST. LOUIS, MISSOURI 63101  
TEL (314) 241-6300  
FAX (314) 241-2391
- ☐ ST. CHARLES OFFICE  
400 N. 5TH STREET, SUITE 101  
ST. CHARLES, MISSOURI 63301  
TEL (636) 724-8300  
FAX (636) 724-8304



PROFESSIONAL REGISTRATIONS LICENSE NO.  
ILLINOIS PROFESSIONAL DESIGN FIRM 184-001220  
PROFESSIONAL ENGINEERING CORP. 62-035370  
PROFESSIONAL STRUCTURAL ENGR. CORP. 81-052502  
ILLINOIS PROF. LAND SURVEYING CORP. 048-000028  
MISSOURI PROFESSIONAL ENGR. CORP. MC 001528  
MISSOURI LAND SURVEYING CORP. MC 000346

SEAL  
MARSHA J. MALLER  
REGISTERED PROFESSIONAL ENGINEER  
Marsha J. Maller  
Marsha J. Maller  
MD Professional Engineer License #E-2000153348  
Signature Date: \_\_\_\_\_  
Expiration Date: \_\_\_\_\_  
STATEMENT OF RESPONSIBILITY  
I hereby confirm that the document herein to be authorized by my seal is restricted to this sheet, and I hereby disclaim any responsibility for all other drawings, specifications, estimates, reports or other documents or instruments relating to or intended to be utilized for any other part of the architectural, engineering or survey project.

TITLE: PROPOSED SITE PLAN  
SITE DEVELOPMENT SECTION PLAN  
PROJECT: HOLIDAY INN EXPRESS  
CITY OF CHESTERFIELD  
ST. LOUIS COUNTY, MISSOURI

REV.	DATE	DESCRIPTION

DRAWN BY: CDK SHEET  
DESIGNED BY: CDK S2  
CHECKED BY: MUM OF 3 SHEETS  
APPROVED BY: MUM SITE PLAN  
PROJECT NUMBER: D01140294 DATE: MAY 2, 2016  
ISSUED FOR REVIEW  ISSUED FOR BIDDING   
ISSUED FOR CONSTR.  RECORD DRAWING

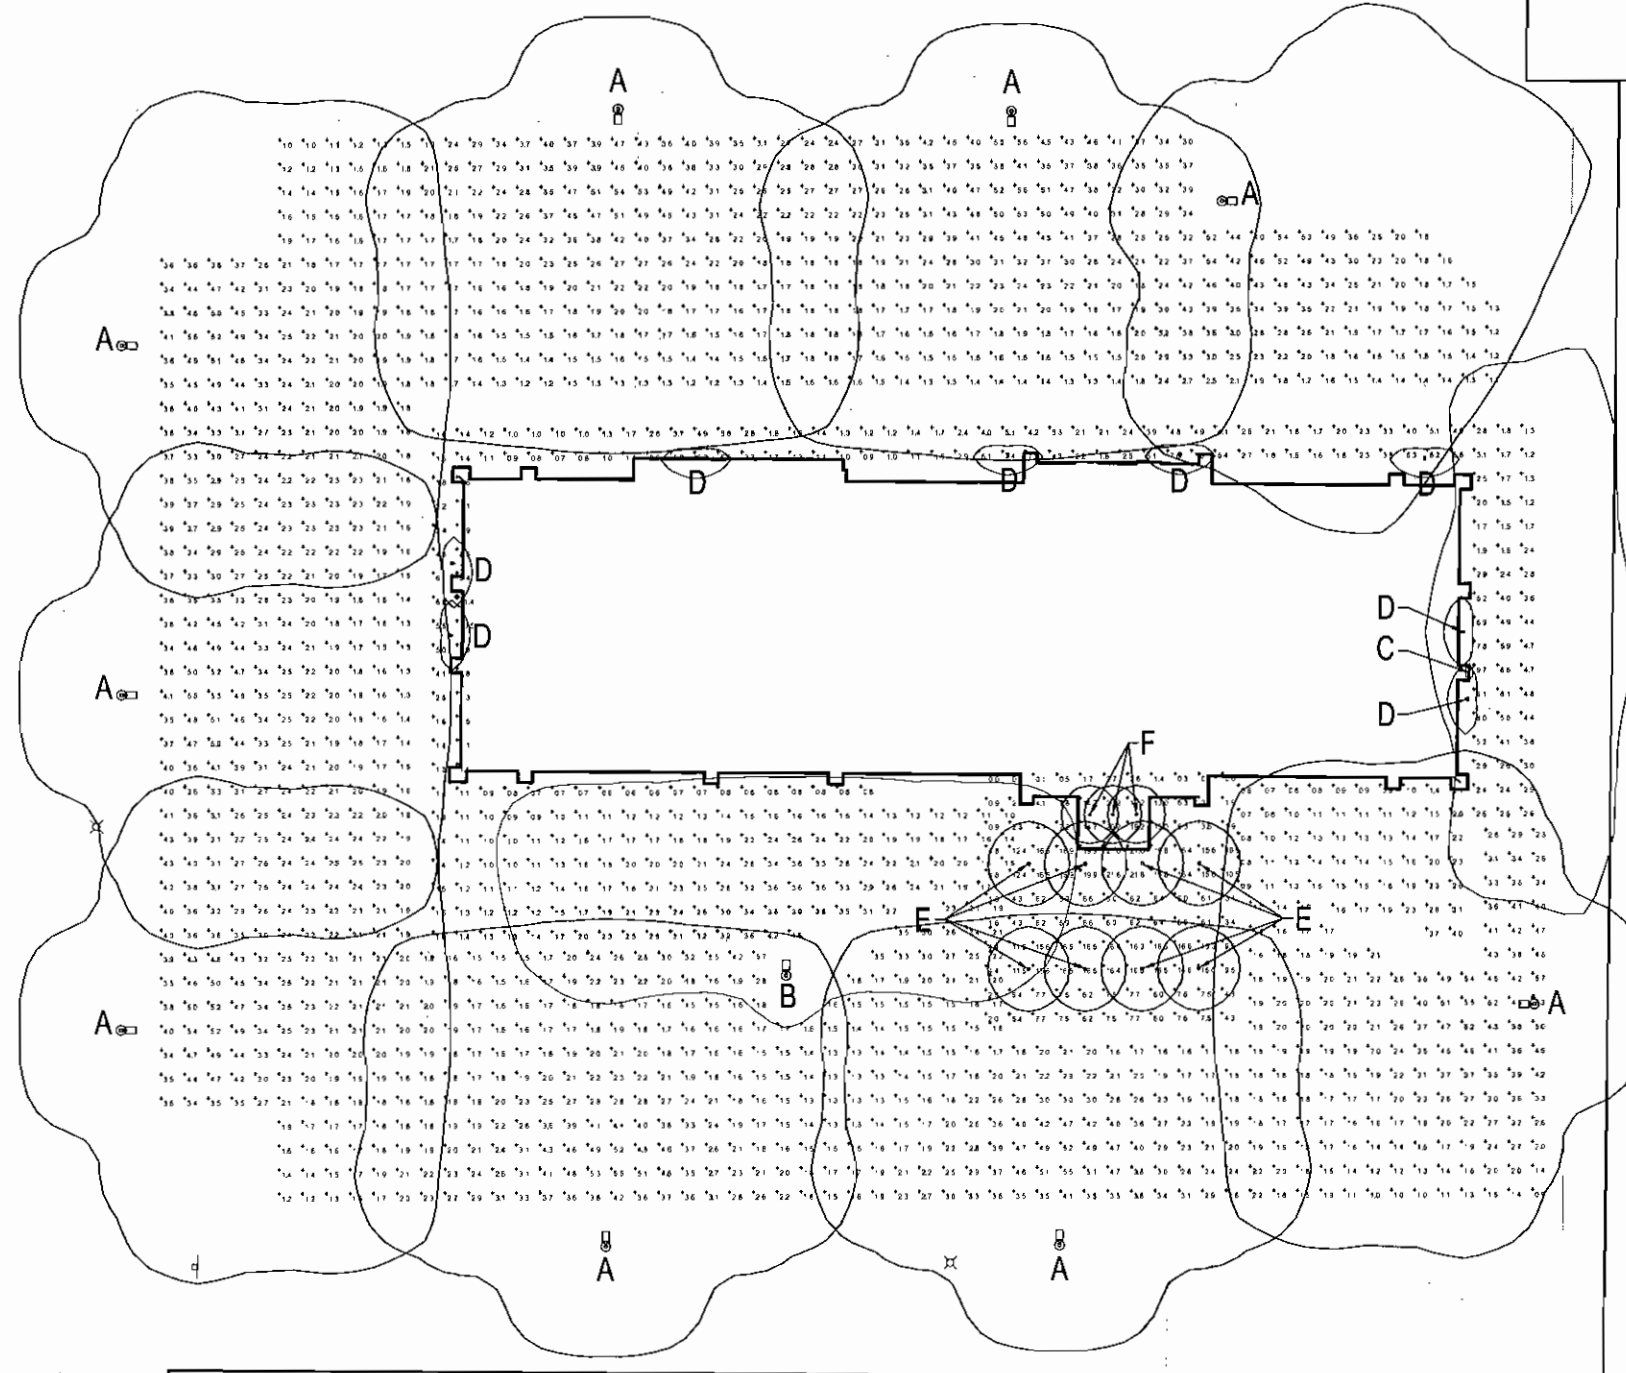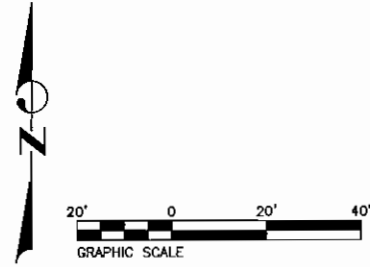

LEGEND

- A LED LUMINAIRE - COOPER LIGHTING CATALOG NO. GA-AE-03-LED-U-TAFT-XX-EA-7060, 15,760 LUMENS, 157 WATTS, 20' MOUNTING HEIGHT, TYPE 4 FORWARD THROW DISTRIBUTION WITH 10" EXTENDED ARM, 70 CRI, 6000K
- B LED LUMINAIRE - COOPER LIGHTING CATALOG NO. GA-AE-02-LED-U-SL3-XX-EA-7060, 10,500 LUMENS, 107 WATTS, 20' MOUNTING HEIGHT, TYPE 3 W/ SPILL CONTROL, DISTRIBUTION WITH 10" EXTENDED ARM, 70 CRI, 6000K
- C LED LUMINAIRE - COOPER LIGHTING CATALOG NO. GA-AE-01-LED-U-SL2-XX-WM-7060, 5,263 LUMENS, 56 WATTS, 25' MOUNTING HEIGHT, TYPE 2 W/ SPILL CONTROL DISTRIBUTION, WALL MOUNT, 70 CRI, 6000K
- D LED WALL SCONCE - LITHONIA CATALOG NO. WST LED-2-10A700/30K-SR4, 47W, 15' MOUNTING HEIGHT, TYPE 4, EMERGENCY BATTERY BACKUP, 3000K, DOWNWARD FACING
- E LED DOWNLIGHT - GOTHAM CATALOG NO. EVO-30-30-BAR-MWD-LS, 15' MOUNTING HEIGHT, 3000 K
- F LED DOWNLIGHT - GOTHAM CATALOG NO. EVO-35-15-6AR-MWD-LS, 15' MOUNTING HEIGHT, 1500K

CITY OF CHESTERFIELD UNIFIED DEVELOPMENT CODE 31-04-03 MINIMUM FOOTCANDLE LIGHTING STANDARDS		
DESCRIPTION	COMMERCIAL REQUIREMENT	PROVIDED
WALKWAYS, AVERAGE MAINTAINED	0.5	1.6
BUILDING ENTRANCES AND EXITS, AVERAGE MAINTAINED	5.0	6.8
MINIMUM INITIAL LEVEL AT ANY POINT ON THE PARKING AREA	0.5	1.0
MAXIMUM INITIAL LEVEL 5 FEET FROM THE BASE OF A LIGHT STANDARD	8.0	6.3

THOUVENOT,  
WADE &  
MOERCHEN, INC.  
ENGINEERS ♦ SURVEYORS ♦ PLANNERS



- CORPORATE OFFICE  
4940 OLD COLLINSVILLE RD.  
SWANSEA, ILLINOIS 62226  
TEL (618) 624-4488  
FAX (618) 624-6688
- WATERLOO OFFICE  
113 SOUTH MAIN STREET  
WATERLOO, ILLINOIS 62298  
TEL (618) 939-5050  
FAX (618) 939-3936
- EDWARDSVILLE OFFICE  
600 COUNTRY CLUB VIEW, SUITE 1  
EDWARDSVILLE, ILLINOIS 62025  
TEL (618) 656-4040  
FAX (618) 656-4343
- ST. LOUIS OFFICE  
720 OLIVE ST., SUITE 200A  
ST. LOUIS, MISSOURI 63101  
TEL (314) 241-6300  
FAX (314) 241-2391
- ST. CHARLES OFFICE  
400 N. 5TH STREET, SUITE 101  
ST. CHARLES, MISSOURI 63301  
TEL (636) 724-8300  
FAX (636) 724-8304

PROFESSIONAL REGISTRATIONS	LICENSE NO.
ILLINOIS PROFESSIONAL DESIGN FIRM	184-001290
PROFESSIONAL ENGINEERING CORP.	62-033370
PROFESSIONAL STRUCTURAL ENGR. CORP.	61-005202
ILLINOIS PROF. LAND SURVEYING CORP.	048-000029
MISSOURI PROFESSIONAL ENGR. CORP.	MC 001528
MISSOURI LAND SURVEYING CORP.	MC 000346

SEAL

Maresha J. Haller  
E-2000155348  
Signature Date: \_\_\_\_\_  
Expiration Date: \_\_\_\_\_


STATEMENT OF RESPONSIBILITY  
I hereby confirm that the document herein to be authenticated by my seal is restricted to this sheet, and I hereby disclaim any responsibility for all other drawings, specifications, schedules, reports or other documents or instruments relating to or intended to be utilized for any other part of the architectural, engineering or survey project.

TITLE: LIGHTING PLAN  
SITE DEVELOPMENT SECTION PLAN




PROJECT: HOLIDAY INN EXPRESS  
CITY OF CHESTERFIELD  
ST. LOUIS COUNTY, MISSOURI

REV	DATE	DESCRIPTION
▲		
▲		
▲		

DRAWN BY: CDK	SHEET
DESIGNED BY: CDK	<b>S3</b>
CHECKED BY: MJM	OF 3 SHEETS
APPROVED BY: MJM	DATE: MAY 2, 2016
PROJECT NUMBER: D01140294	DATE: MAY 2, 2016
<input checked="" type="checkbox"/> ISSUED FOR REVIEW	<input type="checkbox"/> ISSUED FOR BIDDING
<input type="checkbox"/> ISSUED FOR CONSTR.	<input type="checkbox"/> RECORD DRAWING

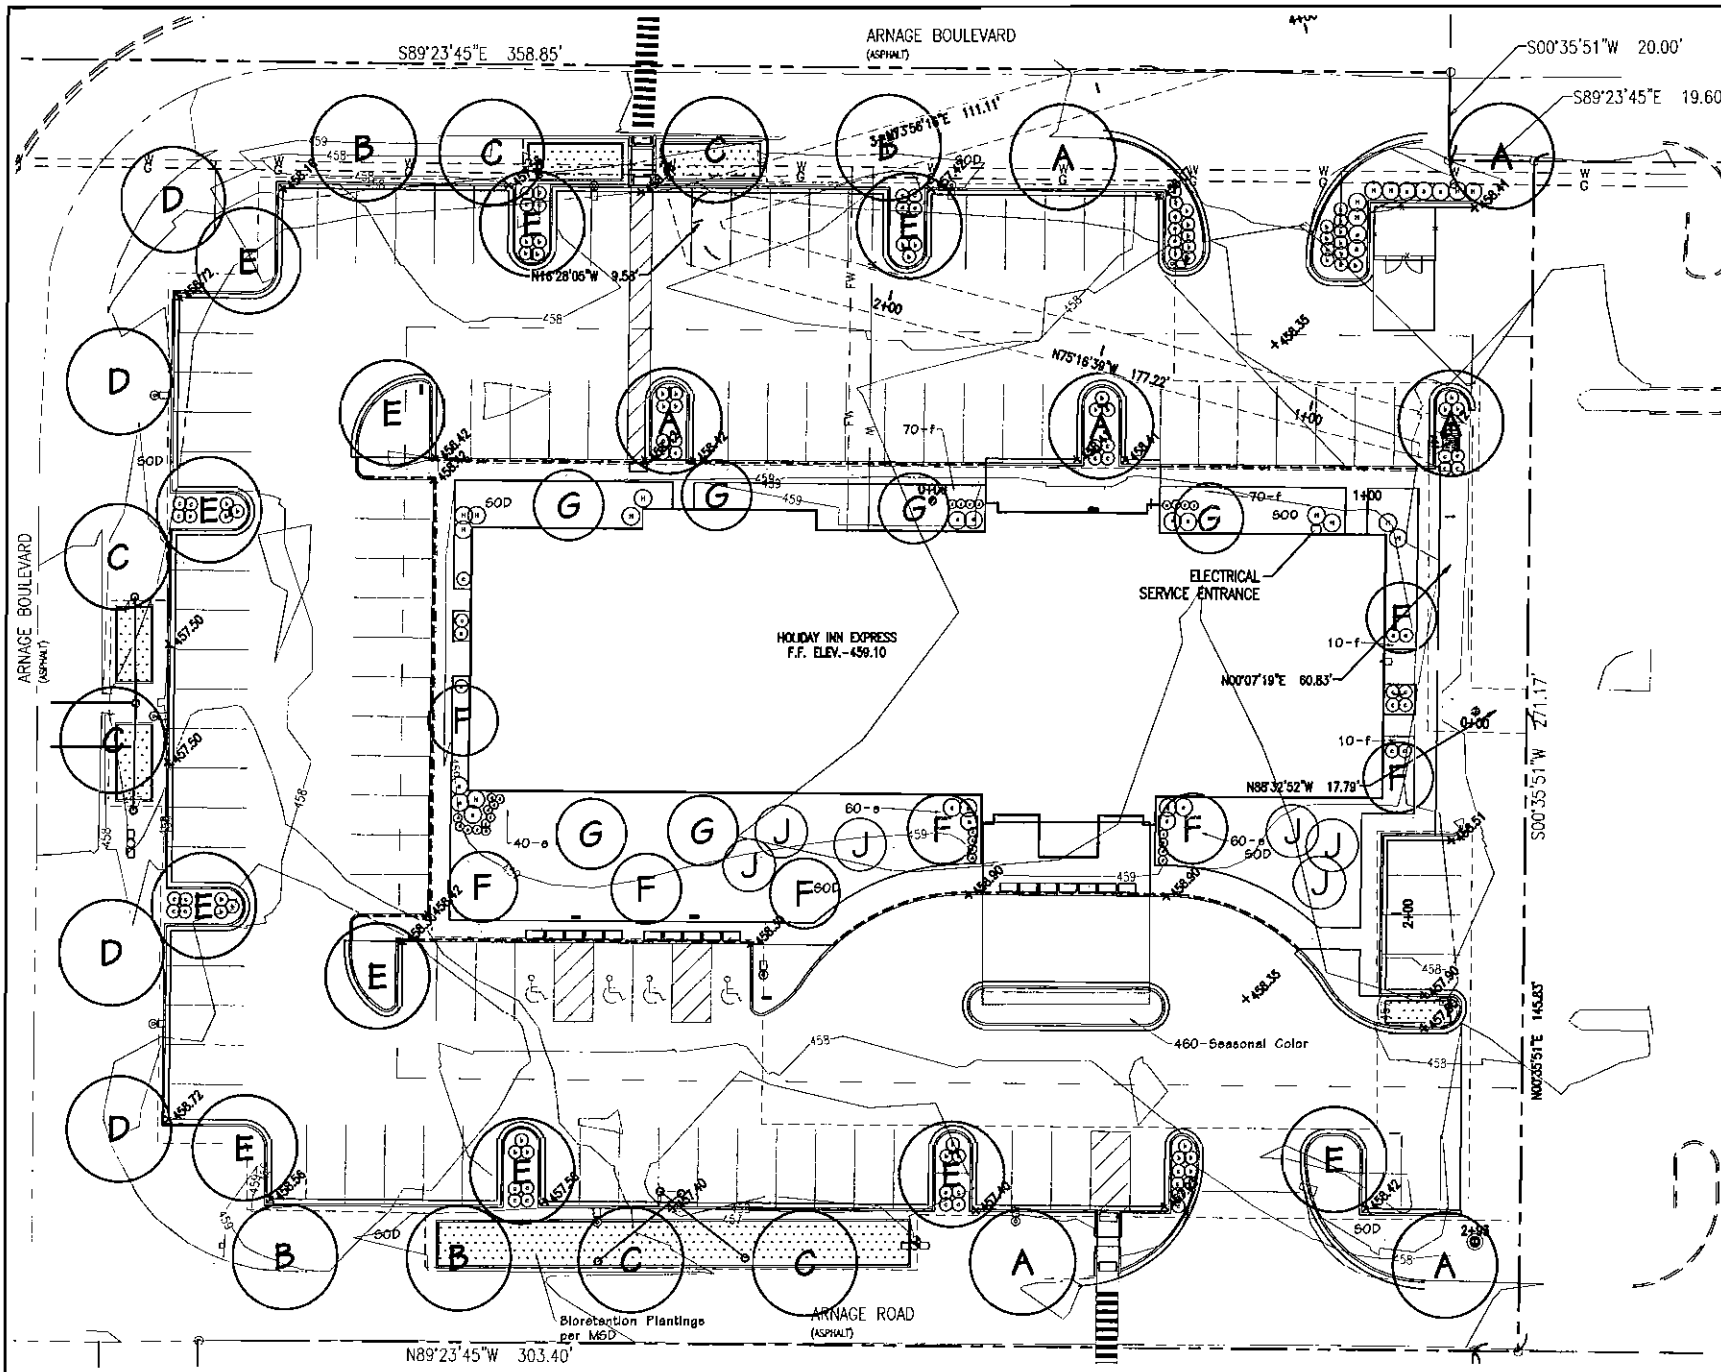

**Landscape Plan**  
SCALE 1"=20'

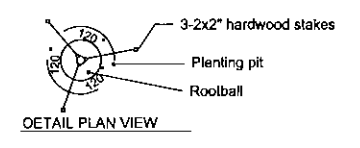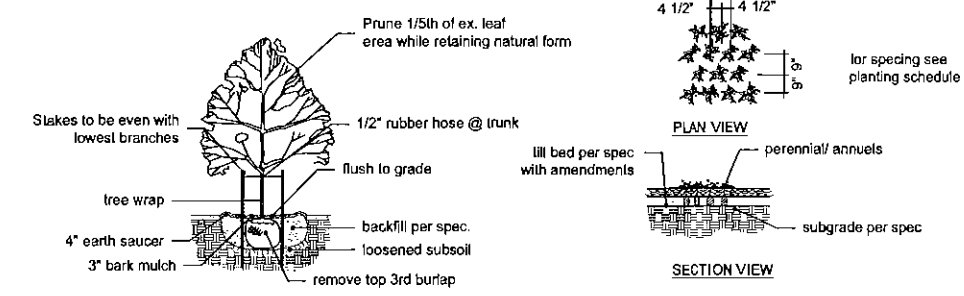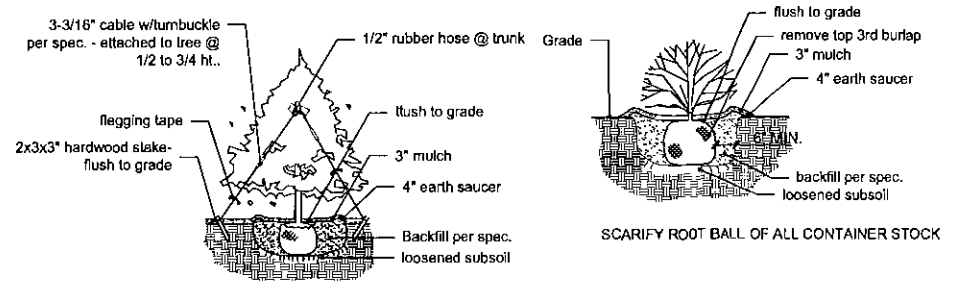

PLANTING SCHEDULE							
SYMBOL	QUANTITY	BOTANICAL NAME	COMMON NAME	SIZE	NATURE HEIGHT	TYPE	
A	7	Gleditsia t. Inermis 'Shademaester'	Shademaester Honeylocust	2 1/2"	45'+	Fast Growing	
B	4	Tilia americana	American Linden	2 1/2"	45'+	Medium Growing	
C	6	Quercus bicolor	Swamp White Oak	2 1/2"	45'+	Medium Growing	
D	4	Platanus x acerifolia	London Planetree	2 1/2"	45'+	Fast Growing	
E	11	Acer rubrum 'Red Sunset'	Red Sunset Red Maple	2 1/2"	45'+	Fast Growing	
F	8	Cercle canadensis	Red Bud	2 1/2"	25'+	Fast Growing	
G	6	Cornus florida	Flowering Dogwood	2 1/2"	15'+	Slow Growing	
H	16	Juniperus c. 'Hetzi Columnaris'	Hetzi Columnar Juniper	6"	20'+	Medium Growing	
J	6	Picea pungens	Colorado Spruce	6"	30-40'	Medium Growing	
a	20	Ilex glabra 'Shamrock'	Shamrock Inkberry	2-3'	3' O.C.		
b	53	Juniperus horizontalis 'Plumosa'	Compact Andorra Juniper	18-24"	3' O.C.		
c	55	Rosa 'Radrazz'	Knock out Rose	18-24"	3' O.C.		
d	27	Buxus elnica l. 'Wintergreen'	Wintergreen Boxwood	18-24"	2' O.C.		
e	160	Hemerocallis 'Stella de Oro'	Stella de Oro daylily	1 gal	12" O.C.		
f	160	Liriope muscari 'Big Blue'	Big Blue Liriope	1 qt	12" O.C.		
Bioretention Plantings per MSD							

- GENERAL NOTES:**
- 1) Openpace ratio is 25.7%
  - 2) Street trees Req. - 075 if/50 ft = 17.5 or 18 street trees
  - 3) All street trees will be located at least 3' from proposed curb.
  - 4) All street trees will be located at least 10' from all storm sewer structures.
  - 5) All turf areas will be sodded.
  - 6) An In-ground Irrigation system will be provided.
  - 7) Any future above ground utility structures to be screened per Ordinance.



Douglas A. DeLong, Landscape Architect LA-81

Consultants:

**HOLIDAY INN EXPRESS**  
**Chesterfield, Missouri**  
PGB Investments, Inc., Edwardsville, IL

Revisions:

Date	Description	No.
10/5/15	City Comments	1
10/27/15	City Comments	2
11/20/15	City Comments	3
12/11/15	City Comments	4

Drawn: BAD  
Checked: DAD

DeLong  
Landscape Architecture, LLC  
7620 West Bruno Ave  
St. Louis, MO. 63117  
(314) 346-4856  
delong.la@gmail.com

Sheet Title: Landscape Plan  
Sheet No: L-1  
Date: 7/31/15  
Job #: 146.001