

Architectural Review Board Staff Report

Project type: Site Development Plan

Meeting Date: September 14, 2023

From: Shilpi Bharti, Planner *SB*

Location: 17970 Edison Avenue

Description: **Damian Kroenung Estate (SDP)**: A Site Development Plan, Landscape Plan, Lighting Plan and Architectural Elevations for an office/warehouse building located on a 7.1-acre tract of land located south side of Edison Avenue, zoned “PI”-Planned Industrial.

PROPOSAL SUMMARY

Engenuity on behalf of Edison Partners LLC, has submitted a Site Development Plan, Landscape Plan, Lighting Plan, and Architectural Elevations for a proposed Office/warehouse building located at 17970 Edison Avenue. The project was presented in front of the Architectural Review Board on August 10. There were several comments related to general building design, and screening. The applicant requested to hold and the board approved the request by a vote of 4-0. Since then, the applicant has revised their submittal.

Proposed Development includes:

- 70,000 square feet of office and warehouse
- 64 parking spaces
- 7 loading spaces
- Landscape Plan
- Lighting Plan



Figure 1: Subject Site

CHANGES SINCE AUGUST ARB:

The applicant has updated the Elevations.

Updated elevations include 3/4” deep reveals and, painted tilt-up panels on the four sides of the building. Additionally, the applicant proposed painted concrete garbage enclosure and provided a sight

section to show the roof top equipment and screening. Site Plan, access and circulation remains the same, which the previous ARB report (attached) highlights the plan in detail.

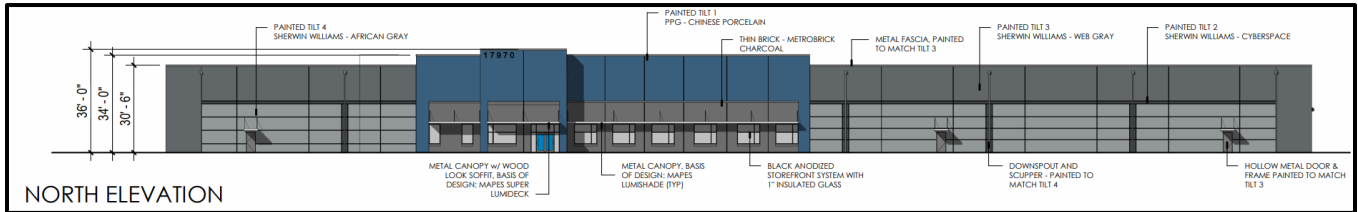


Figure 2: North Side Elevation

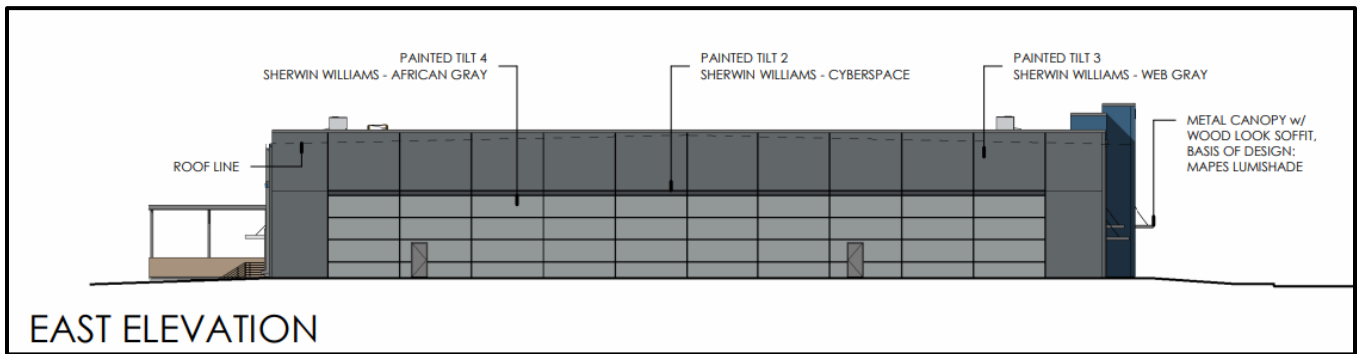


Figure 3: East Side Elevation

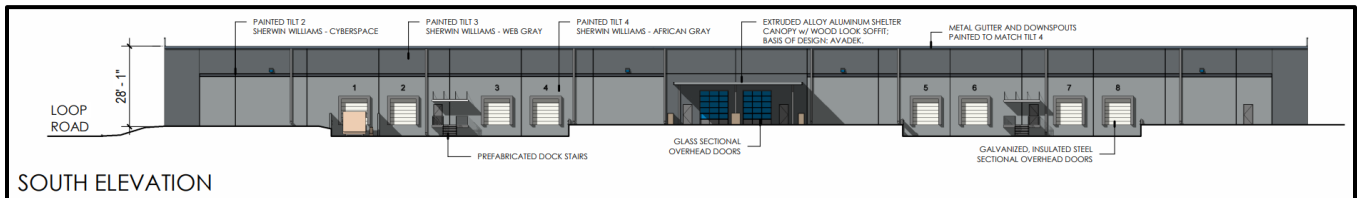


Figure 4: South Side Elevation

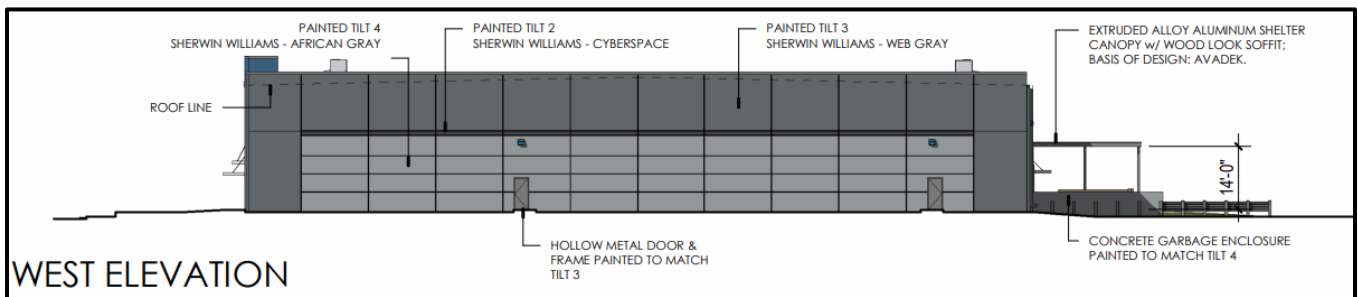


Figure 5: West Side Elevation

Rendering



Figure 7: Rendering

DEPARTMENTAL INPUT

Be advised, this project is still going through development review by City Staff and will not proceed to the Planning Commission until all outstanding items have been addressed. All recommendations made by the ARB will be included in Staff's report to the Planning Commission.

MOTION

The following options are provided to the Architectural Review Board for consideration relative to this application:

- 1) "I move to forward the Site Development Plan, Landscape Plan, Lighting Plan, and Architectural Elevations for Damian Kroenung Estate (SDP), as presented, with a recommendation for approval (or denial)."
- 2) "I move to forward the Site Development Plan, Landscape Plan, Lighting Plan, and Architectural Elevations for Damian Kroenung Estate (SDP), with a recommendation for approval with the following conditions..."

Attachments

1. ARB August 10 Staff report
2. Architectural Review Packet Submittal

Architectural Review Board Staff Report

Project type: Site Development Plan

Meeting Date: August 10, 2023

From: Shilpi Bharti, Planner *SB*

Location: 17970 Edison Avenue.

Description: **Damian Kroenung Estate (SDP)**: A Site Development Plan, Landscape Plan, Lighting Plan and Architectural Elevations for an office/warehouse building located on a 7.1-acre tract of land located south side of Edison Avenue, zoned “PI”-Planned Industrial.

PROPOSAL SUMMARY

Engenuity on behalf of Edison Partners LLC, has submitted a Site Development Plan, Landscape Plan, Lighting Plan, and Architectural Elevations for a proposed Office/warehouse building located at 17970 Edison Avenue.

Proposed Development includes:

- 70,000 square feet of office and warehouse
- 64 parking spaces
- 7 loading spaces
- Landscape Plan
- Lighting Plan



Figure 1: Subject Location

HISTORY OF SUBJECT SITE

The site is located in Ward 4 of the City of Chesterfield. The subdivision was zoned “M3” – Planned Industrial District prior to the City’s incorporation. In 2004, the site was rezoned to “PI” – Planned Industrial following the City ordinance 2124. In 2023, the site-specific ordinance 2124 was amended to modify the existing setbacks, and building square feet requirements. The current ordinance governing the site is ordinance 3242.

STAFF ANALYSIS

The proposed 70,000 sq. ft. building will be located in the center of the site. There are two curb cuts proposed on Edison Avenue, and one access to the shared drive on the east. City of Chesterfield Unified Development Code (UDC) has defined Site and Building design standards for buildings with different usages. The design standards for Commercial and Industrial Architecture are described in Table 1. The UDC also provides general requirements for building design and site design which are further described in the report.

	Access	Landscaping and Screening	Site Design
Commercial and Industrial Architecture	Locate service and loading areas away from public streets and out of the main circulation system and parking areas. Provide access for service vehicles, trash collection and storage areas from alleys when possible.	Screen utility meters, and surface transformer switching pads.	Design and locate building equipment and utilities to minimize visibility from public streets, surface parking lots, and neighboring properties.

Table 1: UDC Design Standards

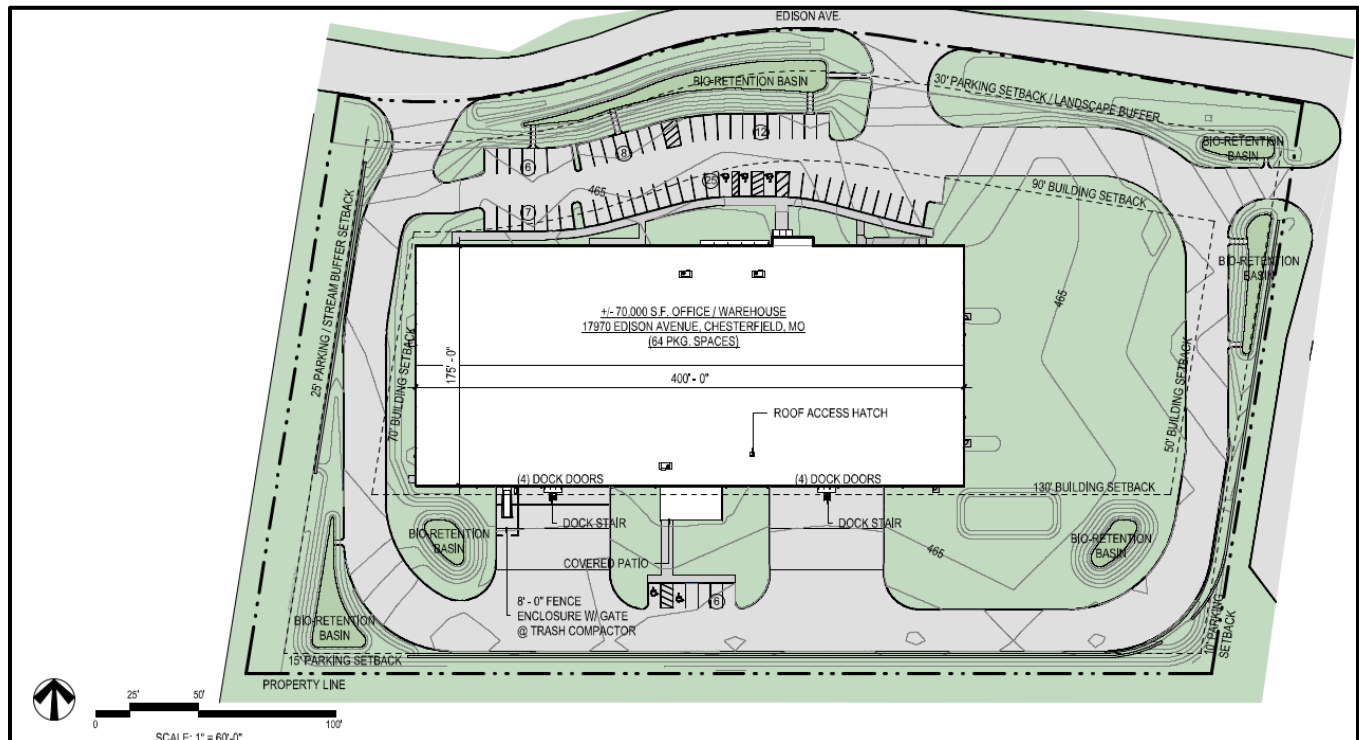


Figure 2: Colored Site Plan

Site Relationships

The proposed building is 70,000 square feet on 7.1 acres of land. The height of the proposed building is 36'. The site is surrounded by Insituform building on the west, Chesterfield Executive Park on the north and Spirit Trade Center on the east. As per the applicant, the proposed building on site will be a single-story office/warehouse building. The trash enclosure will be located on the south of the subject site i.e. back of the building.

Circulation System and Access

The site is accessed through Edison Avenue located north of the subject site. There is an existing shared cross access located on the east of the subject site. Internal driveways are 22'-30' wide with two-way access.

Scale, Topography, Retaining Wall and Screening

The site sits vacant and is surrounded by buildings on the north, east and west. Surrounding buildings are primarily single-story buildings. The site is relatively flat. The retaining wall is proposed on the south and east side. The roof top mechanical equipment will be screened by a parapet.

Materials and Color

The four sides of the building façade consist of concrete tilt-up panels painted with charcoal black (Sherwin-Williams cyberspace) color on the top and sides. The front of the building has a combination of two painted concrete panels, thin Brick and metal canopy. The windows on the north are 1" insulated glass in black anodized storefront system. There are eight overhead doors located at the back of the building. Overhead doors will be of galvanized insulated steel.

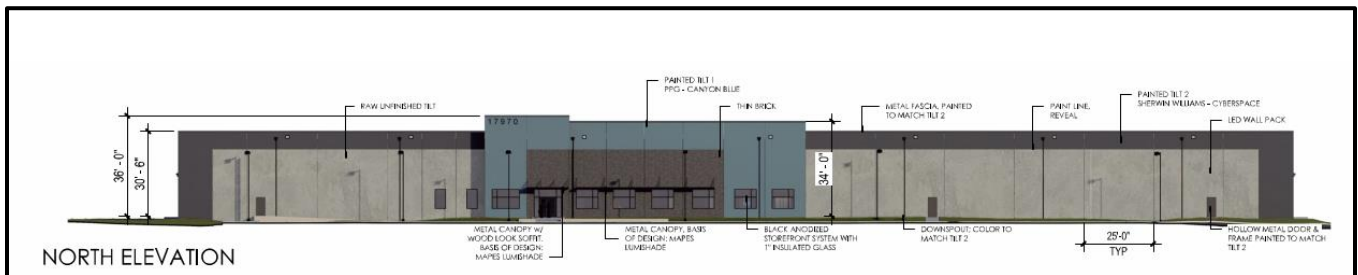


Figure 3: North side Elevation

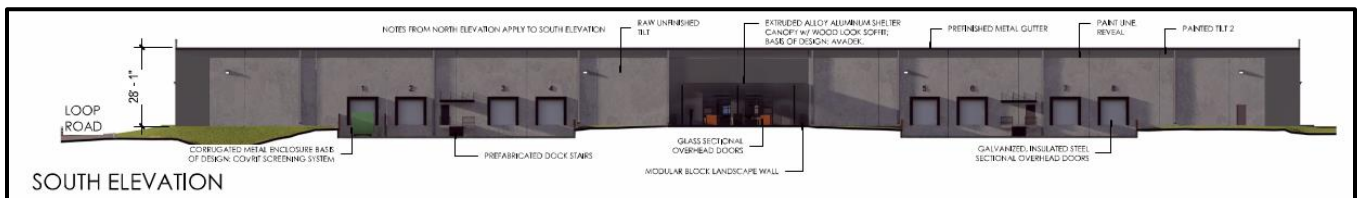


Figure 4: South side Elevation

Lighting

There are five (5) different types of light fixtures proposed for this development. There are six (6) wall pack lights, one (1) canopy light and twelve (12) pole lights.



Figure 7: View of Main Entry

DEPARTMENTAL INPUT

Be advised, this project is under review by City Staff and will not proceed to the Planning Commission until all outstanding items have been addressed. All recommendations made by the ARB will be included in Staff's report to the Planning Commission.

MOTION

The following options are provided to the Architectural Review Board for consideration relative to this application:

- 1) "I move to forward the Site Development Plan, Landscape Plan, Lighting Plan, and Architectural Elevations for Damian Kroenung Estate (SDP), as presented, with a recommendation for approval (or denial)."
- 2) "I move to forward the Site Development Plan, Landscape Plan, Lighting Plan, and Architectural Elevations for Damian Kroenung Estate (SDP), with a recommendation for approval with the following conditions..."

Attachments

1. Architectural Review Packet Submittal

September 6th, 2023

Shilpi Baharti
City Planner
City of Chesterfield, Missouri

Re: Edison Partners LLC – Classroom Library Company Warehouse
Remiger Design Project # 2245.01
Architects Statement of Design

To Whom it May Concern,

As required by Chesterfield's Unified Development Code the following is our Architect's Statement of Design, responding to the Architectural Review Design Standards as they apply to our project.

General Requirements for Site Design:

1. Site Relationships: The proposed Classroom Library Company office/warehouse development is located on the south side of Edison Ave, 0.2 miles east of Goddard Ave. The adjacent property to the east is the House of Denmark building. The property to the south is vacant and the property to the west includes a storm water drainage ditch and railroad tracks.
2. Circulation System and Access: The development includes two curb cuts on Edison Avenue, one on the west side of the site and one in the middle of the site across from Cepi Drive. Cross access is proposed with the House of Denmark parking lot. Delivery trucks will enter the site via one of the two curb cuts on Edison Ave. and travel to the rear of the building to the truck docks. A separate employee parking lot is provided in the front of the building. Sidewalks along the front of the building provide access to the entry doors. A covered patio and parking are proposed in the rear of the building.
3. Topography: The existing topography is flat across the site, draining to the west and south. The elevation of the site will be raised to ensure proper drainage.
4. Retaining Walls: Concrete retaining walls are proposed on the west, south, and east sides of the site. They are only to be 12-18" above grade.

General Requirements for Building Design:

During initial board review, it was decided that changes needed to be made to further address the City of Chesterfield's Unified Development Code. During the open portion of the board meeting, it was discussed that no other buildings in this area utilized raw, unfinished concrete. To address this, we have shuffled the color palette of the building and have added a new color – African Gray that will make up a majority of the surface of the concrete that previously was raw. Additionally, the board felt like the building was not adequately brought down to human scale, to address this we have brought the darker gray portion at the top of the tilt up wall, and the thin brick portion at the main entry down to a more human dimension, as well as added more horizontal reveals that we feel adds a panelized look to the building and helps ground the tall concrete walls. Another comment was that the building, with its simplistic layout lacked articulation. We have increased the "bump out" area, as well as added returns to each side at the roofline



and at the main entry we have added more brick. Additionally, we have added new canopies over each of the windowed areas and egress doors on the northern elevation. We have accented the downspout locations with a vertical stripe of a darker gray color and used that color to compliment the mid gray color and act as a horizontal shadow line to help breakup some of the monolithic nature of the building. Finally, we have addressed the issue of the possibility of seeing the roof top units from the east and west side by adding screening to each unit, this screening will be painted to match the tilt up concrete. We hope that what we have done shows the board that we have heard their comments and are willing to modify our design to better fit into the surrounding community in Chesterfield.

1. Scale: The proposed 70,000 sq ft warehouse and office building is located along Edison Ave. It is scaled appropriately for a building of its use group and in the context of the broader neighborhood. Adjacent properties are similar construction and function.
2. Design: The building design and finishes are coordinated on all sides of the building. The project stands on its own merit but fits in well in the context of the surrounding properties. The main entry is defined by a brick and painted tilt up bump out and helps drive visitors to where they need to go.
3. Building Materials: The warehouse has a simple color pallet. Most of the building will be painted concrete. The paint consists of three shades of gray, and a contrasting dark blue color at the main entry that is complemented by a dark/black thin brick with a gray mortar that has been inset into the tilt up panels. Metal roof edge, downspouts, scuppers and gutters will be painted the same color as the "trim" of the tilt up panels that run around all 4 sides of the building. They will also be complemented by entry canopy in the front that covers the main door, as well as canopies over the main entry windows. Secondary canopies have been added to the remaining egress doors along the front façade to aid in bringing the large surface of the concrete walls down to a human scale. The elevations are rounded out by a large patio canopy in the rear of the building. The windows will be a black aluminum storefront system with low-e glass, all doors around the perimeter of the building are to be hollow metal, painted to stand out and further breakup the horizontalness of the warehouse walls. The garbage compactor is in the rear of the building in one of the bays and is contained by an 8-foot tall, painted tilt-up concrete enclosure, painted to match the field concrete color.
4. Landscape Design and screening: Landscaping has been designed to meet the City of Chesterfields requirements and helps to screen the parking areas as well as bring down the buildings scale and soften the hard edges of the tilt-up.
5. Signage: Not applicable.
6. Lighting: Lighting will be kept simple utilizing wall packs around the building, and pole lights in the parking areas. Cut sheets are included for your review.

We hope the information provided aids you in your decision making. Please do not hesitate to contact us if you have any questions or comments.

Respectfully,

Denny Crain AIA, LEED AP
Managing Principal/Shareholder

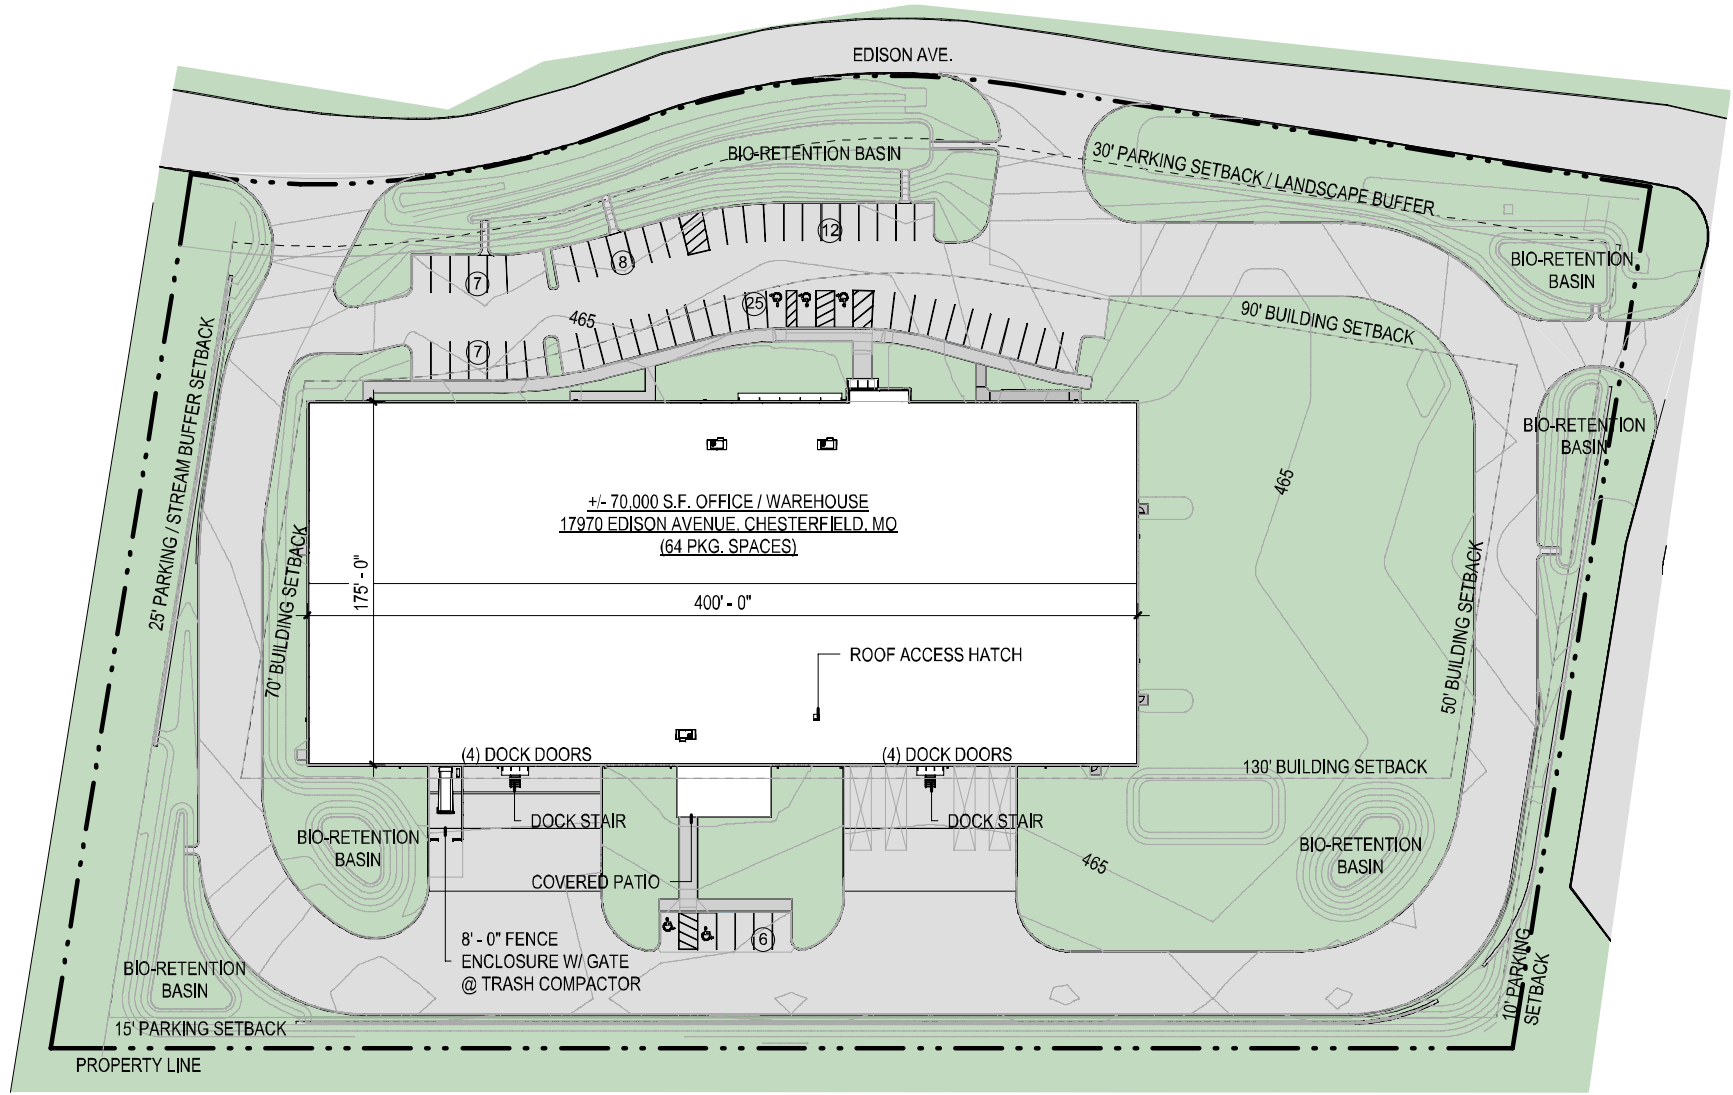

17970 Edison Ave. Chesterfield, MO 63005



REMIGER DESIGN
ARCHITECTS & ENGINEERS

9/6/2023



SITE LOCATION MAP - LEGEND

1. EDISON PARTNERS LLC.
2. VACANT - AGRICULTURAL
3. HOUSE OF DENMARK - COMMERCIAL
4. SPIRIT OF ST. LOUIS AIRPORT
5. INSTITUFORM TECHNOLOGIES/AGEION - COMMERCIAL
6. SPIRIT OF ST. LOUIS AIRPORT MAINTENANCE - INDUSTRIAL
7. ST. LOUIS AIR PARK - RECREATIONAL
8. J & J SIDING AND WINDOW SALES -COMMERCIAL
9. MOHELA - COMMERCIAL

AERIAL VIEW FROM SOUTHWEST - ADJACENT USES



17988 EDISON AVE. - AGEION HEADQUARTERS



17999 EDISON AVE. - INSITUFORM TECHNOLOGIES



17906 EDISON AVE. - HOUSE OF DENMARK DISTRIBUTION CENTER




600 CEPL DR. - J&J SIDING AND WINDOW SALES




17970 Edison Ave. Chesterfield, MO 63005




8/28/23

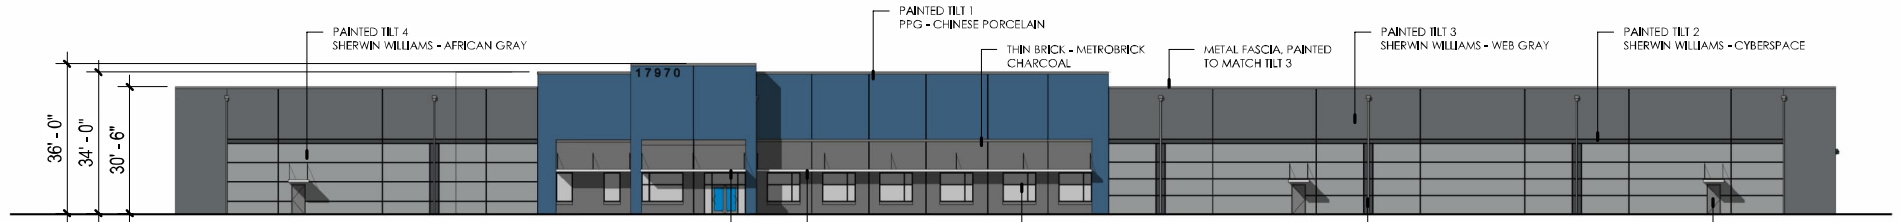


NORTH ELEVATION

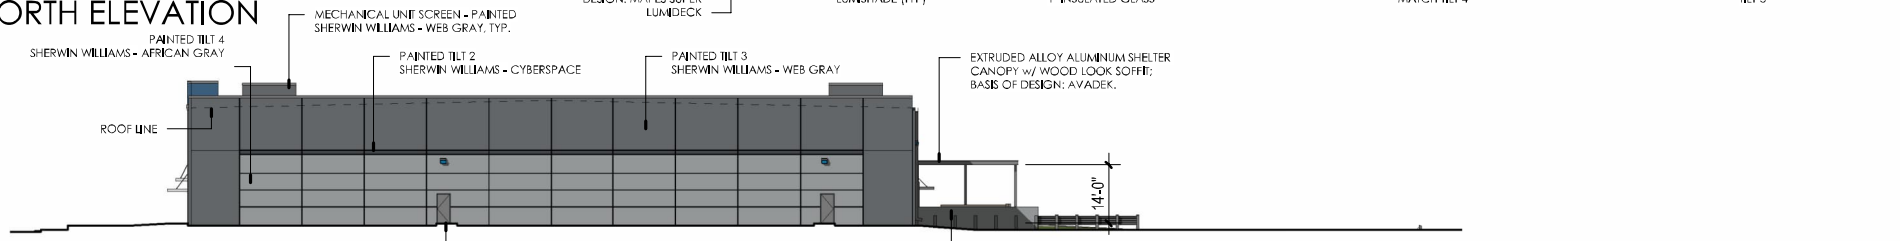

WEST ELEVATION

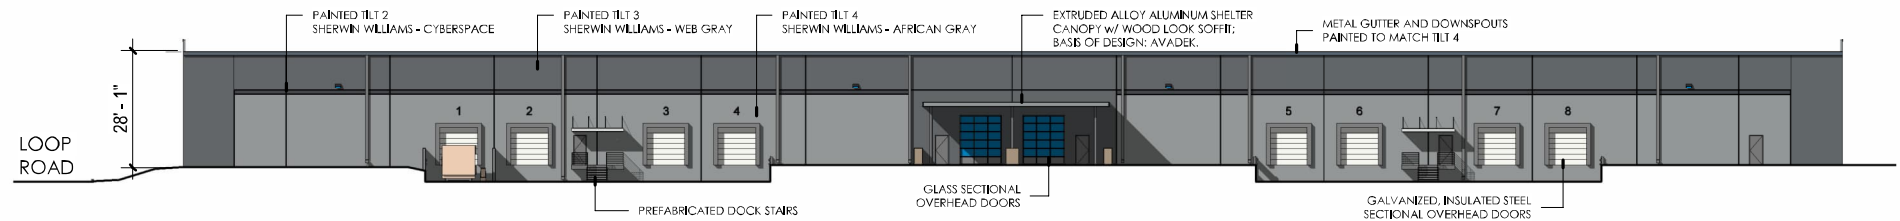

SOUTH ELEVATION

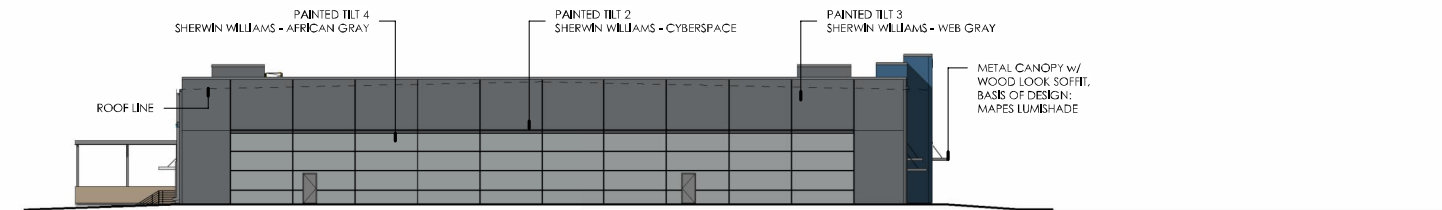

EAST ELEVATION



17970 Edison Ave. Chesterfield, MO 63005



REMIGER DESIGN
ARCHITECTURE INTERIORS

8/28/23



VIEW FROM NORTHEAST



17970 Edison Ave. Chesterfield, MO 63005



REMIGER DESIGN
ARCHITECTURE INTERIORS

8/28/23



VIEW OF MAIN ENTRY



17970 Edison Ave. Chesterfield, MO 63005



8/28/23



VIEW OF REAR PATIO




17970 Edison Ave. Chesterfield, MO 63005




REMIGER DESIGN
ARCHITECTURE • INTERIORS • LANDSCAPE

8/28/23

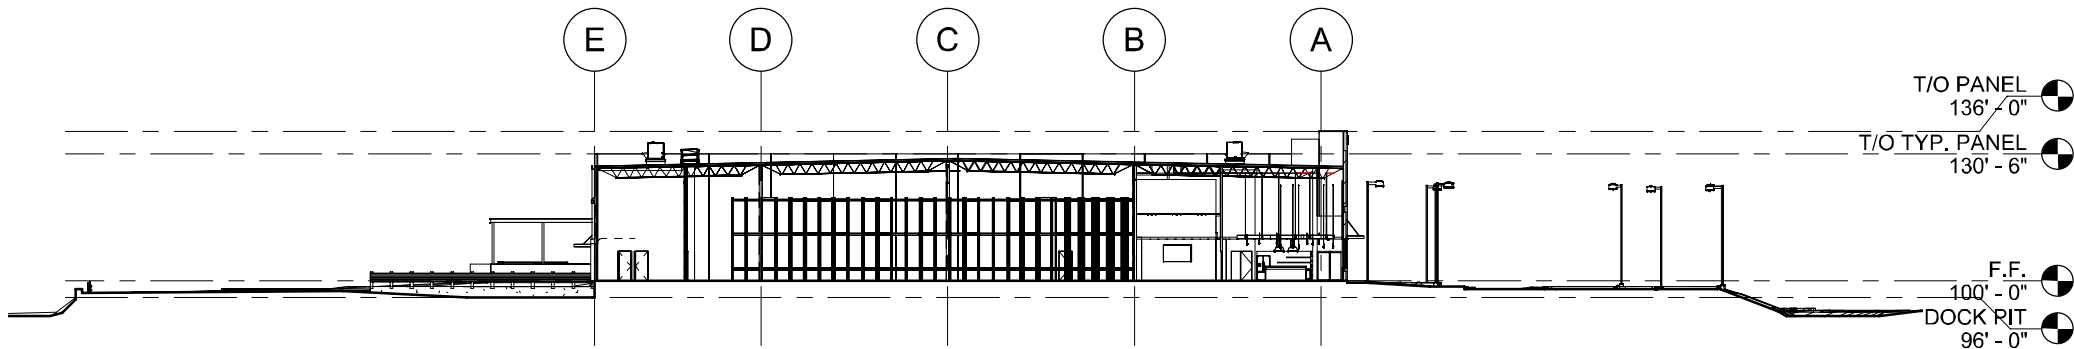


1 SITE/BUILDING - SECTION A
PRE-2 1" = 30'-0"






17970 Edison Ave. Chesterfield, MO 63005



8/28/23

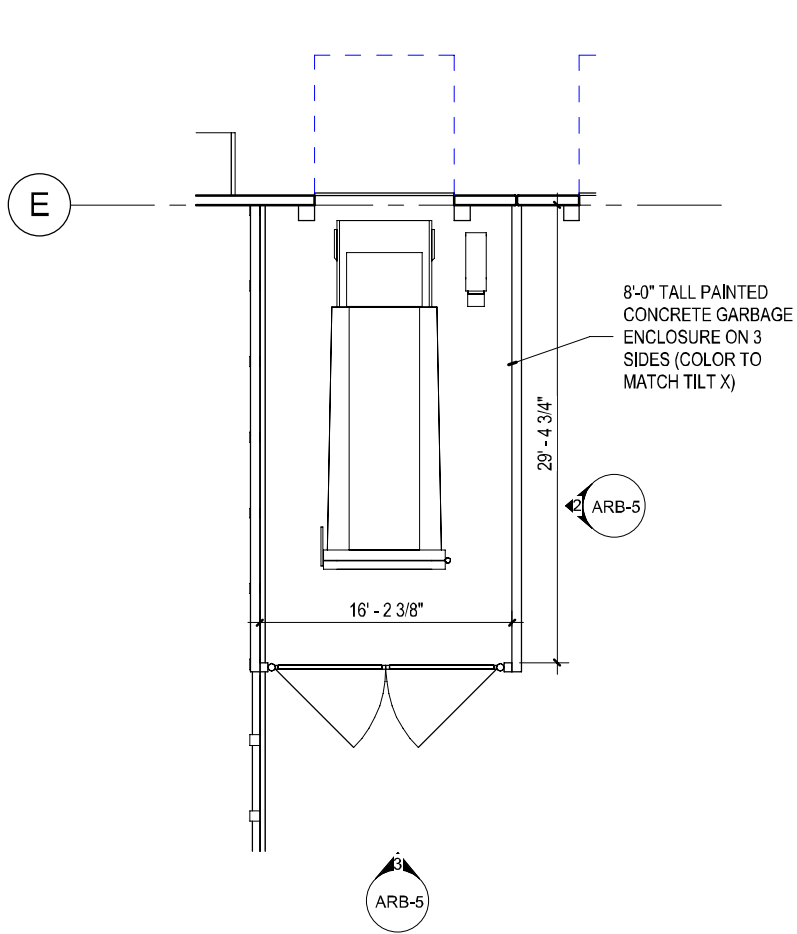

ENLARGED TRASH ENCLOSURE PLAN

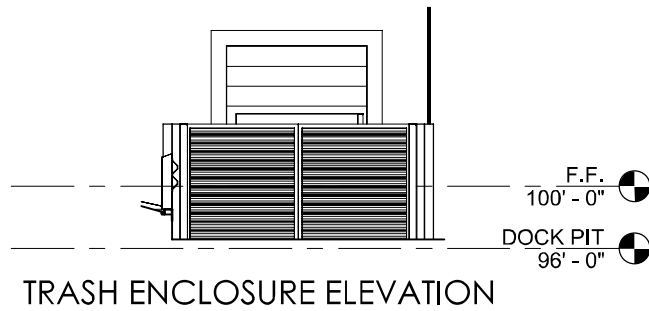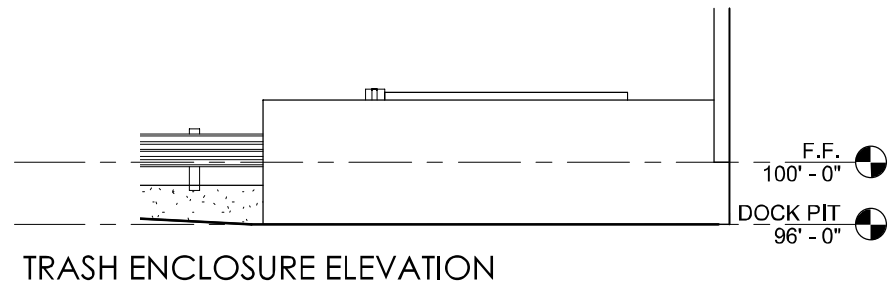

17970 Edison Ave. Chesterfield, MO 63005



8/28/23

TILT COLOR 3

TILT COLOR 2

TILT COLOR 1

BRICK VENEER @ ENTRY

TILT COLOR 4

MAIN ENTRY SOFFIT



17970 Edison Ave. Chesterfield, MO 63005



8/28/23


REVISIONS	BY

landscape
TECHNOLOGIES


11000 N. W. 22nd St.
Miami Lakes, FL 33016
Tel: 305-447-2222
Fax: 305-447-2222

PLANTING PLAN FOR THE PROPOSED
Edison Partners, LLC / Classroom Library Co.
 17970 EDISON AVE. CHESTERFIELD, MISSOURI 63005


DRAWN: M. HARRIS
 CHECKED: R. WILSON
 DATE: JAN 24, 2023
 SCALE: N.A.
 JOB NO.: 2023-144
 SHEET
L-2
 OF THREE SHEETS

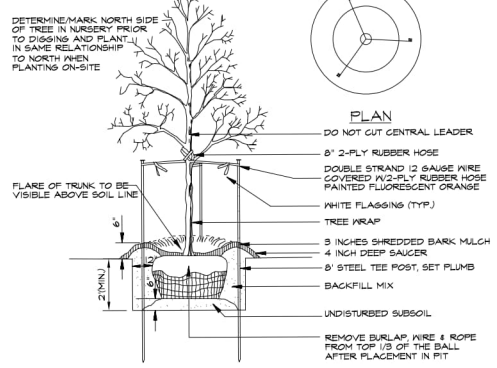


DECIDUOUS TREE PLANTING
N.T.S.

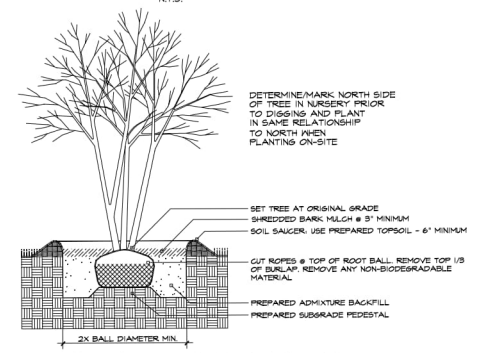


MULTI-STEM TREE PLANTING
N.T.S.

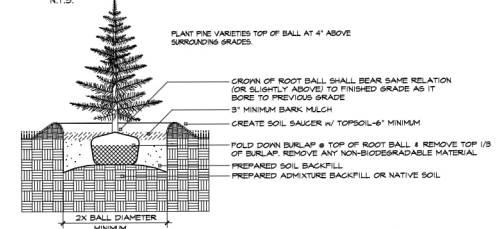


EVERGREEN TREE PLANTING
N.T.S.

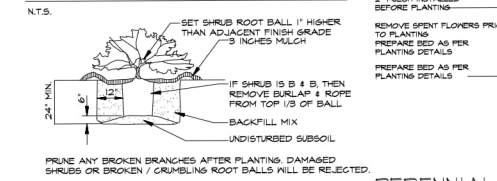


SHRUB PLANTING
N.T.S.

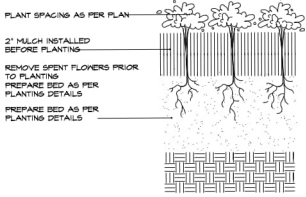

PERENNIAL / ANNUAL PLANTING
N.T.S.

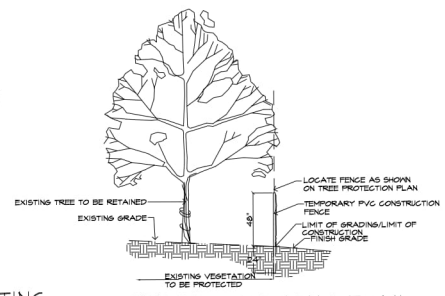

TREE PROTECTION DETAIL
N.T.S.

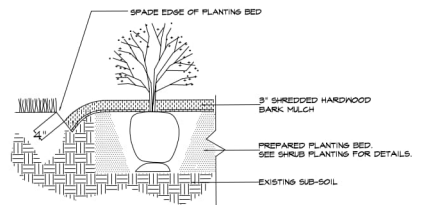

SPADE-CUT EDGE DETAIL
N.T.S.

PLANT SCHEDULE			
TREES	QTY	COMMON / BOTANICAL NAME	SIZE
ABM	3	AUTUMN BLAZE MAPLE / ACER X FREEMANII 'JEFFERSRED'	2.5' CAL.
BC	4	BALD CYPRESS / TAXODIUM DISTICHUM	2.5' CAL.
HACK	3	COMMON HACKBERRY / CELTIS OCCIDENTALIS	2.5' CAL.
EAEH	3	EMERALD AVENUE EUROPEAN HORNBEAM / CARPINUS BETULUS 'EMERALD AVENUE' TM	2.5' CAL.
GMSM	1	GREEN MOUNTAIN SUGAR MAPLE / ACER SACCHARUM 'GREEN MOUNTAIN'	2.5' CAL.
HRB	3	HERITAGE RIVER BIRCH / BETULA NIGRA 'HERITAGE IMPROVED'	10-12/2.5' CAL.
RO	6	RED OAK / QUERCUS RUBRA	2.5' CAL.
SAW	3	SANTOOTH OAK / QUERCUS ACUTISSIMA	2.5' CAL.
SL	3	SILVER LINDEN / TILIA TOMENTOSA	2.5' CAL.
SWO	3	SWAMP WHITE OAK / QUERCUS BICOLOR	2.5' CAL.
OGRM	3	'OCTOBER GLORY' MAPLE / ACER RUBRUM 'OCTOBER GLORY'	2.5' CAL.
EVERGREEN TREES	QTY	COMMON / BOTANICAL NAME	SIZE
CBS	11	COLORADO BLUE SPRUCE / PICEA PENSILVANA 'GLAUCA'	6-7'
NS	3	NORWAY SPRUCE / PICEA ABIES	6-7'
FLOWERING TREES	QTY	COMMON / BOTANICAL NAME	SIZE
RB	7	REDBUD / CERCOIS CANADENSIS	2' CAL.
RHS	4	ROBIN HILL SERVICEBERRY / AMELANCHIER X GRANDIFLORA 'ROBIN HILL'	2' CAL.
SMS	13	SAUCEUR MAGNOLIA / MAGNOLIA X SOULANGIANA	2' CAL.
TGH	7	THORNLESS COCKSPUR HAWTHORN / CRATAEGUS CRUGGALLI VAR. INERMIS	2' CAL.
SHRUBS	QTY	COMMON / BOTANICAL NAME	SIZE
ESHYP	6	ENDLESS SUMMER HYDRANGEA / HYDRANGEA MACROPHYLLA 'ENDLESS SUMMER' TM	5 GAL.
EY	28	EVERLOW YEW / TAXUS X MEDIA 'EVERLOW'	5 GAL.
GSEM	14	GREEN GEM BOXWOOD / BUXUS X 'GREEN GEM'	5 GAL.
LDN	4	LITTLE DEVIL NINEBARK / PHYSOCARPUS OPULIFOLIUS 'LITTLE DEVIL' TM	5 GAL.
PJ	6	PROCCUMBENS JUNIPER / JUNIPERUS PROCCUMBENS 'NANA'	5 GAL.
RCA	14	ROSE CREEK ABELIA / ABELIA X GRANDIFLORA 'ROSE CREEK'	5 GAL.
SIS	5	SCENTLANDIA SWEETSPICE / ITEA VIRGINICA 'SMNVDPC' TM	5 GAL.
SS	6	WINECRAFT GOLD® SMOKE TREE / COTINUS COGGYGRIA 'MINGOJAUS'	5 GAL.
FORBS	QTY	COMMON / BOTANICAL NAME	SIZE
GAX	362	GOLDEN ALEXANDER / ZIZIA AUREA	2 QT. @ 18" OC
ROSEM	145	ROSE MALLOW / HIBISCUS LAEVIS	1 GAL @ 30" OC
SMA	330	SWAMP MILKWEED / ASCLEPIAS INCARNATA	2 QT. @ 24" OC
GRASSES	QTY	COMMON / BOTANICAL NAME	SIZE
CALA	23	FOERSTER'S REED GRASS / CALAMAGROSTIS ACUTIFOLIA 'KARL FOERSTER'	5 GAL.
ANNUALS/PERENNIALS	QTY	COMMON / BOTANICAL NAME	SIZE
BES	13	GOLDSTURM BLACK-EYED SUSAN / RUDBECKIA FULGIDA 'GOLDSTURM'	1 GAL.
SCD	23	STRAWBERRY CANDY DAYLILY / HEMEROCALLIS X 'STRAWBERRY CANDY' TM	1 GAL.
NATIVE GRASSES	QTY	COMMON / BOTANICAL NAME	SIZE
481		BROWN FOX SEDGE / CAREX VULPINOIDEA	PLUG AT 18" OC
730		GREAT GREEN BULRUSH / SCIRPUS ATROVIRENS	PLUG AT 18" OC
324		MORNING STAR SEDGE / CAREX GRAYI	PLUG AT 18" OC
277		PALM SEDGE / CAREX MUSKINGUMENSIS	PLUG AT 18" OC


REVISIONS	BY

Landscape
TECHNOLOGIES

ANNUAL PLANNING
DESIGN, CONSTRUCTION & MAINTENANCE
1000 N. W. 10th St., Suite 100
Fort Lauderdale, FL 33304
TEL: 954.577.1111 FAX: 954.577.1112
WWW.LANDSCAPETECHNOLOGIES.COM

PLANTING PLAN FOR THE PROPOSED
Edison Partners, LLC / Classroom Library Co.
 17970 EDISON AVE. CHESTERFIELD, MISSOURI 63005

DRAWN: M. HANCOCK
 CHECKED: R. WILSON
 DATE: JUN 24, 2023
 SCALE: 1"=20'-0"
 JOB NO.: 2023-144
 SHEET
L-3
 OF THREE SHEETS

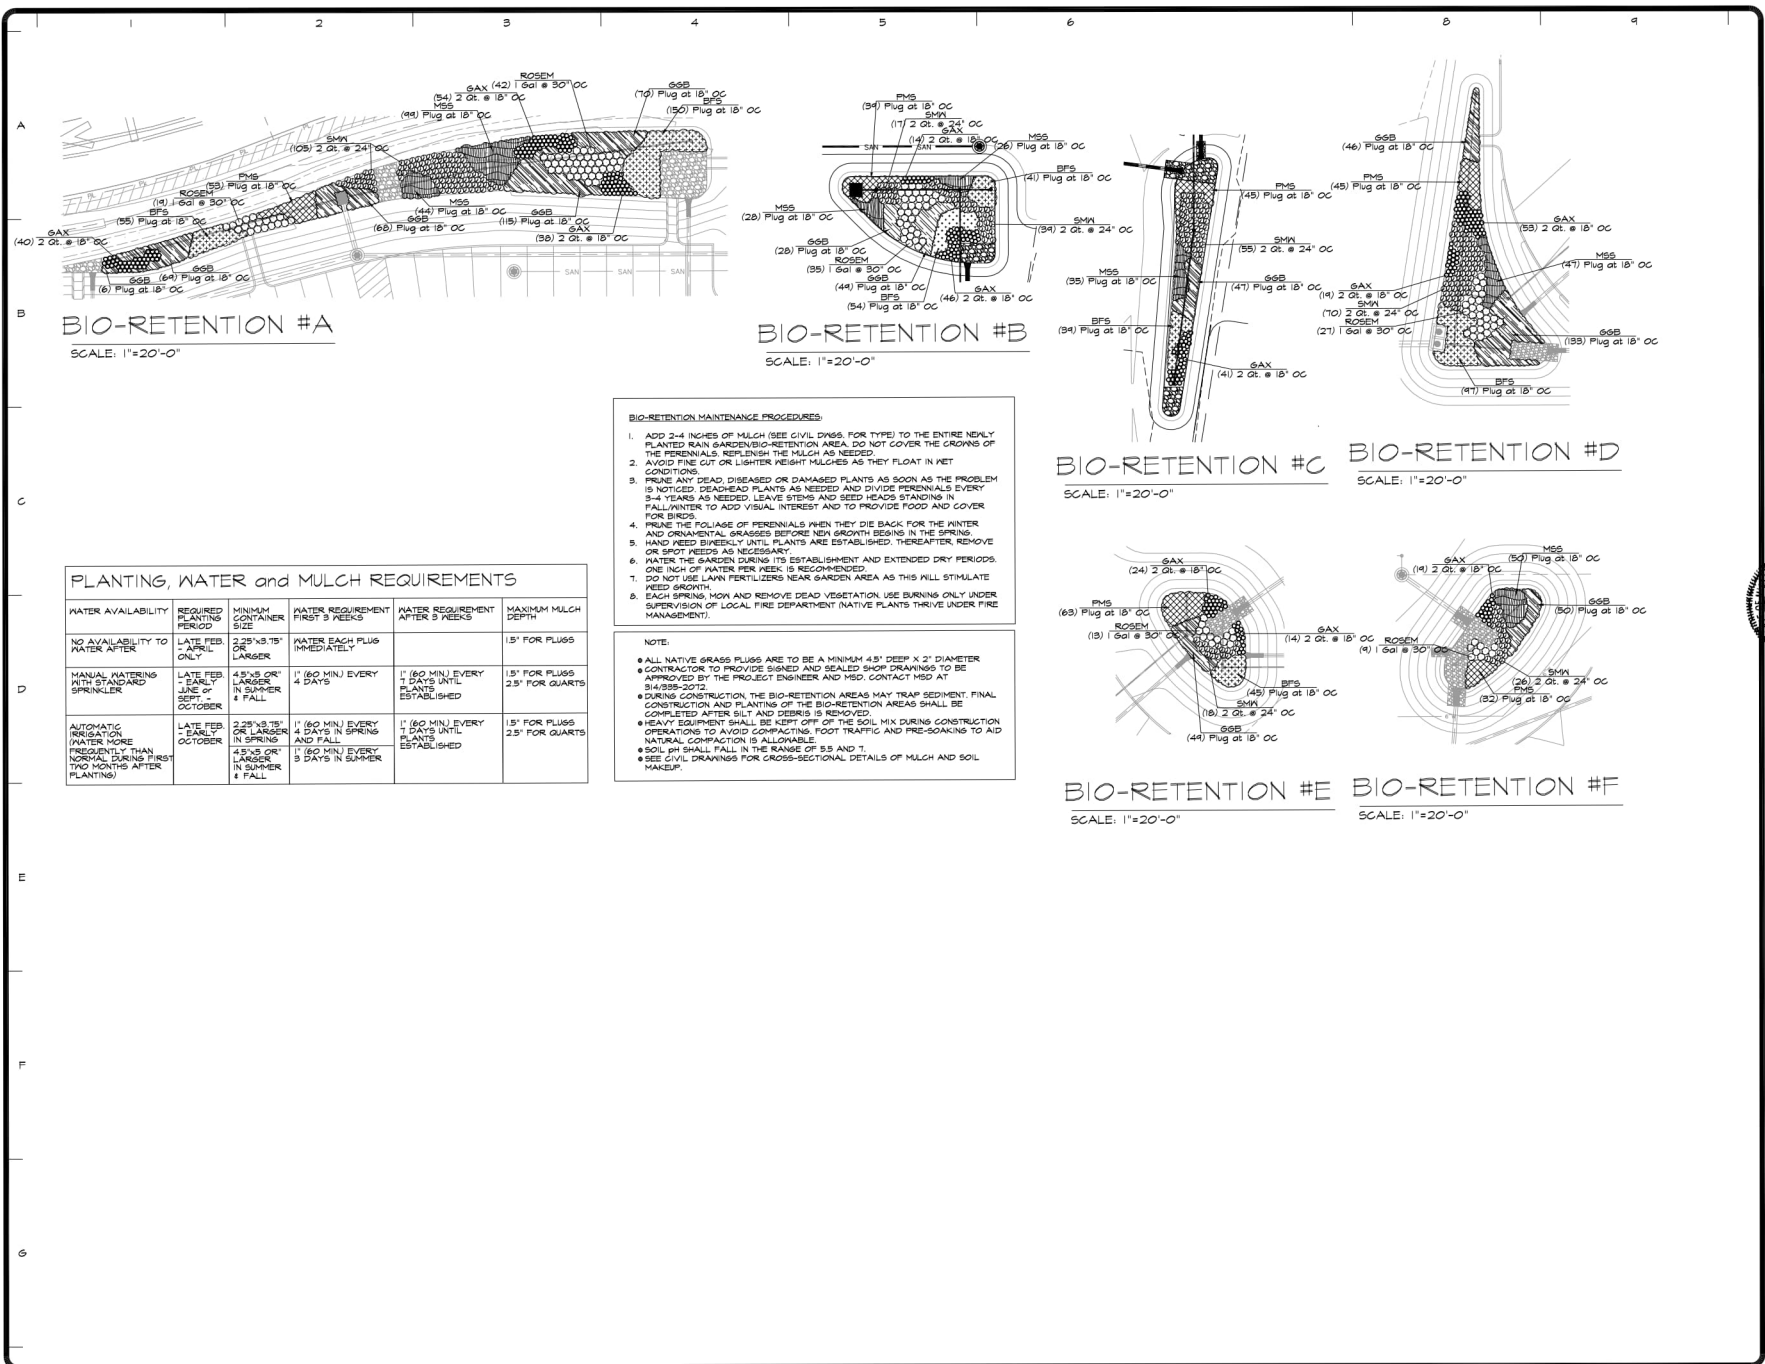

- BIO-RETENTION MAINTENANCE PROCEDURES:**
- ADD 2-4 INCHES OF MULCH (SEE CIVIL DWGS. FOR TYPE) TO THE ENTIRE NEWLY PLANTED RAIN GARDEN/BIO-RETENTION AREA. DO NOT COVER THE GRASSES OF THE PERENNIALS. REPLENISH THE MULCH AS NEEDED.
 - AVOID FINE CUT OR LIGHTER WEIGHT MULCHES AS THEY FLOAT IN WET CONDITIONS.
 - PRUNE ANY DEAD, DISEASED OR DAMAGED PLANTS AS SOON AS THE PROBLEM IS NOTICED. DEADHEAD PLANTS AS NEEDED AND DIVIDE PERENNIALS EVERY 3-4 YEARS AS NEEDED. LEAVE STEMS AND SEED HEADS STANDING IN FALL/WINTER TO ADD VISUAL INTEREST AND TO PROVIDE FOOD AND COVER FOR BIRDS.
 - PRUNE THE FOLIAGE OF PERENNIALS WHEN THEY DIE BACK FOR THE WINTER AND ORNAMENTAL GRASSES BEFORE NEW GROWTH BEGINS IN THE SPRING.
 - HAND WEED BIVERSKLY UNTIL PLANTS ARE ESTABLISHED. THEREAFTER, REMOVE OR SPOT TREAT AS NECESSARY.
 - WATER THE GARDEN DURING ITS ESTABLISHMENT AND EXTENDED DRY PERIODS. ONE INCH OF WATER PER WEEK IS RECOMMENDED.
 - DO NOT USE LAWN FERTILIZERS NEAR GARDEN AREA AS THIS WILL STIMULATE WEED GROWTH.
 - EACH SPRING, MOW AND REMOVE DEAD VEGETATION. USE BURNING ONLY UNDER SUPERVISION OF LOCAL FIRE DEPARTMENT. NATIVE PLANTS THRIVE UNDER FIRE MANAGEMENT.
- NOTE:**
- ALL NATIVE GRASS PLUGS ARE TO BE A MINIMUM 4.5" DEEP X 2" DIAMETER
 - CONTRACTORS TO PROVIDE SIGNED AND SEALED SHOP DRAWINGS TO BE APPROVED BY THE PROJECT ENGINEER AND MSD. CONTACT MSD AT 914-925-2072.
 - DURING CONSTRUCTION, THE BIO-RETENTION AREAS MAY TRAP SEDIMENT. FINAL CONSTRUCTION AND PLANTING OF THE BIO-RETENTION AREAS SHALL BE COMPLETELY AFTER SILT AND DEBRIS IS REMOVED.
 - HEAVY EQUIPMENT SHALL BE KEPT OFF OF THE SOIL MIX DURING CONSTRUCTION OPERATIONS TO AVOID COMPACTING, FOOT TRAFFIC AND FRO-SCALING TO AID NATURAL COMPACTION IS ALLOWABLE.
 - SOIL pH SHALL FALL IN THE RANGE OF 5.5 AND 7.
 - SEE CIVIL DRAWINGS FOR CROSS-SECTIONAL DETAILS OF MULCH AND SOIL MAKEUP.

PLANTING, WATER and MULCH REQUIREMENTS					
WATER AVAILABILITY	REQUIRED PLANTING PERIOD	MINIMUM CONTAINER SIZE	WATER REQUIREMENT FIRST 3 WEEKS	WATER REQUIREMENT AFTER 3 WEEKS	MAXIMUM MULCH DEPTH
NO AVAILABILITY TO WATER AFTER	LATE FEB. - APRIL ONLY	2.25" X 3.75" OR LARGER	WATER EACH PLUG IMMEDIATELY		1.5" FOR PLUGS
MANUAL WATERING WITH STANDARD SPRINKLER	LATE FEB. - EARLY JUNE OF SEPT. - OCTOBER	4.5" X 9" OR LARGER IN SUMMER & FALL	1" (60 MIN) EVERY 4 DAYS	1" (60 MIN) EVERY 2 DAYS UNTIL PLANTS ESTABLISHED	1.5" FOR PLUGS 2.5" FOR QUARTS
AUTOMATIC IRRIGATION (WATER MORE FREQUENTLY THAN NORMAL DURING FIRST TWO MONTHS AFTER PLANTING)	LATE FEB. - EARLY OCTOBER	2.25" X 3.75" OR LARGER IN SPRING 4.5" X 9" OR LARGER IN SUMMER & FALL	1" (60 MIN) EVERY 4 DAYS IN SPRING AND FALL 1" (60 MIN) EVERY 3 DAYS IN SUMMER	1" (60 MIN) EVERY 2 DAYS UNTIL PLANTS ESTABLISHED	1.5" FOR PLUGS 2.5" FOR QUARTS

Project	Edison Partners LLC	Catalog #	PRV-XL-PA3A-740-U-5WQ-SA-BZ	Type	S1,S3,S4, WP
Prepared by		Notes	pole lights mounted on 17.5' pole	Date	7/12/23



Lumark

Prevail LED

Area / Site Luminaire

Product Features



Product Certifications



Interactive Menu

- Ordering Information [page 2](#)
- Mounting Details [page 3, 4](#)
- Optical Configurations [page 5](#)
- Product Specifications [page 5](#)
- Energy and Performance Data [page 6, 7](#)
- Control Options [page 8](#)


Quick Facts

- Lumen packages range from 4,800 - 84,000 lumens (35W - 588W)
- Replaces 70W up to 1,000W HID equivalents
- Efficacies up to 160 lumens per watt
- Energy and maintenance savings up to 85% versus HID solutions
- Standard universal quick mount arm with universal drill pattern

Connected Systems

- WaveLinX

Dimensional Details

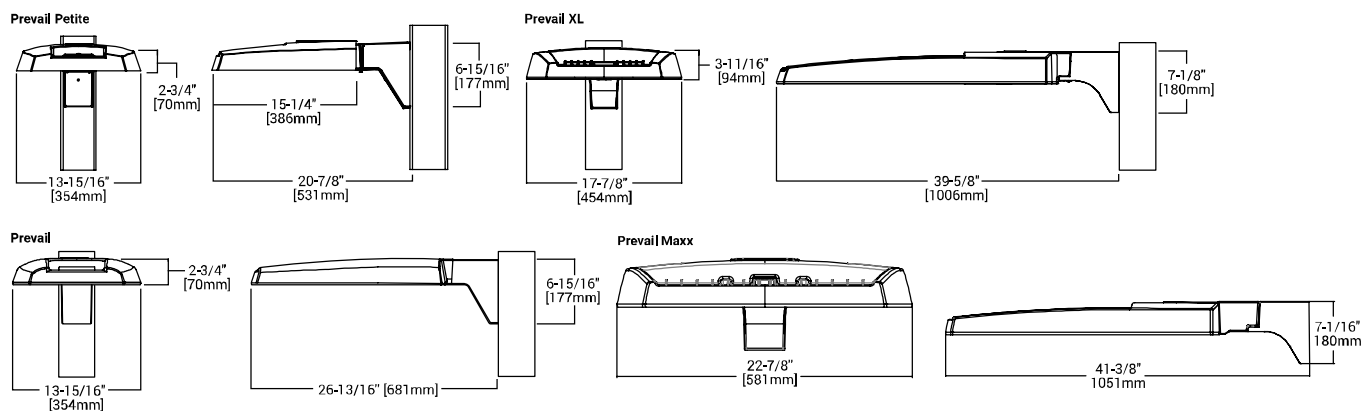


NOTES:
 1. Visit <https://www.designlights.org/search/> to confirm qualification. Not all product variations are DLC qualified.
 2. IDA Certified for 3000K CCT and warmer only.

Ordering Information

SAMPLE NUMBER: PRV-XL-C75-D-UNV-T4-SA-BZ

Product Family ^{1,2}	Light Engine ⁴	Color Temperature	Driver	Voltage	Distribution	Mounting	Color
PRV-P=Prevail Petite BAA-PRV-P=Prevail Petite BAA Compliant ³ TAA-PRV-P=Prevail Petite TAA Compliant ³	C10=(1 LED) 4,900 Nominal Lumens C15=(1 LED) 6,900 Nominal Lumens C20=(1 LED) 9,800 Nominal Lumens C25=(1 LED) 11,800 Nominal Lumens	740=70CRI, 4000K 727=70CRI, 2700K 730=70CRI, 3000K 750=70CRI, 5000K 8540=85CRI, 4000K	D=Dimming (0-10V)	UNV=Universal (120-277V) H=High Voltage, 347-480V 8=480V ⁵ 9=347V DV=DuraVolt (277-480V) ^{5,6}	T2=Type II T3=Type III T4=Type IV T5=Type V	SA=QM Standard Versatile Arm MA=QM Mast Arm FMA= Fixed Mast Arm ²⁸ WM=QM Wall Mount Arm ADJA-WM=Adjustable Arm-Wall Mount ³⁰ ADJA=Adjustable Arm-Pole Mount ³⁰ ADJS=Adjustable Arm-Slipfitter, 3" vertical tenon ³⁰ SP2=Adjustable Arm-Slipfitter, 2 3/8" vertical tenon ^{28,30}	BZ=Bronze AP=Grey BK=Black DP=Dark Platinum GM=Graphite Metallic WH=White
PRV=Prevail BAA-PRV=Prevail BAA Compliant ³ TAA-PRV=Prevail TAA Compliant ³	C15=(1 LED) 7,100 Nominal Lumens C25=(2 LEDs) 13,100 Nominal Lumens C40=(2 LEDs) 17,100 Nominal Lumens C60=(2 LEDs) 20,000 Nominal Lumens						
PRV-XL=Prevail XL BAA-PRV-XL=Prevail XL BAA Compliant ³ TAA-PRV-XL=Prevail XL TAA Compliant ³	C75=(4 LED) 26,100 Nominal Lumens C100=(4 LED) 31,000 Nominal Lumens C125=(4 LED) 36,000 Nominal Lumens C150=(6 LED) 41,100 Nominal Lumens C175=(6 LED) 48,600 Nominal Lumens						
PRV-M=Prevail Maxx BAA-PRV-M=Prevail Maxx BAA Compliant ³ TAA-PRV-M=Prevail MaxxTAA Compliant ³	C200=(9 LED) 48,000 Nominal Lumens C225=(9 LED) 56,000 Nominal Lumens C250=(9 LED) 65,000 Nominal Lumens C275=(9 LED) 73,000 Nominal Lumens						
Options (Add as Suffix)			Accessories (Order Separately) ^{20,21}				
<p>7030=70 CRI / 3000K CCT ⁷ 7050=70 CRI / 5000K CCT ⁷ CC=Coastal Construction finish ³¹ HSS=House Side Shield ⁸ L90=Optics Rotated 90° Left R90=Optics Rotated 90° Right 10K=10KV/10kA UL 1449 Fused Surge Protective Device 20MSP=20KV MOV Surge Protective Device 20K=20KV UL 1449 Fused Surge Protective Device HA=50°C High Ambient Temperature ⁹ PR=NEMA 3-PIN Twistlock Photocontrol Receptacle ¹¹ PR7=NEMA 7-PIN Twistlock Photocontrol Receptacle ¹¹ MS/DIM-L08=Dimming Motion and Daylight Sensor, IR Remote Programmable, < 8' Mounting Height ^{12,13,22,28} MS/DIM-L20=Dimming Motion and Daylight Sensor, IR Remote Programmable, 8' - 20' Mounting Height ^{12,22,13} MS/DIM-L40=Dimming Motion and Daylight Sensor, IR Remote Programmable, 21' - 40' Mounting Height ^{12,13}</p> <p>SPB1=Dimming Motion and Daylight Sensor, Bluetooth Programmable, < 8' Mounting Height ^{12,14,22} SPB2=Dimming Motion and Daylight Sensor, Bluetooth Programmable, 8' - 20' Mounting Height ^{12,14,22} SPB4=Dimming Motion and Daylight Sensor, Bluetooth Programmable, 21' - 40' Mounting Height ^{12,14,28,29} ZW=WaveLinx-enabled 4-PIN Twistlock Receptacle ¹² ZD=DAL-enabled 4-PIN Twistlock Receptacle ¹² ZW-SWPD4XX=WaveLinx Pro, Dimming Motion and Daylight, WAC Programmable, 7' - 15' Mounting ^{12,15,16,17,28} ZW-SWPD5XX=WaveLinx Pro, Dimming Motion and Daylight, WAC Programmable, 15' - 40' Mounting ^{12,15,16,17,28,29} ZD-SWPD4XX= WaveLinx Pro, SR Driver, Dimming Motion and Daylight, WAC Programmable, 7' - 15' Mounting ^{12,15,16,17,22} ZD-SWPD5XX=WaveLinx Pro, SR Driver, Dimming Motion and Daylight, WAC Programmable, 15' - 40' Mounting ^{12,15,16,17,28,29}</p> <p>(See Table Below)=LumenSafe Integrated Network Security Camera ^{18,19}</p>			<p>PRVSA-XX=Standard Arm Mounting Kit ²² PRVMA-XX=Mast Arm Mounting Kit ²² PRVWM-XX=Wall Mount Kit ²² PRV-ADJA-XX=Adjustable Arm - Pole Mount Kit ²² PRV-ADJS-XX=Adjustable Arm - Slipfitter Kit ²² PRV-ADJA-WM-XX=Adjustable Arm - Wall Mount Kit ²² PRVXLSA-XX=Standard Arm Mounting Kit ²⁹ PRVXLSA-XX=Mast Arm Mounting Kit ²⁹ PRVXLWM-XX=Wall Mount Kit ²⁹ PRV-XL-ADJA-XX=Adjustable Arm - Pole Mount Kit ²⁹ PRV-XL-ADJS-XX=Adjustable Arm - Slipfitter Kit ²⁹ PRV-XL-ADJA-WM-XX=Adjustable Arm - Wall Mount Kit ²⁹ PRV-M-ADJA-XX=Adjustable Arm - Pole Mount Kit ²⁸ PRV-M-ADJS-XX=Adjustable Arm - Slipfitter Kit ²⁸ PRV-M-ADJA-WM-XX=Adjustable Arm - Wall Mount Kit ²⁸ MA1010-XX=Single Tenon Adapter for 3-1/2" O.D. Tenon MA1011-XX=2@180° Tenon Adapter for 3-1/2" O.D. Tenon</p> <p>MA1017-XX=Single Tenon Adapter for 2-3/8" O.D. Tenon MA1018-XX=2@180° Tenon Adapter for 2-3/8" O.D. Tenon SRA238=Tenon Adapter from 3" to 2-3/8" PRV/COB-FDV=Full Drop Visor ²³ PRVXL/COB-FDV=Full Drop Visor ¹⁸ HS/VERD=House Side Shield Kit ^{8,24} VGS-F/B= Vertical Glare Shield Kit, Front/Back ²⁴ VGS-SID=Vertical Glare Shield Kit, Side ²⁴ OA/RA1013=Photocontrol Shorting Cap OA/RA1014=NEMA Photocontrol - 120V OA/RA1016=NEMA Photocontrol - Multi-Tap 105-285V OA/RA1201=NEMA Photocontrol - 347V OA/RA1027=NEMA Photocontrol - 480V FSIR-100=Wireless Configuration Tool for Occupancy Sensor ²⁵ WOLC-7P-10A=WaveLinx Outdoor Control Module (7-PIN) ²⁷ SWPD4-XX=WaveLinx Sensor, Dimming Motion and Daylight, WAC Programmable, 7' - 15' Mounting ^{15,16,17,22,26} SWPD5-XX=WaveLinx Sensor, Dimming Motion and Daylight, WAC Programmable, 15' - 40' Mounting ^{15,16,17,26,28,29}</p>				
<p>NOTES:</p> <ol style="list-style-type: none"> DesignLights Consortium® Qualified. Refer to www.designlights.org Qualified Products List under Family Models for details. Customer is responsible for engineering analysis to confirm pole and fixture compatibility for all applications. Refer to installation instructions IB500002EN and pole white paper WP513001EN for additional support information. Only product configurations with these designated prefixes are built to be compliant with the Buy American Act of 1933 (BAA) or Trade Agreements Act of 1979 (TAA), respectively. Please refer to DOMESTIC PREFERENCES website for more information. Components shipped separately may be separately analyzed under domestic preference requirements. Standard 4000K CCT and 70CRI. 480V not to be used with ungrounded or impedance grounded systems. DuraVolt drivers feature added protection from power quality issues such as loss of neutral, transients and voltage fluctuations. Visit www.signify.com/duravolt for more information. Use dedicated IES files on product website for non-standard CCTs. House Side Shield not suitable with T5 distribution. Not available with PRV-C60 lumen package. Not available with PRV-C60 lumen package. Not available with PRV-P-C25 lumen package. Coastal construction finish salt spray tested to over 5,000-hours per ASTM B117, with a scribe rating of 9 per ASTM D1654. If DuraVolt (DV) is specified, use a photocontrol that matches the input voltage used. Controls system is not available in combination with a photocontrol receptacle (PR & PER7) or another controls system (MS, SPB, ZD, or ZW). Option not available with DuraVolt (DV) voltage option. Utilizes the Wattstopper sensor FSP-211. Sensor color white unless specified otherwise via PDR. To field-configure, order FSIR-100 accessory separately. Utilizes the Wattstopper sensor FSP-3XX series. Sensor color determined by product finish. See Sensor Color Reference Table. Field-configures via mobile application. See Controls section for details. Sensor passive infrared (PIR) may be overly sensitive when operating below -20°C (-4°F). For the device to be field-configurable, requires WAC Gateway components WAC-PoE and WPOE-120 in appropriate quantities. Only compatible with WaveLinx system and software and requires system components to be installed for operation. See website for more WaveLinx application information. Replace XX with sensor color (WH, BZ, or BK). Only available in PRV-XL configurations C75, C100, C125, C150, or C175. Not available with 347V, 480V, DV, or HA options. Consult LumenSafe system product pages for additional details and compatibility information. Replace XX with paint color. For BAA or TAA requirements, Accessories sold separately will be separately analyzed under domestic preference requirements. Consult factory for further information. Not for use with PRV-XL or PRV-M configurations. Only for use with PRV. Not applicable to PRV-M, PRV-XL, or PRV-P. Must order one per optic/LED when ordering as a field-installable accessory (1, 2, 4, 6 or 9). This tool enables adjustment to Motion Sensor (MS) parameters including high and low modes, sensitivity, time delay, cutoff and more. Consult your lighting representative for more information. Requires 4-PIN twistlock receptacle (ZD or ZW) option. Requires 7-PIN NEMA twistlock photocontrol receptacle (PR & PER7) option. The WOLC-7 cannot be used in conjunction with other controls systems (MS, ZD, ZW or LWR). Operates on 120-347V input voltages. Only for use with PRV-M configurations. Only for use with PRV-XL configurations. Fixed for PRV-M. 							

LumenSafe Integrated Network Security Camera Technology Options (Add as Suffix)


Product Family	Camera Type	Data Backhaul		
L=LumenSafe Technology 	H=Dome Camera, High Res Z=Dome Camera, Remote PTZ	C=Cellular, Customer Installed SIM Card A=Cellular, Factory Installed AT&T SIM Card	V=Cellular, Factory Installed Verizon SIM Card S=Cellular, Factory Installed Sprint SIM Card	E=Ethernet Networking

Stock Ordering Information


Product Family ¹	Light Engine	Voltage	Distribution
PRVS=Prevail	C15=(1 LED) 7,100 Nominal Lumens C25=(2 LEDs) 13,100 Nominal Lumens C40=(2 LEDs) 17,100 Nominal Lumens C60=(2 LEDs) 20,000 Nominal Lumens	UNV=Universal (120-277V) 347=347V ²	T3=Type III T4=Type IV
PRVS-XL=Prevail XL	C75=(4 LED) 26,100 Nominal Lumens C100=(4 LED) 31,000 Nominal Lumens C125=(4 LED) 36,000 Nominal Lumens C150=(6 LED) 41,100 Nominal Lumens C175=(6 LED) 48,600 Nominal Lumens		
<p>NOTES:</p> <ol style="list-style-type: none"> All stock configurations are standard 4000K/70CRI, bronze finish, and include the standard versatile mounting arm. Only available in PRVS configurations C15, C25, C40 or C60. 			

Mounting Details


SA=QM Pole Mount Arm (PRV & PRV-P)

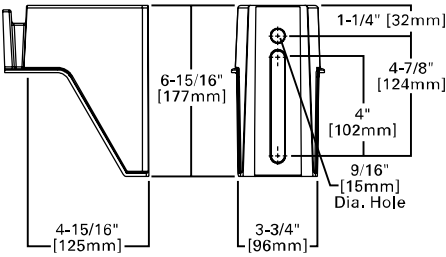


SA=QM Pole Mount Arm (PRV-XL)

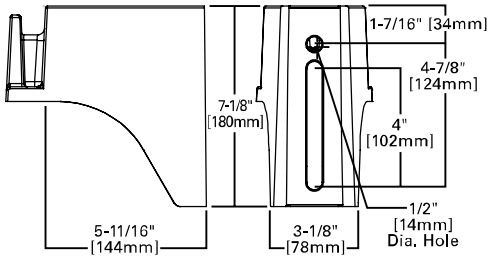


WM=QM Wall Mount Arm (PRV & PRV-P)

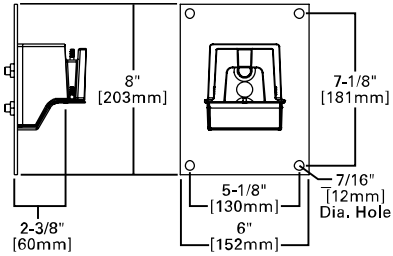


WM=QM Wall Mount Arm (PRV-XL)

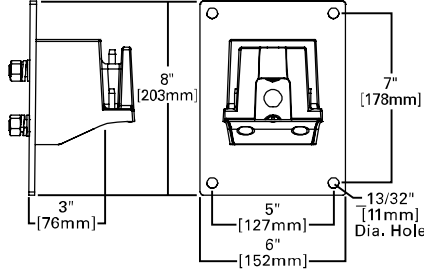


MA=QM Mast Arm (PRV & PRV-P)

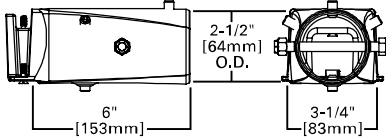


MA=QM Mast Arm (PRV-XL)

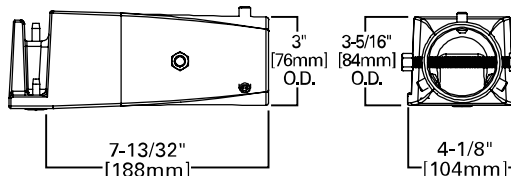


ADJA=Adjustable Arm Pole Mount (PRV & PRV-P)

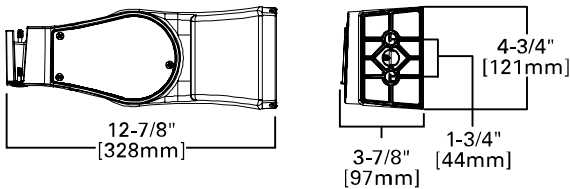


ADJA=Adjustable Arm Pole Mount (PRV-XL)

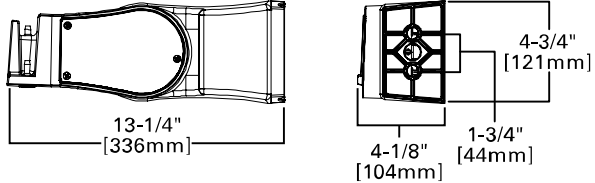


ADJA-WM=Adjustable Arm Wall Mount (PRV & PRV-P)

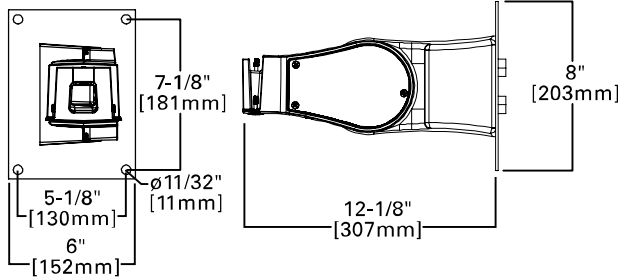


ADJA-WM=Adjustable Arm Wall Mount (PRV-XL)

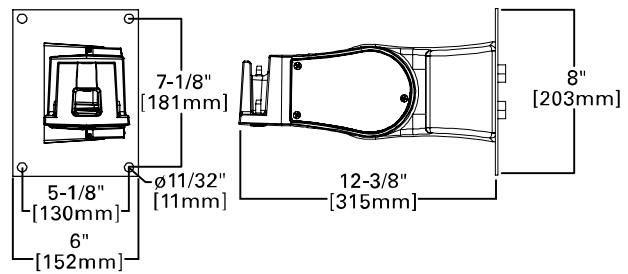

ADJS=Adjustable Slipfitter 3 (PRV & PRV-P)

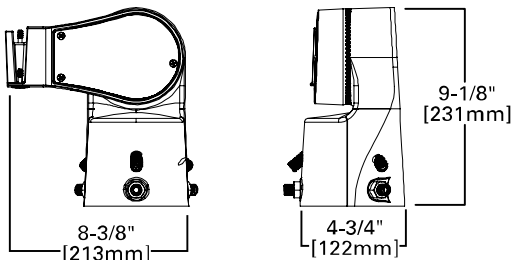


ADJS=Adjustable Slipfitter 3 (PRV-XL)

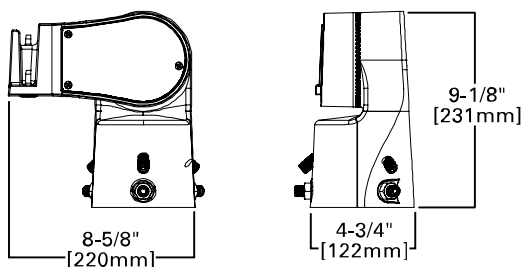


Mounting Details


SA=QM Pole Mount Arm (PRV-M)

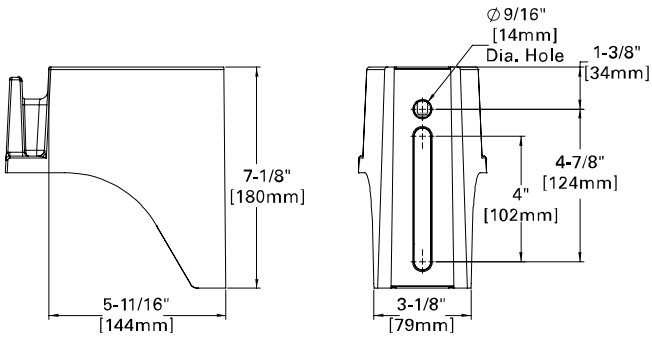


WM=QM Wall Mount Arm (PRV-M)

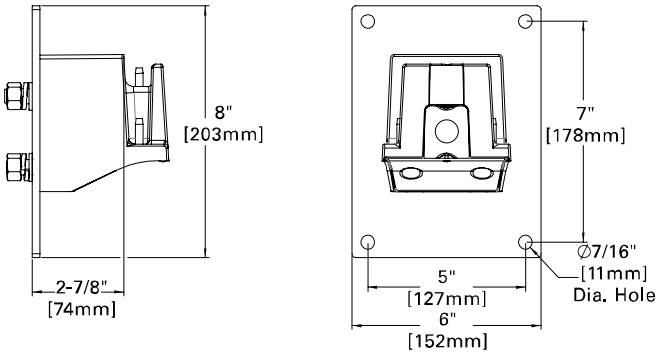


MA=QM Mast Arm (PRV-M)

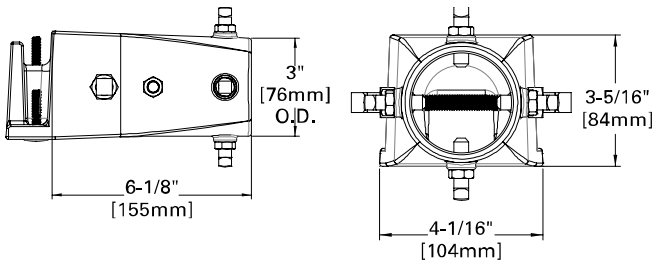


FMA=Fixed Mast Arm (PRV-M)

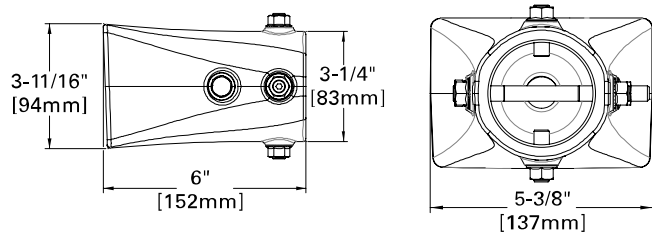


DM=Direct Pole Mount Arm (PRV-M)

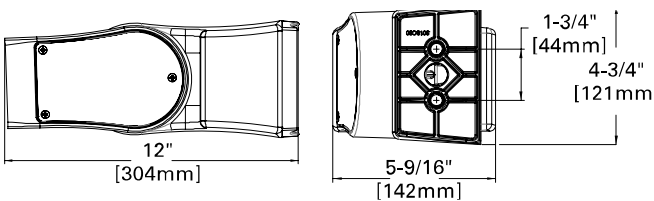


Versatile Mount System

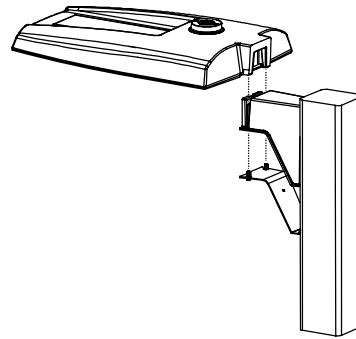

ADJS=Adjustable Slipfitter (PRV-M)

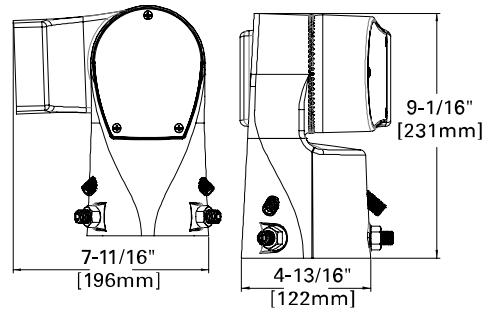

SP2=Adjustable Slipfitter 2-3/8\" (PRV-M)

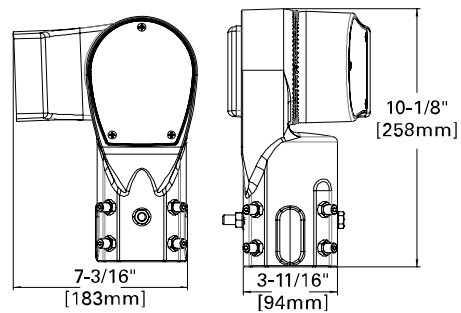

Mounting Details

Mounting Configurations and EPAs

NOTE: For 2 PRV's mounted at 90°, requires minimum 3" square or 4" round pole for fixture clearance. For 2 PRV-XL's mounted at 90°, requires minimum 4" square or round pole for fixture clearance. Customer is responsible for engineering analysis to confirm pole and fixture compatibility for applications.


Housing Size	Tilt Angle (Degrees)	Arm Mount Single	Arm Mount 2 @ 180°	Arm Mount 2 @ 90°	Arm Mount 3 @ 90°	Arm Mount 4 @ 90°
Prevail Petite	0°	0.54	1.08	0.84	1.38	1.38
	60°	1.68	1.85	2.42	3.15	3.30
Prevail	0°	0.92	1.35	1.42	1.63	1.63
	60°	2.20	2.40	3.05	3.88	4.07
	60° + Full Drop Visor	2.20	2.40	3.25	4.28	4.47
Prevail XL	0°	1.12	2.25	2.13	2.52	2.52
	60°	3.99	4.30	5.26	6.51	6.79
	60° + Full Drop Visor	3.99	4.30	5.59	7.17	7.49
Prevail Maxx	0°	1.28	2.56	1.7	2.69	2.69
	60°	5.09	5.52	6.34	7.49	7.81

Optical Configurations

PRV-P-C10/C15/C20/C25
(4,900/6,900/9,800/11,800 Nominal Lumens)




PRV-C15
(7,100 Nominal Lumens)




PRV-C25/C40/C60
(13,100/17,100/20,000 Nominal Lumens)




PRV-XL-C75/C100/C125
(26,100/31,000/36,300 Nominal Lumens)




PRV-XL-C150/C175
(41,100/48,600 Nominal Lumens)



PRV-M-PA6X
(50,000/60,000/70,000/80,000 Nominal Lumens)



Optical Distributions

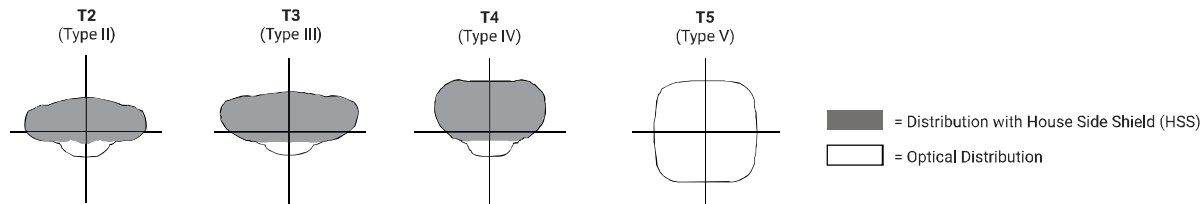

Product Specifications

Construction

- Single-piece die-cast aluminum housing
- Tethered die-cast aluminum door

Optics

- Dark Sky Approved (3000K CCT and warmer only)
- Precision molded polycarbonate optics

Electrical

- -40°C minimum operating temperature
- 40°C maximum operating temperature
- >.9 power factor
- <20% total harmonic distortion
- Class 1 electronic drivers have expected life of 100,000 hours with <1% failure rate
- 0-10V dimming driver is standard with leads external to the fixture
- Standard MOV surge protective device designed to withstand 10kV of transient line surge

Mounting

- Versatile, patented, standard mount arm accommodates multiple drill patterns ranging from 1-1/2" to 4-7/8" (Type M drilling recommended for new installations)
- A knock-out on the standard mounting arm enables round pole mounting
- Adjustable pole and wall mount arms adjust in 5° increments from 0° to 60°; Downward facing orientation only (Type N drilling required for ADJA mount)
- Adjustable slipfitter arm adjusts in 5° increments from -5° to 85°; Downward facing orientation only
- Adjustable Arms: 1.5G vibration rated
- Prevail and Prevail Petite: 3G vibration rated
- Prevail XL Mast Arm: 3G vibration rated
- Prevail XL Standard Arm: 1.5G vibration rated

Typical Applications

- Parking lots, Walkways, Roadways and Building Areas

Finish

- Five-stage super TGIC polyester powder coat paint, 2.5 mil nominal thickness
- Finish is compliant to 3,000 hour salt spray standard (per ASTM B117)

Shipping Data

- Prevail Petite: 18 lbs. (7.94 kgs.)
- Prevail: 20 lbs. (9.09 kgs.)
- Prevail XL: 45 lbs. (20.41 kgs.)
- Prevail Maxx: 49 lbs. (22.23 kgs.)

Warranty

- Five year limited warranty, consult website for details. www.cooperlighting.com/legal

Energy and Performance Data

[View PRV-P IES files](#)

[View PRV IES files](#)

[View PRV-XL IES files](#)

Power and Lumens

Product Family	Prevail Petite				Prevail				Prevail XL				Prevail Maxx					
Light Engine	C10	C15	C20	C25	C15	C25	C40	C60	C75	C100	C125	C150	C175	C200	C225	C250	C275	
Power (Watts)	35	49	73	94	52	96	131	153	176	217	264	285	346	346	418	487	588	
Input Current @ 120V (A)	0.29	0.41	0.61	0.79	0.43	0.80	1.09	1.32	1.50	1.84	2.21	2.38	2.92	2.89	3.49	4.06	4.90	
Input Current @ 277V (A)	0.13	0.18	0.27	0.35	0.19	0.35	0.48	0.57	0.66	0.82	0.97	1.04	1.25	1.26	1.51	1.72	2.06	
Input Current @ 347V (A)	0.11	0.16	0.23	0.29	0.17	0.30	0.41	0.48	0.54	0.66	0.79	0.84	1.02	1.00	1.21	1.40	1.70	
Input Current @ 480V (A)	0.08	0.12	0.17	0.22	0.12	0.22	0.30	0.35	0.40	0.48	0.57	0.62	0.74	0.73	0.88	1.00	1.21	
Distribution ¹																		
Type II	4000K Lumens	4,775	6,717	9,542	11,521	7,123	13,205	17,172	20,083	26,263	31,231	36,503	41,349	48,876	50,349	59,444	68,447	79,322
	BUG Rating	B1-U0-G1	B1-U0-G1	B2-U0-G2	B2-U0-G2	B2-U0-G2	B2-U0-G2	B3-U0-G3	B3-U0-G3	B3-U0-G3	B3-U0-G4	B4-U0-G4	B4-U0-G4	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B5-U0-G5
	Lumens per Watt	138	137	131	122	137	138	131	131	149	144	138	145	141	146	142	141	135
	3000K Lumens ¹	4,869	6,595	9,369	11,312	6,994	12,965	16,860	19,718	25,786	30,664	35,840	40,598	47,989	49,437	58,368	67,208	77,886
Type III	4000K Lumens	4,782	6,727	9,556	11,538	7,111	13,183	17,144	20,050	26,120	31,061	36,304	41,124	48,610	50,162	59,223	68,193	79,027
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G3	B1-U0-G2	B2-U0-G3	B3-U0-G4	B3-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B5-U0-G5	B5-U0-G5
	Lumens per Watt	138	137	131	123	137	137	131	131	148	143	138	144	140	145	142	140	135
	3000K Lumens ¹	4,695	6,605	9,383	11,329	6,982	12,944	16,832	19,686	25,646	30,497	35,645	40,377	47,727	49,254	58,151	66,958	77,596
Type IV	4000K Lumens	4,880	6,865	9,752	11,774	7,088	13,140	17,087	19,984	26,098	31,035	36,274	41,089	48,569	50,575	59,711	68,754	79,678
	BUG Rating	B1-U0-G2	B1-U0-G2	B2-U0-G3	B2-U0-G3	B1-U0-G3	B2-U0-G4	B2-U0-G4	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B3-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B4-U0-G5	B5-U0-G5
	Lumens per Watt	141	140	134	125	136	137	130	131	148	143	137	144	140	146	143	141	136
	3000K Lumens ¹	4,792	6,740	9,575	11,561	6,959	12,901	16,777	19,621	25,624	30,471	35,615	40,343	47,687	49,659	58,630	67,510	78,235
Type V	4000K Lumens	5,067	7,128	10,126	12,226	7,576	14,045	18,264	21,360	28,129	33,450	39,097	44,287	52,349	53,531	63,201	72,773	84,335
	BUG Rating	B3-U0-G2	B3-U0-G2	B4-U0-G3	B4-U0-G3	B3-U0-G3	B4-U0-G3	B4-U0-G4	B5-U0-G4	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5	B5-U0-G5
	Lumens per Watt	146	145	139	130	146	146	139	140	160	154	148	155	151	155	151	150	144
	3000K Lumens ¹	4,975	6,999	9,942	12,004	7,438	13,790	17,932	20,972	27,618	32,843	38,387	43,483	51,398	52,562	62,057	71,455	82,808

NOTES:
1. For 3000K, 5000K or HSS data, refer to published IES files.

Lumen Maintenance

Configuration	TM-21 Lumen Maintenance (50,000 Hours)	Theoretical L70 (Hours)
Prevail and Prevail Petite at 25°C	91.30%	> 194,000
Prevail and Prevail Petite at 40°C	87.59%	> 134,000
Prevail XL at 25°C	91.40%	> 204,000
Prevail XL at 40°C	89.41%	> 158,000
Prevail Maxx at 25°C	91.40%	> 204,000
Prevail Maxx at 40°C	89.41%	> 158,000

Sensor Color Reference Table (SPBx)

Housing Finish	Sensor Color
AP =Grey	Grey
BZ =Bronze	Bronze
BK =Black	Black
DP =Dark Platinum	Grey
GM =Graphite Metallic	Black
WH =White	White

Lumen Multiplier




Ambient Temperature	Lumen Multiplier
10°C	1.02
15°C	1.01
25°C	1.00
40°C	0.99

Control Options

0-10V This fixture provides 0-10V dimming wire leads for use with a lighting control panel or other control method.

Photocontrol (PR and PR7) Photocontrol receptacles provide a flexible solution to enable "dusk-to-dawn" lighting by sensing light levels. Advanced control systems compatible with NEMA 7-PIN standards can be utilized with the PR7 receptacles.


Dimming Occupancy Sensor (SPB, MS/DIM-LXX) These sensors are factory installed in the luminaire housing. When the SPB or MS/DIM sensor options are selected, the luminaire will dim down after five minutes of no activity detected. When activity is detected, the luminaire returns to full light output. These occupancy sensors include an integral photocell for "dusk-to-dawn" control or "daylight harvesting." Factory default is enabled for the MS sensors and disabled for the SPB. SPB motion sensors require the Sensor Configuration mobile application by Wattstopper to change factory default dimming level, time delay, sensitivity and other parameters. Available for iOS and Android devices. The SPB sensor is factory preset to dim down to approximately 10% power with a time delay of five minutes.

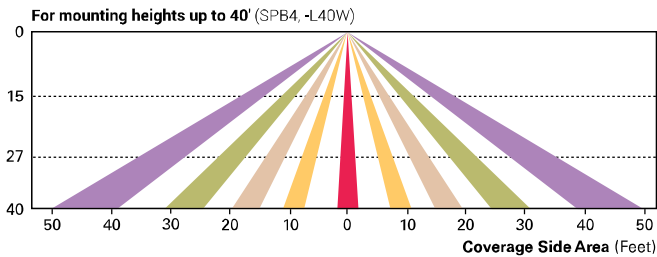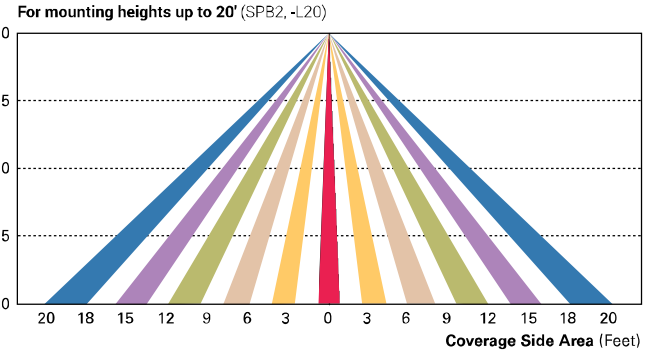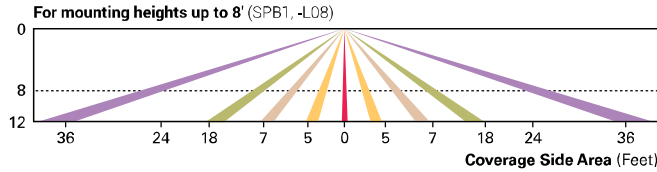

WaveLinx Wireless Control and Monitoring System Available in 7-PIN or 4-PIN configurations, the WaveLinx Outdoor control platform operates on a wireless mesh network based on IEEE 802.15.4 standards enabling wireless control of outdoor lighting. At least one Wireless Area Controller (WAC) is required for full functionality and remote communication (including adjustment of any factory pre-sets).

WaveLinx Outdoor Control Module (WOLC-7P-10A) A photocontrol that enables astronomic or time-based schedules to provide ON, OFF and dimming control of fixtures utilizing a 7-PIN receptacle. The out-of-box functionality is ON at dusk and OFF at dawn.

WaveLinx Wireless Sensor (SWPD4 and SWPD5) These outdoor sensors offer passive infrared (PIR) occupancy sensing and a photocell for closed-loop daylight sensing. These sensors can be factory installed or field-installed via simple, tool-less integration into luminaires equipped with the Zhaga Book 18 compliant 4-PIN receptacle (ZD or ZW). These sensors are factory preset to dim down to approximately 50 percent power after 15 minutes of no activity detected, and the photocell for "dusk-to-dawn" control is default enabled. A variety of sensor lenses are available to optimize the coverage pattern for mounting heights from 7'-40'.

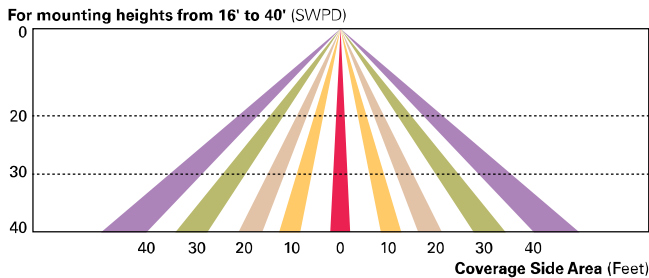

LumenSafe (LD) The LumenSafe integrated network camera is a streamlined, outdoor-ready camera that provides high definition video surveillance. This IP camera solution is optimally designed to integrate into virtually any video management system or security software platform of choice. No additional wiring is needed beyond providing line power to the luminaire. LumenSafe features factory-installed power and networking gear in a variety of networking options allowing security integrators to design the optimal solution for active surveillance.

POLE FEATURES MOUNTED AT 20' INCLUDING BASE
 LIGHT BEARS CALCULATED ON THE GROUND

Light Category	Units	Avg	Max	Min	Avg/Min	Max/Min
STREET LIGHTS	FC	2.43	7.3	0.4	5.4	16.8
CAN PARKING	FC	2.43	7.3	0.4	5.4	16.8
TRUCK AREAS	FC	2.43	7.3	0.4	5.4	16.8

Symbol	Qty	Label	Arrangement	Luminaire Spacing		Description
				LF	LF	
1	6	S1	SINGLE	1.000	1.12	PRANCKE 20' TOWER
2	4	S2	SINGLE	1.000	1.12	PRANCKE 20' TOWER
3	6	S3	SINGLE	1.000	1.12	PRANCKE 20' TOWER
4	6	S4	SINGLE	1.000	1.12	PRANCKE 20' TOWER
5	6	S5	SINGLE	1.000	1.12	PRANCKE 20' TOWER
6	6	S6	SINGLE	1.000	1.12	PRANCKE 20' TOWER
7	6	S7	SINGLE	1.000	1.12	PRANCKE 20' TOWER
8	6	S8	SINGLE	1.000	1.12	PRANCKE 20' TOWER
9	6	S9	SINGLE	1.000	1.12	PRANCKE 20' TOWER
10	6	S10	SINGLE	1.000	1.12	PRANCKE 20' TOWER
11	6	S11	SINGLE	1.000	1.12	PRANCKE 20' TOWER
12	6	S12	SINGLE	1.000	1.12	PRANCKE 20' TOWER
13	6	S13	SINGLE	1.000	1.12	PRANCKE 20' TOWER
14	6	S14	SINGLE	1.000	1.12	PRANCKE 20' TOWER
15	6	S15	SINGLE	1.000	1.12	PRANCKE 20' TOWER
16	6	S16	SINGLE	1.000	1.12	PRANCKE 20' TOWER
17	6	S17	SINGLE	1.000	1.12	PRANCKE 20' TOWER
18	6	S18	SINGLE	1.000	1.12	PRANCKE 20' TOWER
19	6	S19	SINGLE	1.000	1.12	PRANCKE 20' TOWER
20	6	S20	SINGLE	1.000	1.12	PRANCKE 20' TOWER
21	6	S21	SINGLE	1.000	1.12	PRANCKE 20' TOWER
22	6	S22	SINGLE	1.000	1.12	PRANCKE 20' TOWER
23	6	S23	SINGLE	1.000	1.12	PRANCKE 20' TOWER
24	6	S24	SINGLE	1.000	1.12	PRANCKE 20' TOWER
25	6	S25	SINGLE	1.000	1.12	PRANCKE 20' TOWER
26	6	S26	SINGLE	1.000	1.12	PRANCKE 20' TOWER
27	6	S27	SINGLE	1.000	1.12	PRANCKE 20' TOWER
28	6	S28	SINGLE	1.000	1.12	PRANCKE 20' TOWER
29	6	S29	SINGLE	1.000	1.12	PRANCKE 20' TOWER
30	6	S30	SINGLE	1.000	1.12	PRANCKE 20' TOWER
31	6	S31	SINGLE	1.000	1.12	PRANCKE 20' TOWER
32	6	S32	SINGLE	1.000	1.12	PRANCKE 20' TOWER
33	6	S33	SINGLE	1.000	1.12	PRANCKE 20' TOWER
34	6	S34	SINGLE	1.000	1.12	PRANCKE 20' TOWER
35	6	S35	SINGLE	1.000	1.12	PRANCKE 20' TOWER
36	6	S36	SINGLE	1.000	1.12	PRANCKE 20' TOWER
37	6	S37	SINGLE	1.000	1.12	PRANCKE 20' TOWER
38	6	S38	SINGLE	1.000	1.12	PRANCKE 20' TOWER
39	6	S39	SINGLE	1.000	1.12	PRANCKE 20' TOWER
40	6	S40	SINGLE	1.000	1.12	PRANCKE 20' TOWER
41	6	S41	SINGLE	1.000	1.12	PRANCKE 20' TOWER
42	6	S42	SINGLE	1.000	1.12	PRANCKE 20' TOWER
43	6	S43	SINGLE	1.000	1.12	PRANCKE 20' TOWER
44	6	S44	SINGLE	1.000	1.12	PRANCKE 20' TOWER
45	6	S45	SINGLE	1.000	1.12	PRANCKE 20' TOWER
46	6	S46	SINGLE	1.000	1.12	PRANCKE 20' TOWER
47	6	S47	SINGLE	1.000	1.12	PRANCKE 20' TOWER
48	6	S48	SINGLE	1.000	1.12	PRANCKE 20' TOWER
49	6	S49	SINGLE	1.000	1.12	PRANCKE 20' TOWER
50	6	S50	SINGLE	1.000	1.12	PRANCKE 20' TOWER

ALL LIGHT BEARS ARE CALCULATED ON THE GROUND. THE LIGHT BEAR VALUES ARE BASED ON THE LIGHT BEAR VALUES PROVIDED IN THE SPECIFICATIONS. THE LIGHT BEAR VALUES ARE BASED ON THE LIGHT BEAR VALUES PROVIDED IN THE SPECIFICATIONS.

